


B SIZE - 279mm x 432mm
 File Name: P:\Projects\2015\15-0107-019\Drawings\15-0107-019_E25.dwg - Tab: E25 Plotted By: deroche 09/02/2016 [Fr. 3:27pm]

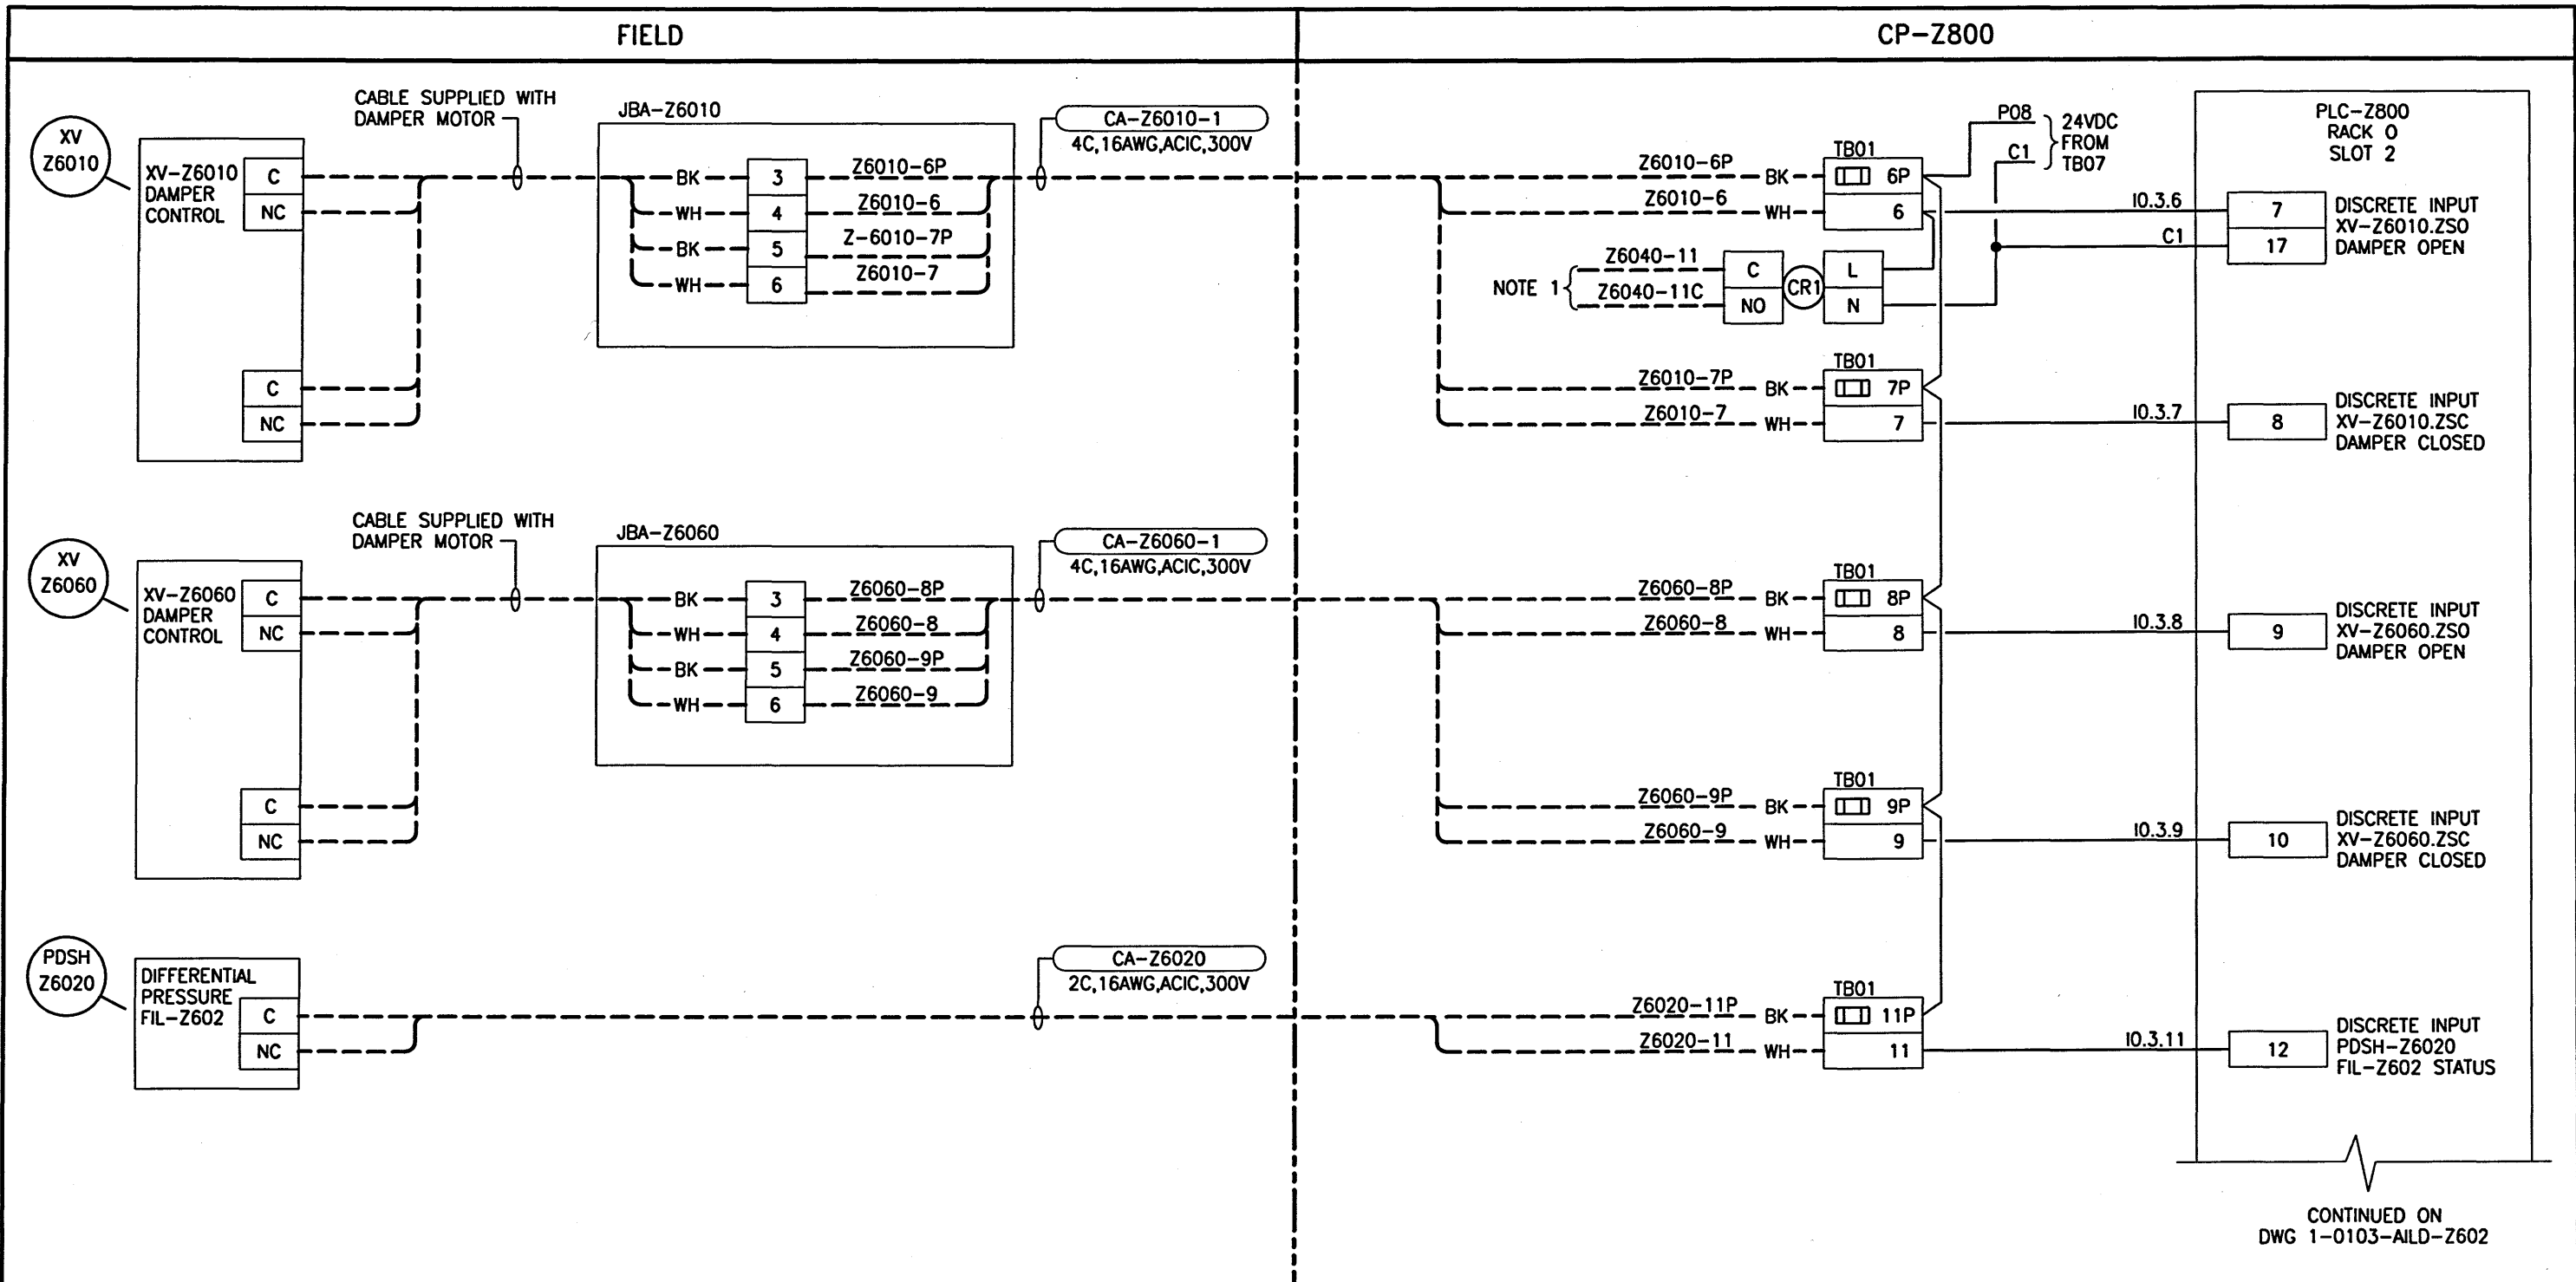

CONTINUED ON
DWG 1-0103-AILD-Z602

NOTES:
1. CONTINUED ON DRAWING 1-0103-AILD-Z602.

LEGEND:
 _____ PANEL WIRING
 - - - - - FIELD WIRING



KGS GROUP CONSULTING ENGINEERS				
DESIGNED BY: C. S. ROBINSON	CHECKED BY: <i>J.A. BOUCHARD</i>	ENGINEER'S SEAL 16/09/02		
DRAWN BY: D. SHABATAEV	APPROVED BY: <i>J.A. BOUCHARD</i>			
SCALE: N.T.S.	DATE: 2016/06/06			
BY: RELEASED FOR CONSTRUCTION DATE:				
00	ISSUED FOR CONSTRUCTION	2016/09/02	DDN <i>[Signature]</i>	CONSULTANT NO.: 15-0107-019_E25
NO.	REVISIONS	DATE	DESIGN	CHECK

THE CITY OF WINNIPEG
 WATER AND WASTE DEPARTMENT

WEST END SEWAGE TREATMENT PLANT
 EFFLUENT MONITORING STATION
 LOOP DIAGRAM
 XV-Z6010, XV-Z6060, PDSH-Z6020

CITY DRAWING NUMBER 1-0103-AILD-Z601	SHEET 1	REV. 00	SIZE B
--	-------------------	-------------------	------------------