


B SIZE - 279mm x 432mm

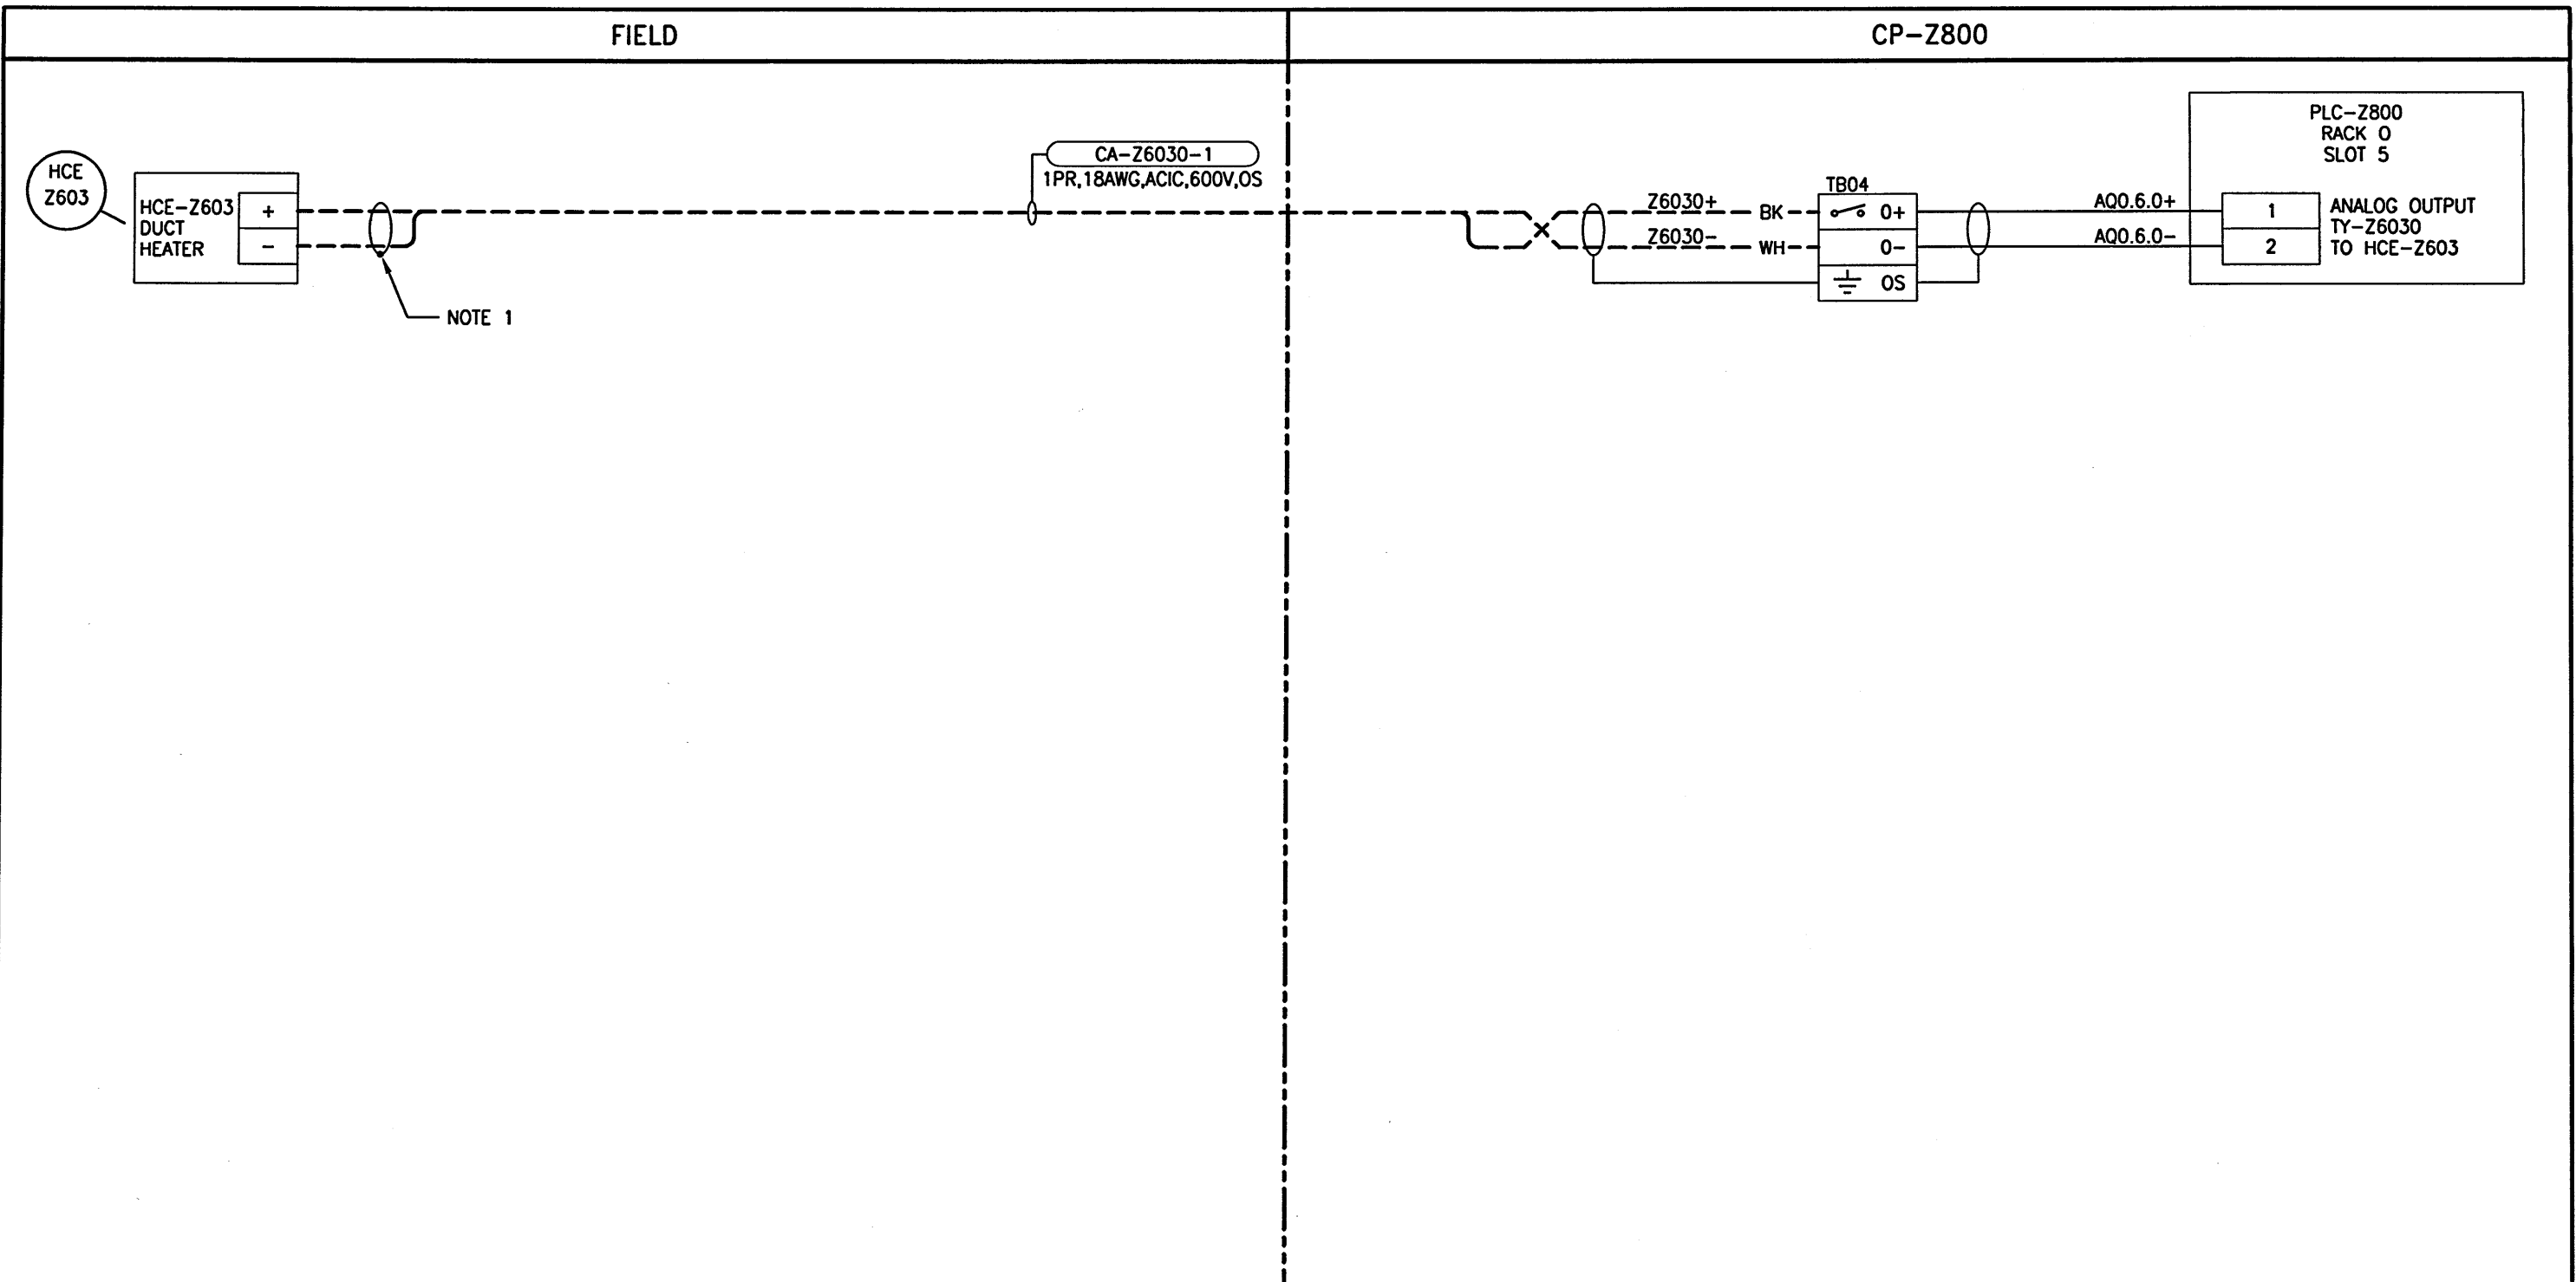

NOTE 1

NOTES:
1. ISOLATE SHIELD AT THIS END.

LEGEND:
 _____ PANEL WIRING
 - - - - - FIELD WIRING



KGS GROUP CONSULTING ENGINEERS				
NO.	REVISIONS	DATE	DESIGN	CHECK
00	ISSUED FOR CONSTRUCTION	2016/09/02	DDN	JAB

DESIGNED BY: C. S. ROBINSON	CHECKED BY: J.A. BOUCHARD
DRAWN BY: D. SHABATAEV	APPROVED BY: J.A. BOUCHARD
SCALE: N.T.S.	DATE: 2016/06/06
RELEASED FOR CONSTRUCTION DATE:	
CONSULTANT NO.: 15-0107-019_E27	

ENGINEER'S SEAL

16/09/02

THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT

WEST END SEWAGE TREATMENT PLANT
EFFLUENT MONITORING STATION
LOOP DIAGRAM
HCE-Z6030

CITY DRAWING NUMBER 1-0103-AILD-Z603	SHEET 1	REV. 00	SIZE B
---	------------	------------	-----------

Filename: P:\Projects\2015\15-0107-019\019_E27.dwg [Etc] 15-0107-019_E27.dwg - Tab: E27 Plotted By: deroche 09/02/2016 [Fr 3:26pm]