
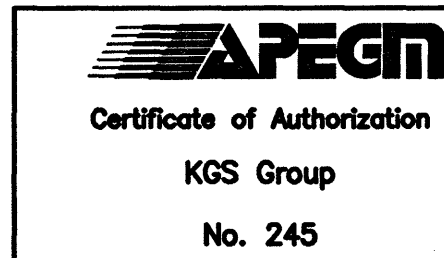



**NOTES:**

1. ALL PENETRATIONS THROUGH FLOORS AND WALL SHALL BE SEALED.

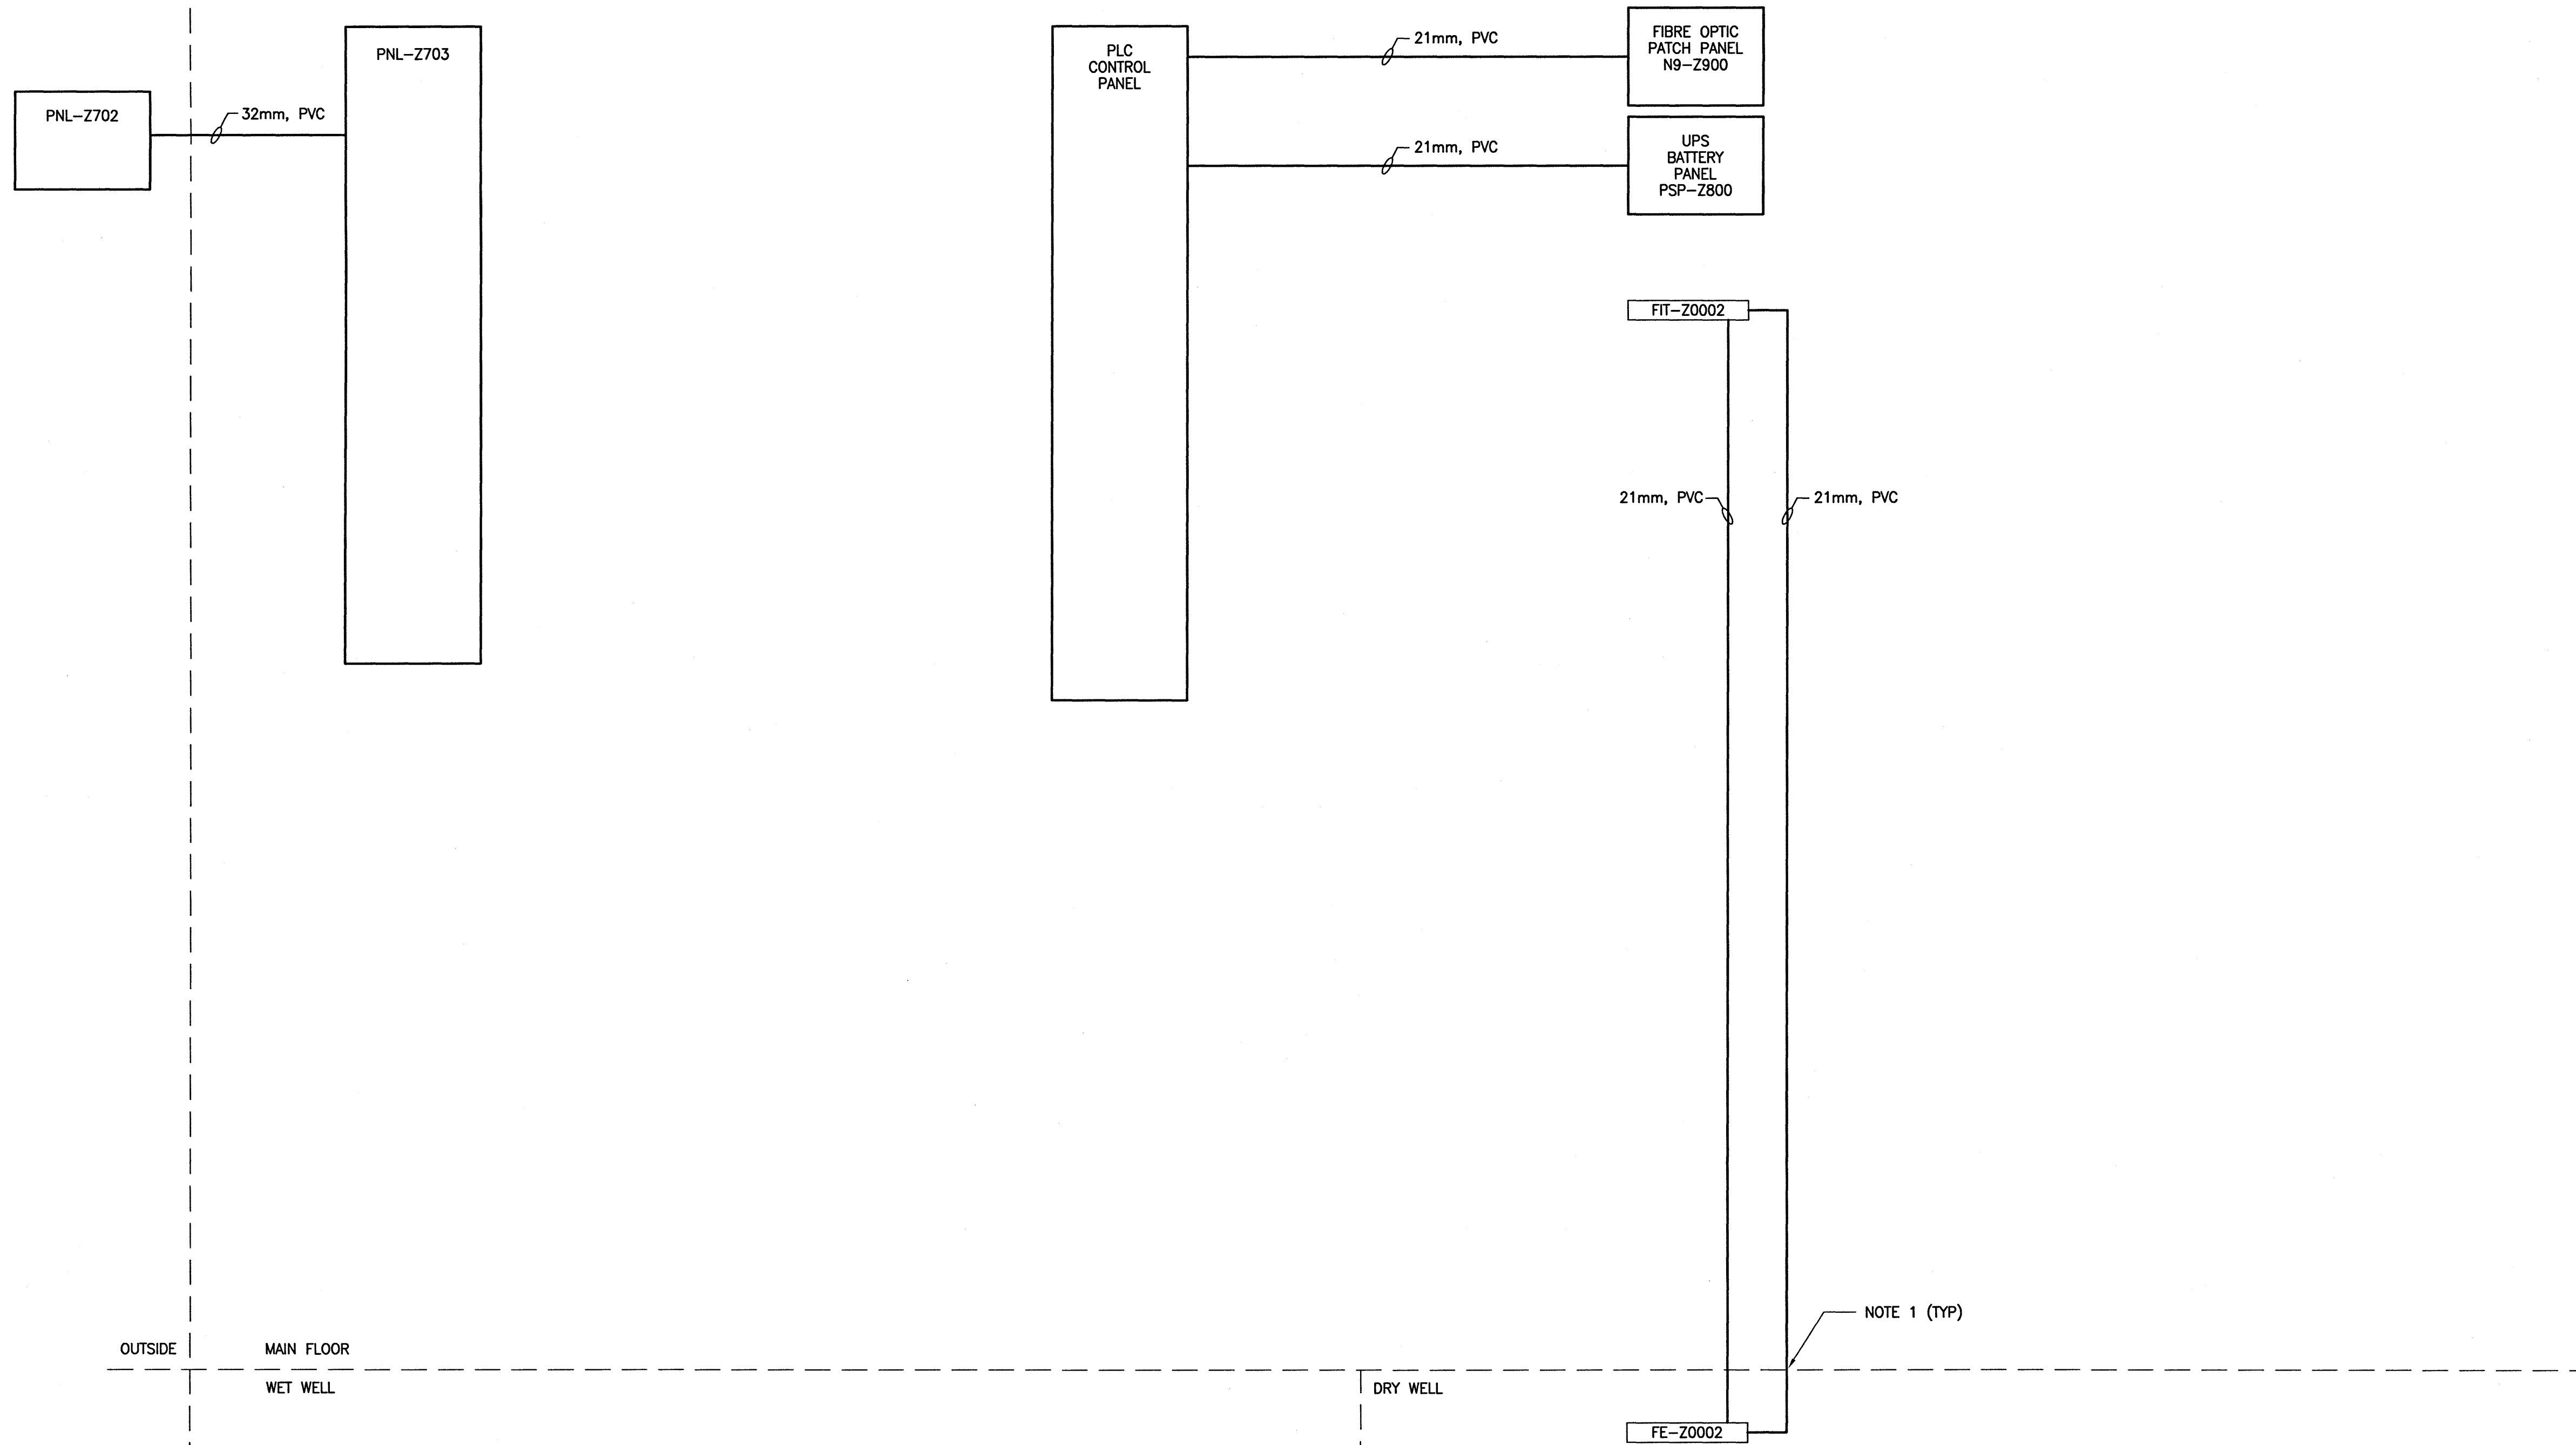

B.M.	-
ELEV.	-
00	ISSUED FOR CONSTRUCTION
NO.	REVISIONS
DATE	DESIGN CHECK

<b>KGS GROUP</b> CONSULTING ENGINEERS	
DESIGNED BY: C. S. ROBINSON	CHECKED BY: J.A. BOUCHARD
DRAWN BY: S. GUSE	APPROVED BY: J.A. BOUCHARD
SCALE: N.T.S.	ISSUED FOR CONSTRUCTION
DATE: 2016/06/27	BY: DATE:
CONSULTANT NO.: 15-0107-019_E09	

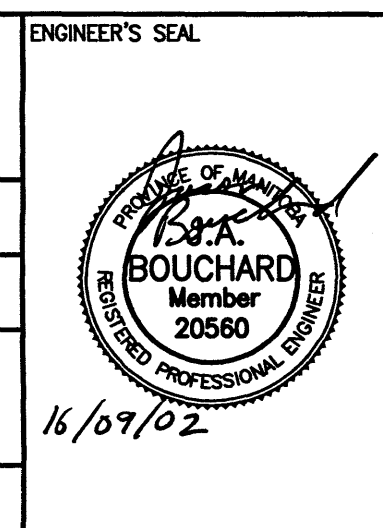

<b>THE CITY OF WINNIPEG</b> WATER AND WASTE DEPARTMENT	
WEST END SEWAGE TREATMENT PLANT EFFLUENT MONITORING STATION CONDUIT RISER DIAGRAM	
CITY DRAWING NUMBER	SHEET
1-0103-ECTR-Z001	00
REV.	SIZE
00	A1