
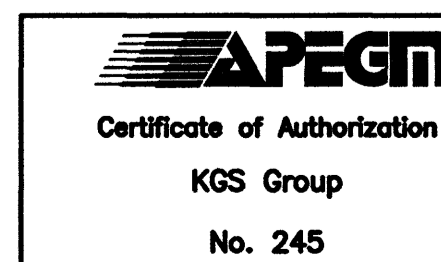



NOTES:

1. ELECTRICAL SERVICE TO EXISTING EFFLUENT CHAMBER BUILDING IS TO BE DISCONNECTED AND REMOVED WITH THE REMOVAL OF THE OVERHEAD DISTRIBUTION LINE. EQUIPMENT WITHIN BUILDING IS TO BE ABANDONED.
2. REPLACE EXISTING TWO (2) UNIT HEATERS WITHIN GATE CHAMBER BUILDING WITH NEW, SUITABLE FOR OPERATION ON 208V SINGLE PHASE SERVICE.
3. PROVIDE TEMPORARY POWER SUPPLY TO GATE CHAMBER BUILDING DURING REMOVAL OF OVERHEAD 12.47kV DISTRIBUTION AND INSTALLATION OF NEW ELECTRICAL SERVICE TO ENSURE EFFLUENT SAMPLING SYSTEM REMAINS OPERATIONAL.

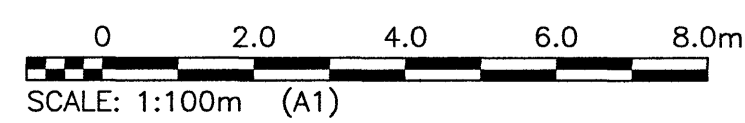

B.M. ELEV.	-
DESIGNED BY:	E. IFIONU
DRAWN BY:	S. GUSE
SCALE:	AS NOTED
DATE:	2016/05/05
ISSUED FOR CONSTRUCTION	2016/09/02
NO. REVISIONS	

KGS GROUP CONSULTING ENGINEERS	
CHECKED BY:	J.A. BOUCHARD
APPROVED BY:	J.A. BOUCHARD
ISSUED FOR CONSTRUCTION BY:	
DATE:	16/09/02
CONSULTANT NO.:	15-0107-019_E17

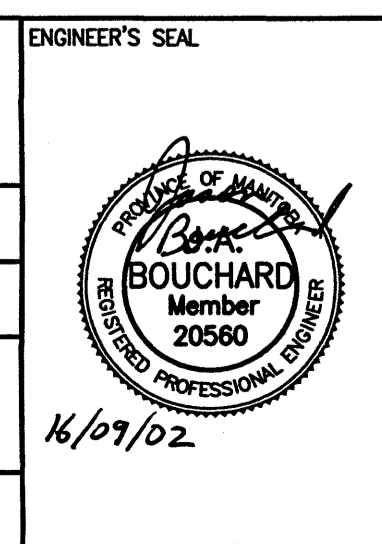

THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT

WEST END SEWAGE TREATMENT PLANT
EFFLUENT MONITORING STATION
PARTIAL ELECTRICAL SITE PLAN
BURIED CABLE ROUTING
EFFLUENT MONITORING STATION AREA

CITY DRAWING NUMBER	SHEET	REV.	SIZE
1-0103-EGAD-Z004	00	00	A1