
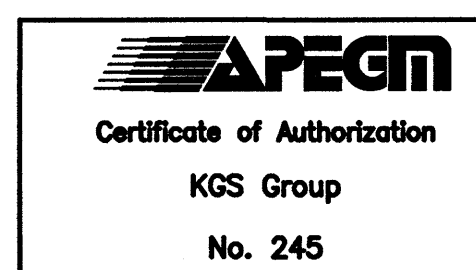


- NOTES:**
1. ALL LUMINAIRES IN DRY WELL ARE MOUNTED 2 METERS ABOVE FINISHED FLOOR.
 2. ALL LUMINAIRES IN WET WELL TO BE MOUNTED 0.3 METERS BELOW CEILING AND ACCESSIBLE FROM THE LADDER.
 3. EMERGENCY LIGHTING HEAD TO BE MOUNTED 2 METRES ABOVE PLATFORM.

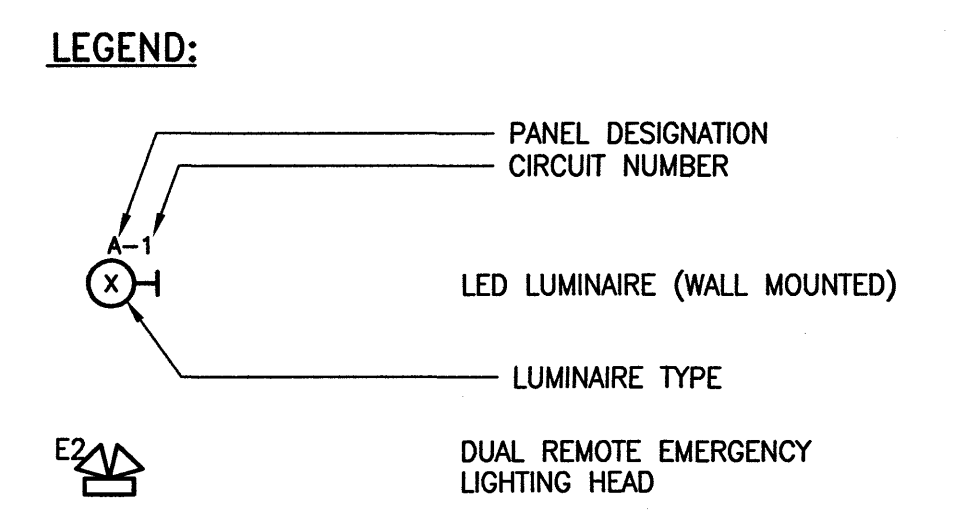

B.M.	-		
ELEV.	-		
DESIGNED BY:	E. IFIONU		
CHECKED BY:	J.A. BOUCHARD		
DRAWN BY:	S. GUSE		
APPROVED BY:	J.A. BOUCHARD		
SCALE:	AS NOTED		
ISSUED FOR CONSTRUCTION BY:			
DATE:	2016/03/18		
CONSULTANT NO.:	15-0107-019_E05		
NO.	REVISIONS	DATE	DESIGN CHECK
00	ISSUED FOR CONSTRUCTION	2016/09/02	J.A. BOUCHARD

KGS GROUP
 CONSULTING ENGINEERS

ENGINEER'S SEAL

THE CITY OF WINNIPEG
 WATER AND WASTE DEPARTMENT

WEST END SEWAGE TREATMENT PLANT
 EFFLUENT MONITORING STATION
 GENERAL ARRANGEMENT DRAWING
 LOWER LEVEL PLAN
 LIGHTING LAYOUT

CITY DRAWING NUMBER	SHEET	REV.	SIZE
1-0103-ELTG-Z002	00	00	A1