


KEYNOT	ES:
1	PANELBOARD 'AA' 347/600VAC COMPLETE WITH CIRCUIT BREAKERS.
2	100A-3P SERVICE ENTRANCE RATED MAIN BREAKER IN TYPE 1 ENCL.
3	600VAC, 120 KA TVSS/SPD.
4	PANELBOARD 'A' 240/120 C/W 100A MAIN BREAKER AND BRANCH CIRCUIT BREAKERS.
5	30 A SLUICE GATE ACTUATOR LOCKABLE DISCONNECT SWITCH BY ALLEN BRADLEY 194E-GA32.
6	7.5 KVA 600-240/120VAC TRANSFORMER BY HAMMOND.
7	NEMA 3R CUSTOM MADE FREE STANDING ENCLOSURE C/W BACKPAN AND SOLID BARRIER. MINIMUM APPROXIMATE SIZE 92"H x 116"W x 24"D WITH DRIP SHIELD.
8	METER SOCKET WITH NEUTRAL KIT. MOUNTED AT 70" AFF AS PER MB HYDRO STANDARD.
9	RTU CONTROL PANEL. REFER TO DRAWING 101 TO 118 FOR DETAILS.
(10)	GFCI DUPLEX RECEPTACLE
(11)	CHAMBER AND GATE LIGHT SWITCHES
(12)	VIEWING WINDOW.
(13)	400W PANEL HEATER BY HOFFMAN DAH-4001B
(14)	TVSS/SPD 240VAC BY SCHNEIDER TVS120XR50S
(15)	SP-01 SUMP PUMP CONTROL PANEL
(16)	ROXTEC GLAND RG M63 COMPLETE WITH ROXTEC GLAND M63 CONDUIT ADAPTER. SIZE AS REQUIRED.
(17)	CONDUIT EXPANSION JOINT FITTING.

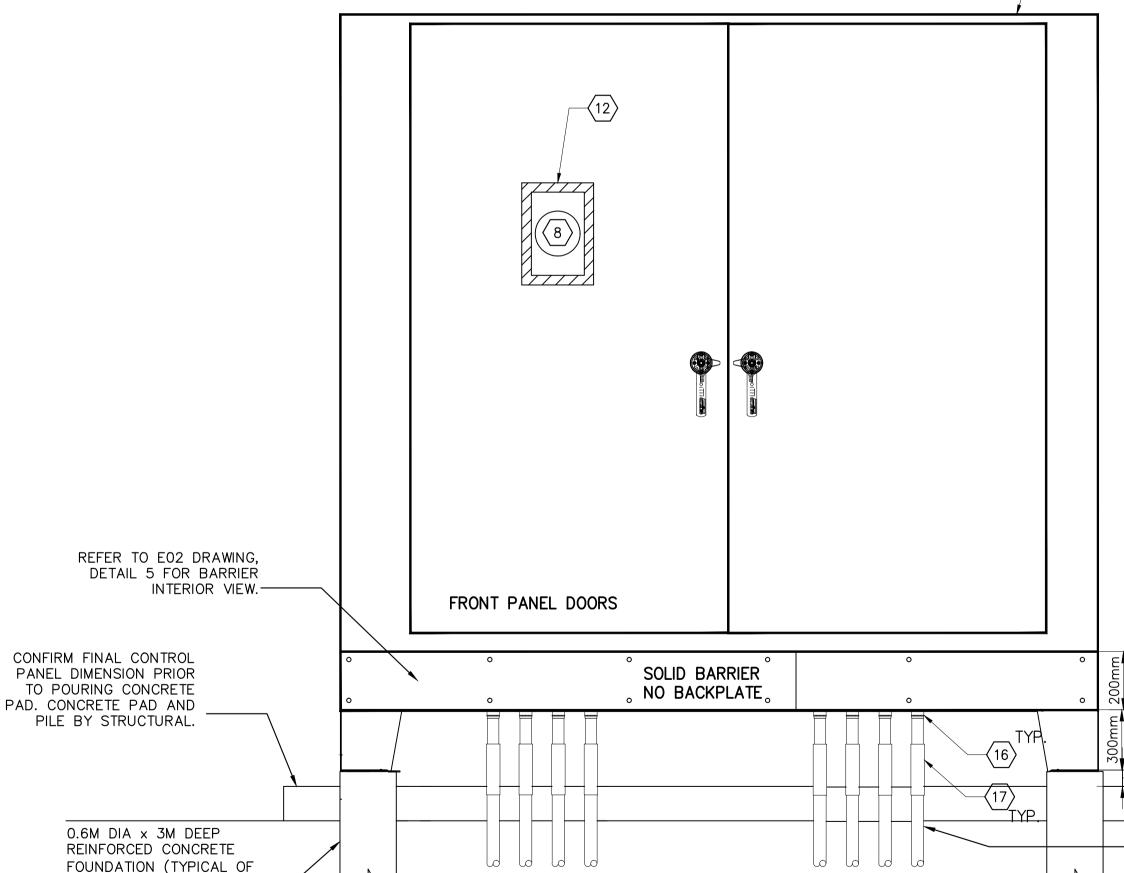

WHOLE NUMBERS INDICATE MILLIMETRES 1600 BUFFALO PLACE, WINNIPEG, MANITOBA CANADA R3T 6B8 PHONE: 204-477-6650 FAX: 204-474-2864 WWW.WSPGROUP.COM DECIMALIZED NUMBERS INDICATE METRES DESIGNED CHECKED HP DG **APEGIN** APPROVED HP DG Certificate of Authorization AS NOTED RELEASED FOR AS NOTED No. 5750 Date: SEP. 07, 2016 VERTICAL ISSUED FOR TENDER 109/07/16 HP NO. REVISIONS DATE DATE 2016/09/07 BY


-ALL CONDUITS TO SLUICE GATE AND SUMP PUMP SHALL BE

JUNCTION BOX (TYP.)

WSP Canada Inc.

PROVIDED WITH ROXTEC SEAL AND





2016/09/07

Winnipeg

ELECTRICAL & INSTRUMENTATION GENERAL NOTES

1.1 ALL WORK SHALL CONFORM WITH WINNIPEG ELECTRICAL BYLAW AND TO LOCAL ORDINANCES HAVING JURISDICTION

1.6 CARRY OUT THE WORK IN ACCORDANCE WITH DRAWINGS, SPECIFICATIONS AND CONTRACTOR REQUIREMENTS 1.7 COMPLY WITH REGULATIONS AND REQUIREMENTS OF LOCAL INSPECTION AUTHORITY HAVING JURISDICTION. 1.8 COORDINATE THE WORK WITH ALL TRADES. KEEP CLEAR OFF ALL MECHANICAL, ARCHITECTURAL AND

1.9 CONFIRM EXACT LOCATION OF ELECTRICAL EQUIPMENT AND REPORT ANY CONFLICT TO CONTRACT ADMINISTRATOR 1.10 PROVIDE SHOP DWGS OF ALL ELECTRICAL AND INSTRUMENTATION PRODUCTS FOR REVIEW BY CONTRACT ADMINISTRATOR.

1.11 THERE ARE EXISTING ELECTRICAL SERVICES AT THE PUMPING STATION, WW TREATMENT PLANT AND LAGOON SITES.

2.1 PROVIDE ALL LABOUR, MATERIAL AND TOOLS REQUIRED TO COMPLETE ELECTRICAL WORKS IN THE SPECIFICATION.

THE SERVICES SHALL BE LOCATED AND PROTECTED, AS THEY WILL CONTINUE TO BE USED DURING INTERIM OPERATION OF

a. THE PUMP CONTROLLER (PC) AND ACTUATOR CONTROLLER (AC) (CONTROL PANELS) WILL BE SUPPLIED WITH STARTERS, OVERLOADS, CONTROL RELAYS, PILOT SWITCHES, ETC BY MANUFACTURERS. ARRANGÉ WITH THE MANUFACTURERS

b. RGS CONDUITS WITH ROXTEC RG M63 SEALS, POWER AND/OR CONTROL WIRES FOR WIRING IN HAZARDOUS AREAS

3.3 THE PUMP AND ACTUATOR SUPPLIER MAY PROVIDE SEALED POWER AND CONTROL CABLES THE CONTRACTOR SHALL.

3.4 RUN CABLES AND/ OR WIRES IN CONDUIT FOR INCOMING SERVICES, POWER AND CONTROL SERVICES, ETC CONCRETE ENCASED

4.1 PROVIDE 200A, 3P, 600V CSTE IN OUTDOOR SERVICE ENTRANCE TYPE ENCLOSURE AS MANUFACTURED BY ECH OR PRAIRIE.

5.1 THE P&C PANEL SHALL BE MADE FROM CODE GAUGE STAINLESS STEEL SHEETS WITH STIFFENERS, DOUBLE LEAF LOCKABLE DOORS. 5.2 THE P&C PANEL SHALL BE SIZED WITH ALL EQUIPMENT AS INDICATED + 20% SPARE CAPACITY. PROVIDE SHOP DWGS FOR REVIEW.

6.3 ALL PANELS SHALL BE FULLY RATED C/W MOLDED CASE BOLT-ON BREAKERS, COPPER BUS, NEUTRAL BAR AND GROUND LUG IN

8.3 PROVIDE WIRING FOR FLOATS IN PUMP AND ACTUATOR CHAMBERS AND ISB RELAYS IN DEDICATED JB INSIDE P&C PANEL AS INDICATED.

c. EMT CONDUITS WITH RAINTIGHT FITTINGS, POWER AND/OR CONTROL WIRES FOR WIRING IN P&C PANEL.

VERIFY AND INSTALL THESE AND REMAINING CABLES W/O ANY SPLICE IN CONDUITS AS REQUIRED.

3.10 FOR CLARITY, THE SKETCHES DO NOT SHOW ANY WIRING AND THOSE SHOWN ARE DIAGRAMMATIC ONLY.

SURFACE MOUNTED, FULLY ENCLOSED CSA 1 ENCLOSURE WITH HINGED COVER AND DIRECTORY.

8.1 PROVIDE LEVEL FLOATS WITH CABLES, JB, MOUNTING RAIL, ETC MANUFACTURED BY MILLTRONICS.

10.1 PROVIDE LIGHTING, HEATER AND RELATED CONTROLS INSIDE P&C PANEL, GATE AND CHAMBERS. 10.1 PROVIDE LED LUMINAIRE 120VAC LIGHTING IN CHAMBERS. REFER TO LUMINAIRE SCHEDULE. 10.1 PROVIDE 26W. 120VAC. TUBE TYPE LED LIGHTING IN RTU PANEL AND P&C PANEL AS

11.2 BOND ALL NON-CURRENT CARRYING EQUIPMENT ADEQUATELY TO SATISFACTION OF INSPECTION AUTHORITY

12.1 PROVIDE SHOP DRAWINGS OF ALL ELECTRICAL PRODUCTS SUCH AS CSPE PANEL, METER, POWER PANELS, TRANSFORMER,

14.1 PROVIDE SHOP DRAWINGS OF ALL INSTRUMENTATION PRODUCTS SUCH AS RTU, MODEM, FLOAT, PUMP CONTROLLER ACTUATOR CONTROLLER AND RTU CONTROL PANEL COMPLETE WITH WIRING DIAGRAM AND LOOP DIAGRAM, ETC FOR REVIEW AND APPROVAL PRIOR TO ANY PURCHASE.

b. START-UP THE PUMP AND ACTUATOR MANUALLY FROM FROM THE CONTROLLERS AND RTU; ENSURE THAT THEY OPERATE

d. SIMULATE THE OPERATION OF CONTROLLING DEVICE AND CHECK IF THEY SEND/ RECEIVE SIGNALS SATISFACTORY. e. ENSURE THAT REMOTE ALARMS AND STATUS ARE WELL RECEIVED AT THE RTÚ AND AT REMOTE LOCATION.

11.3 PROVIDE 3 x 20mm x 3M GROUND RODS OUTSIDE P&C PANEL AND INTERCONNECTING GROUND WIRE.

SWITCHES, POWER & CONTROL PANEL, ETC FOR REVIEW AND APPROVAL PRIOR TO ANY PURCHASE.

15.1 IDENTIFY ALL EQUIPMENT USING LAMICOID NAMEPLATE WITH NAME, NUMBER, VOLTAGE, AMPS, SOURCE

15.2 AT THE END OF THE CONSTRUCTION AND IN COOPERATION WITH THE MECHANICAL TRADE, COMMISSION

a. JOG EVERY EQUIPMENT THAT HAS MOTOR, ONE AT A TIME, FOR CORRECT ROTATION AND OPERATION.

c. SIMULATE THE OPERATION OF LEVEL FLOATS AND CHECK IF THE PUMPS START CORRECTLY.

13.1 RECORD ACCURATELY ALL AS-BUILT REVISIONS TO ELECTRICAL SYSTEMS AS JOB PROGRESS.

11.1 PROVIDE A SEPARATE AND CONTINUOUS GROUND WIRE SYSTEM THROUGHOUT.

13.2 HAND OVER A SET TO CONTRACTOR AT THE COMPLETION OF PROJECT.

THE ALL SYSTEMS IN ACCORDANCE WITH SPEC#1500 AND AS FOLLOWS:

f. FINALLY STARTUP THE ENTIRE ELECTRICAL AND INSTRUMENTAION SYSTEMS.

7.1 PROVIDE LOW VOLTAGE TRANSFORMER WITH RESIN ENCAPSULATED WINDINGS AND RATING AS INDICATED IN

9.2 THE ELECTRICAL TRADE WILL COORDINATE SHOP DWG'S AND FAT OF AND INFORM THE OWNER OF THE SCHEDULE.

3.7 ALL UG WIRES IN CONDUIT SHALL BE COPPER WITH RWU90 XLPE INSULATION AND COLOUR-

4.2 PROVIDE 100A, 600V ELECTRIC METER AND SOCKET TO MANITOBA HYDRO STANDARDS. 4.3 PAY, COORDINATE AND ARRANGE WITH MANITOBA HYDRO FOR 600VAC SERVICE TO THE SITE.

CSA 1 ENCLOSURE TO BE MOUNTED INSIDE WEATHER ENCLOSURE P&C PANEL.

3.5 WHERE THERE IS VEHICULAR AREAS, THE UG WIRING SHALL BE INSTALLED IN CONCRETE ENCASED SLEEVES. 3.6 PROVIDE ALL SUPPORTS AND MOUNTING HARDWARE FOR WIRING AND EQUIPMENT TO GENERAL AND

d. PROVIDE P&C PANEL C/W INTERIOR LIGHTING, HEATER/ THERMOSTAT, POWER PANELS, LV TRANSFORMER, RTU SYSTEM, DISTRIBUTION PANELS ETC AS INDICATED.

f. PROVIDE OUTDOOR RACK FOR MOUNTING P&C P&C PANEL, AND HYDRO METER ON CONCRETE PAD..
g. PROVIDE ALL POWER AND CONTROL WIRING IN P&C PANEL, BETWEEN P&C P AND ACTUATOR CHAMBER AND PUMP CHAMBER AND HYDRO Tx..

1.8 REFER TO OTHER DESIGN DISCIPLINE DRAWINGS AND VERIFY ALL DIMENSIONS PRIOR TO INSTALLATION.

1.4 ALL EQUIPMENT SHALL BE NEW AND BEAR CSA APPROVAL STICKER UNLESS NOTED OTHERWISE.

2.2 GENERALLY, THE EXTENT OF WORK SHALL INCLUDE BUT NOT BE LIMITED TO THE FOLLOWING:

1.2 OBTAIN ELECTRICAL PERMIT AND PAY ALL FEES LEVIED. 1.3 PROVIDE CERTIFICATION AT COMPLETION OF WORK.

TO PROVIDE SHOP DWG'S AND FAT RESULTS. b. THE CONTRACTOR SHALL OBTAIN THE PC AND AC CPs. c. INSTALL PC IN POWER & CONTROL PANEL (P&C P).

e. PROVIDE 200A CSTE PADMOUNTED AND HYDRO METER & SOCKET.

2.3 COORDINATE, MAKE ARRANGEMENTS AND PROVIDE POWER TO THE SITE.

3.2 UNDERGROUND (UG) PORTION OF THE WIRING MAY BE PVC CONDUITS.

IN VEHICULAR AREAS AND DIRECTLY BURIED ELSEWHERE.

3.11 RUN WIRING IN PARALLEL OR PERPENDICULAR TO BUILDING AXIS.

h. PROVIDE GROUNDING WITH CONFORMANCE TO WINNIPEG ELECTRICAL BYLAW.

AND AREAS SUBJECT TO MECHANICAL DAMAGE SUACH AS ABOVE GROUND.

3.8 RW90 XLPE WIRES IN CONDUIT WILL BE ACCEPTED ONLY IN AG APPLICATION.

3.9 PROVIDE A SEPARATE GREEN INSULATED GROUND WIRE IN EVERY RACEWAY.

STRUCTURAL FEATURES.

THE PUMPING STATION.

h. PROVIDE RTU CONTROL PANEL.

a. WIRES IN RIGID CONDUITS THROUGHOUT.

WIRING SYSTEM 3.1 ALL WIRING SHALL BE:

STANDARD PRACTICES

CODED TO MATCH PHASES.

INCOMING POWER SERVICE

POWER & CONTROL PANEL

8. LEVEL FLOAT SWITCHES AND ISB RELAYS

8.2 PROVIDE INTRINSICALLY SAFE BARRIER RELAYS AS INDICATED.

9.1 THE CITY OF WINNIPEG SHALL PROVIDE WIRELESS MODEM.

9.3 PROVIDE ALL CONTROL WIRING AND MAKE CONNECTIONS.

MANUFACTURED BY OMNILUMEN/ HUBBELL.

6. POWER PANELS 6.1 PROVIDE 600VAC PANEL.

9. REMOTE TERMINAL UNIT

10. LIGHTING AND HEATER

AND MANUFACTURER.

14. SHOP DRAWINGS - INSTRUMENTATION

PER MANUFACTURER'S REQUIREMENTS.

15.3 CLEAN THE AREA AND REMOVE DEBRIS OFF SITE.

15. COMMISSIONING AND HANDOVER

(FED FROM), ETC

11. GROUNDING

1.5 EXAMINE THE SITE THOROUGHLY FOR SERVICE POINT LOCATIONS.

THE CITY OF WINNIPEG WATER AND WASTE DEPARTMENT

OUTFALL GATE CHAMBER UPGRADES **RUBY STREET** SRS OUTFALL GATE CHAMBER

CONSULTANT DRAWING NUMBER 5516047 - E01 CITY DRAWING NUMBER

LD-7934

CONTROL PANEL DETAIL GENERAL NOTES

REFER TO E02 DRAWING, DETAIL 5 FOR BARRIER INTERIOR VIEW.		FRONT PANEL DOORS		
CONFIRM FINAL CONTROL PANEL DIMENSION PRIOR TO POURING CONCRETE PAD. CONCRETE PAD AND	0		SOLID BARRIER NO BACKPLATE	0
PILE BY STRUCTURAL. 0.6M DIA × 3M DEEP REINFORCED CONCRETE FOUNDATION (TYPICAL OF 2)			1	TYI 16 TYP

These design documents are prepared solely for the use by the party with whom the design professional has entered into a contract and there

are no representations of any kind made by the design professional to any party with whom the design professional has not entered into a contract.