


**WATER SERVICE INFORMATION**

ADDRESS	SIZE (mm) MATERIAL (STREET)	SIZE (mm) MATERIAL (PROP.)	SHORT & LONG MEASUREMENT	CORP. LOCATION	REMARKS
285 GARRY ST	COMMERCIAL 12	COPPER LEAD	OPP SL OF DOOR 100.43>NNL GRAHAM	101.2>NNL GRAHAM	RENEW TO PL WITH 20 COPPER UNDERSIZED
287 GARRY ST	COMMERCIAL 100	CAST IRON	2.30 NSL BLDG 87.50 SSL PORTAGE	OPP S/C	-
287 GARRY ST	COMMERCIAL 25	LEAD	5.18 NSL FOUNDATION 104.85>NNL GRAHAM	OPP S/C	RENEW TO PL WITH 25 COPPER POSSIBLE LEAD SERVICE
289 GARRY ST	COMMERCIAL 38	COPPER	-	0.3 S S/C	-
290 GARRY ST	COMMERCIAL 150	CAST IRON	5.33 NSL BLDG 72.50 SSL PORTAGE	OPP S/C	-
291 GARRY ST	COMMERCIAL 25	CAST IRON	7.01 NSL BLDG 74.68 SSL PORTAGE	OPP S/C	-
295 GARRY ST	COMMERCIAL 100	LEAD	60.00 SSL PORTAGE 2.13 NSL OF N WINDOW	OPP S/C	RENEW TO PL WITH 20 COPPER POSSIBLE LEAD SERVICE
298 GARRY ST	COMMERCIAL 25	LEAD	56.85 SSL PORTAGE 14.63 NSL BLDG	0.4 N CS	-
250 PORTAGE AVE	COMMERCIAL 150	CAST IRON	27.90 SSL PORTAGE	-	-

\* SERVICES TO BE RENEWED TO PL. ALL OTHERS TO BE RECONNECTED


NOTE: CHAINAGES SHOWN ARE ALONG WEST R OF GARRY STREET

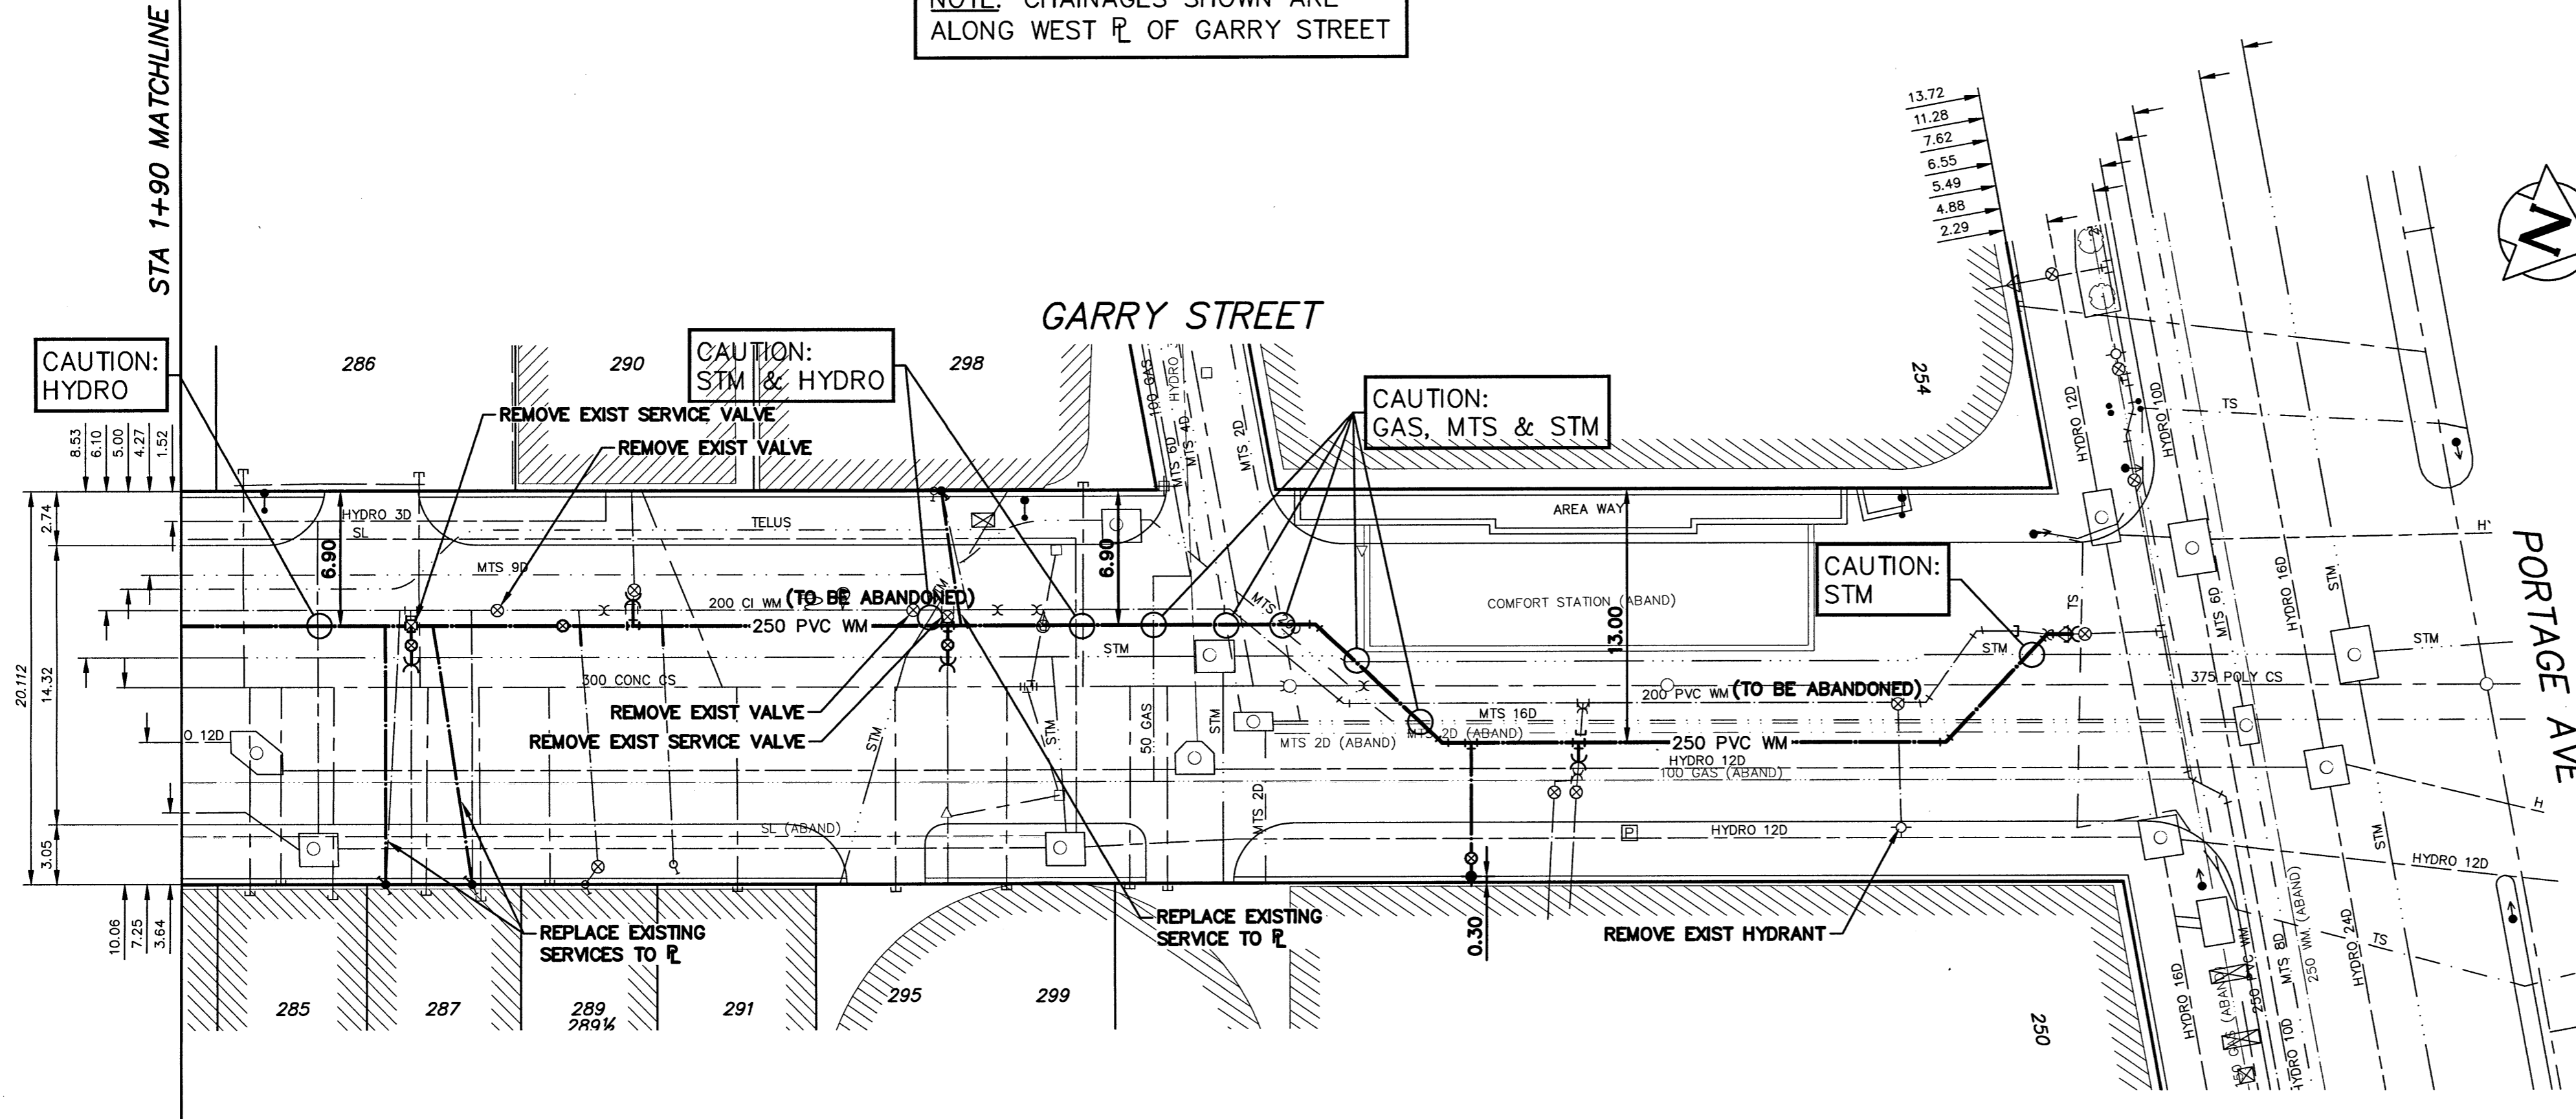

**PROPERTY LIMITS DELINEATION**  
 DELINEATION OF PROPERTY LIMITS AS SHOWN ON THIS DWG DOES NOT REPRESENT A "LEGAL SURVEY". KGS GROUP MAKES NO REPRESENTATION OR WARRANTY AS TO THE ACCURACY OF PROPERTY LIMITS DELINEATED ON THIS DWG, NOR ON THE DIMENSIONAL ACCURACY OF DWG FEATURES RELATIVE TO THOSE PROPERTY LIMITS.

NOTE: ALL VALVES TO BE INSTALLED COUNTERCLOCKWISE TO CLOSE

**APEGM**  
 Certificate of Authorization  
 KGS Group  
 No. 245

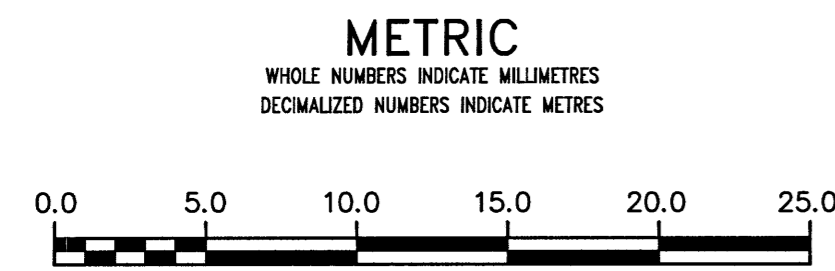

**WARNING**  
 IF POWER EQUIPMENT OR EXPLOSIVES ARE TO BE USED FOR EXCAVATION ON THIS PROJECT THE CONTRACTOR MUST:  
 1) NOTIFY THE GAS COMPANY OF THE PROPOSED LOCATION OF EXCAVATION.  
 2) TAKE PRECAUTION TO AVOID DAMAGE TO GAS COMPANY INSTALLATIONS.  
 SEE PROVINCIAL REGULATION 210/72 FOR DETAILS

**LOCATION APPROVED**  
 UNDERGROUND STRUCTURES  
 SUPV. U/G STRUCTURES COMMITTEE DATE  
 NOTE:  
 LOCATION OF UNDERGROUND STRUCTURES AS SHOWN ARE BASED ON THE BEST INFORMATION AVAILABLE BUT NO GUARANTEE IS GIVEN THAT ALL EXISTING UTILITIES ARE SHOWN OR THAT THE GIVEN LOCATIONS ARE EXACT. CONFIRMATION OF EXISTENCE AND EXACT LOCATION OF ALL SERVICES MUST BE OBTAINED FROM THE INDIVIDUAL UTILITIES BEFORE PROCEEDING WITH CONSTRUCTION.

NO.	ISSUED FOR CONSTRUCTION	DATE	BY
0	ISSUED FOR CONSTRUCTION	17/04/27	RBO

**KGS GROUP CONSULTING ENGINEERS**  
 DESIGNED BY TLE  
 CHECKED BY [Signature]  
 DRAWN BY GEL  
 APPROVED BY [Signature]  
 SCALE: HORIZONTAL 1:250, VERTICAL 1:50  
 RELEASED FOR CONSTRUCTION [Signature]  
 DATE 2017 04 26

ENGINEER'S SEAL  
  
 CONSULTANT DRAWING NUMBER  
 17-0107-002\_C13

**THE CITY OF WINNIPEG**  
 WATER AND WASTE DEPARTMENT  
 ENGINEERING DIVISION  
 2017 WATER MAIN RENEWALS  
 CONTRACT 8  
**GARRY STREET**  
 GRAHAM AVENUE TO PORTAGE AVENUE  
 STA 1+90 TO PORTAGE AVENUE

SHEET 14 OF 19  
 CITY DRAWING NUMBER  
**D-14688**