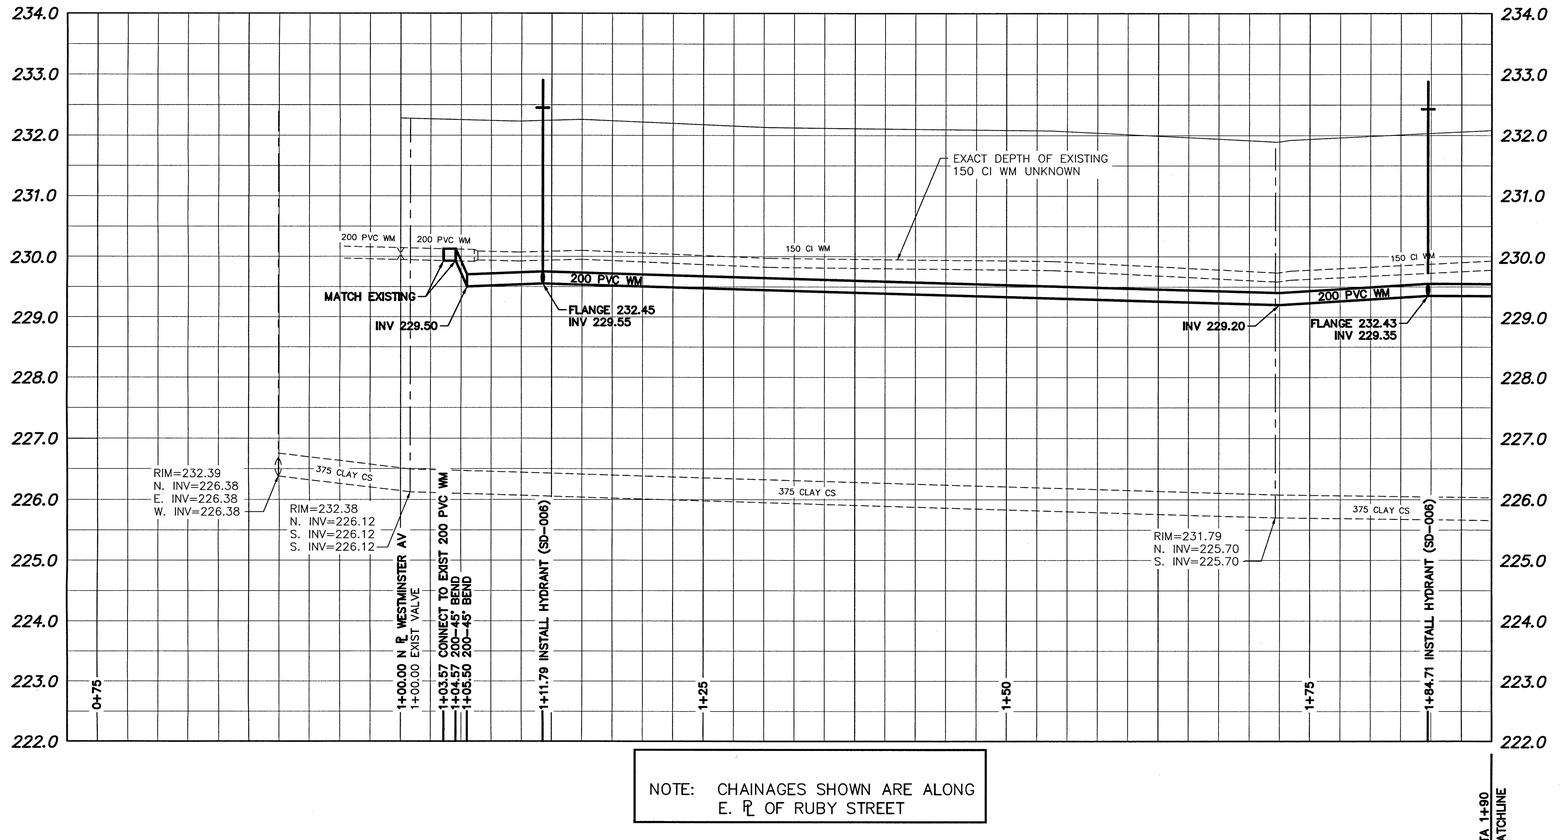

NOTE: CHAINAGES SHOWN ARE ALONG E. PL OF RUBY STREET

WATER SERVICE INFORMATION

ADDRESS	SIZE (mm) MATERIAL (STREET)	SIZE (mm) MATERIAL (PROP.)	SHORT & LONG MEASUREMENT	CORP. LOCATION	REMARKS
154 RUBY ST RESIDENTAL	20 COPPER	20 COPPER	1.1 SNL BLDG 12.9 NNL WESTMINISTER	0.3 SS CURB	– –
156 RUBY ST RESIDENTAL	20 COPPER	20 COPPER	2.6 SNHL 21.9 NNL WESTMINISTER	0.3 SS CURB	– –
158 RUBY ST RESIDENTAL	20 COPPER	20 COPPER	2.1 SNHL 32.3 NNL WESTMINISTER	0.6 SS CURB	– –
* 160 RUBY ST RESIDENTAL	12 LEAD	12 COPPER	2.4 SNHL 41.1 NNL WESTMINISTER	OPP S CURB	REPLACE TO PL WITH 20 COPPER POSSIBLE LEAD SERVICE
* 162 RUBY ST RESIDENTAL	16 LEAD	12 LEAD	0.3 NNHL #162 53.3 NNL WESTMINISTER	1.5 SS CURB	REPLACE TO PL WITH 20 COPPER POSSIBLE "Y" SERVICE
* 164 RUBY ST RESIDENTAL	16 LEAD	12 LEAD	0.3 NNHL #162 53.3 NNL WESTMINISTER	1.5 SS CURB	POSSIBLE "Y" SERVICE
166 RUBY ST RESIDENTAL	20 COPPER	12 LEAD	6.3 NSL BLDG 73.15 NNL WESTMINISTER	0.6 N OF CS	– –
168 RUBY ST RESIDENTAL	20 COPPER	20 COPPER	1.2 SNHL #168 82.3 NNL WESTMINISTER	OPP S/C	– –
177 RUBY ST RESIDENTAL	20 COPPER	12 LEAD	3.35 SNHL 4.0 NSHL	1.5 S S/C	– –
179 RUBY ST RESIDENTAL	20 COPPER	12 LEAD	4.9 NSHL 40.5 NNL WESTMINISTER	0.3 S S/C	– –
183 RUBY ST RESIDENTAL	20 COPPER	12 LEAD	0.15 NNHL 54.2 NNL WESTMINISTER	0.6 C S/C	– –
187 RUBY ST RESIDENTAL	20 COPPER	12 LEAD	1.5 SSHL 54.6 NNL WESTMINISTER	0.3 S S/C	– –
* 191 RUBY ST RESIDENTAL	16 LEAD	12 LEAD	OPP SNHL #193 76.5 NNL WESTMINISTER	1.8 S S/C	– –
* 193 RUBY ST RESIDENTAL	16 LEAD	12 LEAD	OPP SNHL #193 76.5 NNL WESTMINISTER	1.8 S S/C	– –
* 175 RUBY ST RESIDENTAL	25 LEAD	25 CU	3.9 NSL BLDG 18.9 NNL WESTMINISTER	0.6 S S/C	REPLACE TO PL WITH 20 COPPER POSSIBLE LEAD SERVICE
170 RUBY ST RESIDENTAL	– –	– –	– –	–	– –
911 WESTMINSTER RESIDENTAL	25 COPPER	25 LEAD	4.61 NSL APT BLDG 5.54 NNL WESTMINSTER	0.24 S S/C	– –

* SERVICES TO BE RENEWED TO PL. ALL OTHERS TO BE RECONNECTED

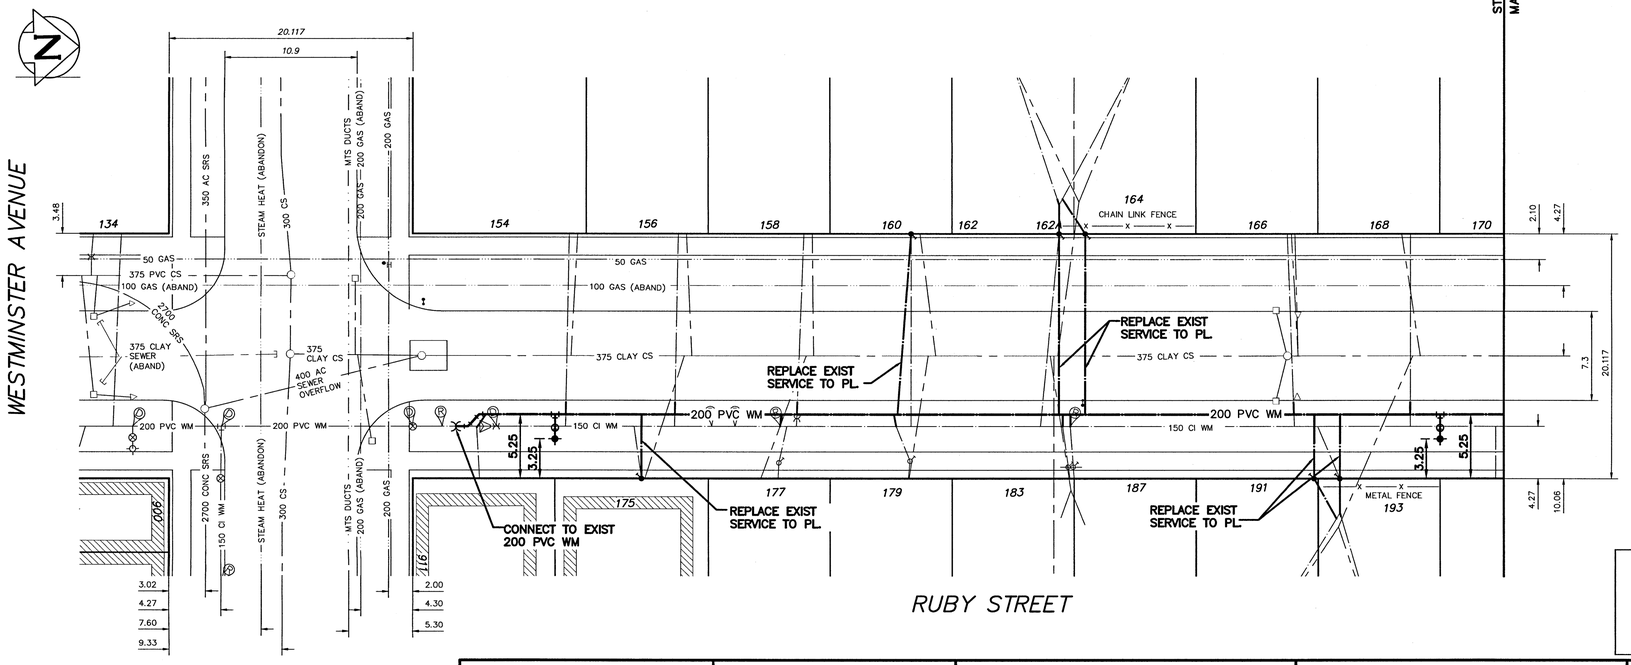

STA 1+90 MATCHLINE

NOTE: ALL VALVES TO BE INSTALLED COUNTERCLOCKWISE TO CLOSE

PROPERTY LIMITS DELINEATION

DELINEATION OF PROPERTY LIMITS AS SHOWN ON THIS DWG DOES NOT REPRESENT A "LEGAL SURVEY". KGS GROUP MAKES NO REPRESENTATION OR WARRANTY AS TO THE ACCURACY OF PROPERTY LIMITS DELINEATED ON THIS DWG, NOR ON THE DIMENSIONAL ACCURACY OF DWG FEATURES RELATIVE TO THOSE PROPERTY LIMITS.

APEGM
Certificate of Authorization
KGS Group
No. 245

METRIC

WHOLE NUMBERS INDICATE MILLIMETRES
DECIMALIZED NUMBERS INDICATE METRES

0.0 5.0 10.0 15.0 20.0 25.0

WARNING

IF POWER EQUIPMENT OR EXPLOSIVES ARE TO BE USED FOR EXCAVATION ON THIS PROJECT THE CONTRACTOR MUST:

1) NOTIFY THE GAS COMPANY OF THE PROPOSED LOCATION OF EXCAVATION.

2) TAKE PRECAUTION TO AVOID DAMAGE TO GAS COMPANY INSTALLATIONS.

SEE PROVINCIAL REGULATION 210/72 FOR DETAILS

LOCATION APPROVED
UNDERGROUND STRUCTURES

SUPV. U/G STRUCTURES COMMITTEE _____ DATE _____

NOTE:

LOCATION OF UNDERGROUND STRUCTURES AS SHOWN ARE BASED ON THE BEST INFORMATION AVAILABLE BUT NO GUARANTEE IS GIVEN THAT ALL EXISTING UTILITIES ARE SHOWN OR THAT THE GIVEN LOCATIONS ARE EXACT. CONFIRMATION OF EXISTENCE AND EXACT LOCATION OF ALL SERVICES MUST BE OBTAINED FROM THE INDIVIDUAL UTILITIES BEFORE PROCEEDING WITH CONSTRUCTION.

B.M. _____
ELEV. _____

NO.	REVISIONS	DATE	BY
0	ISSUED FOR CONSTRUCTION	17/05/17	T.L.E.

KGS GROUP CONSULTING ENGINEERS

DESIGNED BY	T.L.E.	CHECKED BY	
DRAWN BY	D.M.W.	APPROVED BY	RBO
SCALE: HORIZONTAL	1:250	RELEASED FOR CONSTRUCTION	
VERTICAL	1:50	DATE	5/19/17
DATE	2017 05 17		
PLOT DATE:	2017 05 17		

ENGINEER'S SEAL
PROVINCE OF MANITOBA
R.B. OFFMAN
Member 24791
REGISTERED PROFESSIONAL ENGINEER

CONSULTANT DRAWING NUMBER
17-0107-003_C07

BID OPPORTUNITY: 296-2017
CONTRACT NUMBER: 11

FILE PATH: U:\FMS\17-0107-003\
FILE NAME: 17-0107-003_CALL.dwg

Winnipeg

THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT
ENGINEERING DIVISION

2017 WATER MAIN RENEWALS
(CONTRACT 11)

RUBY STREET

WESTMINSTER AVENUE TO PORTAGE AVENUE
STA 0+75 TO STA 1+90

SHEET 8 OF 17

CITY DRAWING NUMBER
D-14765