

4" X 12" GLULAM PURLINS @
5'-0" ± O/C (TYP) TO REMAIN

LOWER ROOF AREA (N.I.C.)

LOWER ROOF AREA (N.I.C.)

RIDGE LINE


EXISTING SBS MODIFIED
BITUMEN ROOFING TO REMAIN

OVERHANG OF ROOF

11" X 45" ± TAPERED GLULAM BEAM
(TYP) COMPLETE LOCALIZED REPAIRS AT
LOCATIONS IDENTIFIED BY CONSULTANT

ROOF FRAMING PLAN
3/32 = 1'-0"

- DESIGN DEAD LOAD = 15 PSF
- LIVE LOAD = 36 PSF
- FIELD VERIFY ALL DIMENSIONS
- REPAIR AREAS AND QUANTITIES TO BE MEASURED BY CONTRACTOR AND VERIFIED BY CONTRACT ADMINISTRATOR

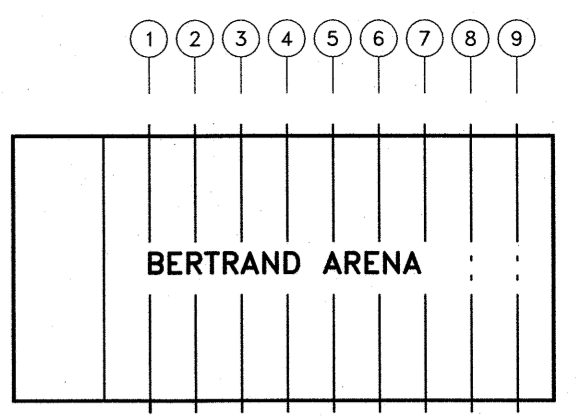

KEY PLAN
NTS

The General Contractor shall check & verify all dimensions and report any errors or omissions to the designers.

No.	Date	Issue/Revision	By
0	2017-04-19	ISSUED FOR CONSTRUCTION	SMC

APEGM
Certificate of Authorization
Crosier Kilgour & Partners Ltd.
No. 235 Date: 2017-04-19



Consultant

300-275 Carlton Street
Winnipeg, Manitoba R3C 5R6
T 204. 943. 7501
F 204. 943. 7507

Crosier Kilgour & Partners Ltd.
CONSULTING STRUCTURAL ENGINEERS

Project
BERTRAND ARENA
GLULAM REPAIRS

294 BERTRAND STREET
WINNIPEG, MANITOBA

Sheet Title
ROOF FRAMING PLAN

File	2017-0006	Date	2017-04-19
Design	SMC	Drawn	RJM

Revision	Sheet No.
A	S2.1