


NOTES:

- CONTRACTOR SHALL COORDINATE WITH SUPPLIER OF ACTUATOR AND MOTORIZED VALVES TO ENSURE SUFFICIENT POWER AND SIGNAL CABLE LENGTHS ARE PROVIDED.



1
TRUCK FILL CONTROL PANEL
BLOCK DIAGRAM
 SCALE: N.T.S.

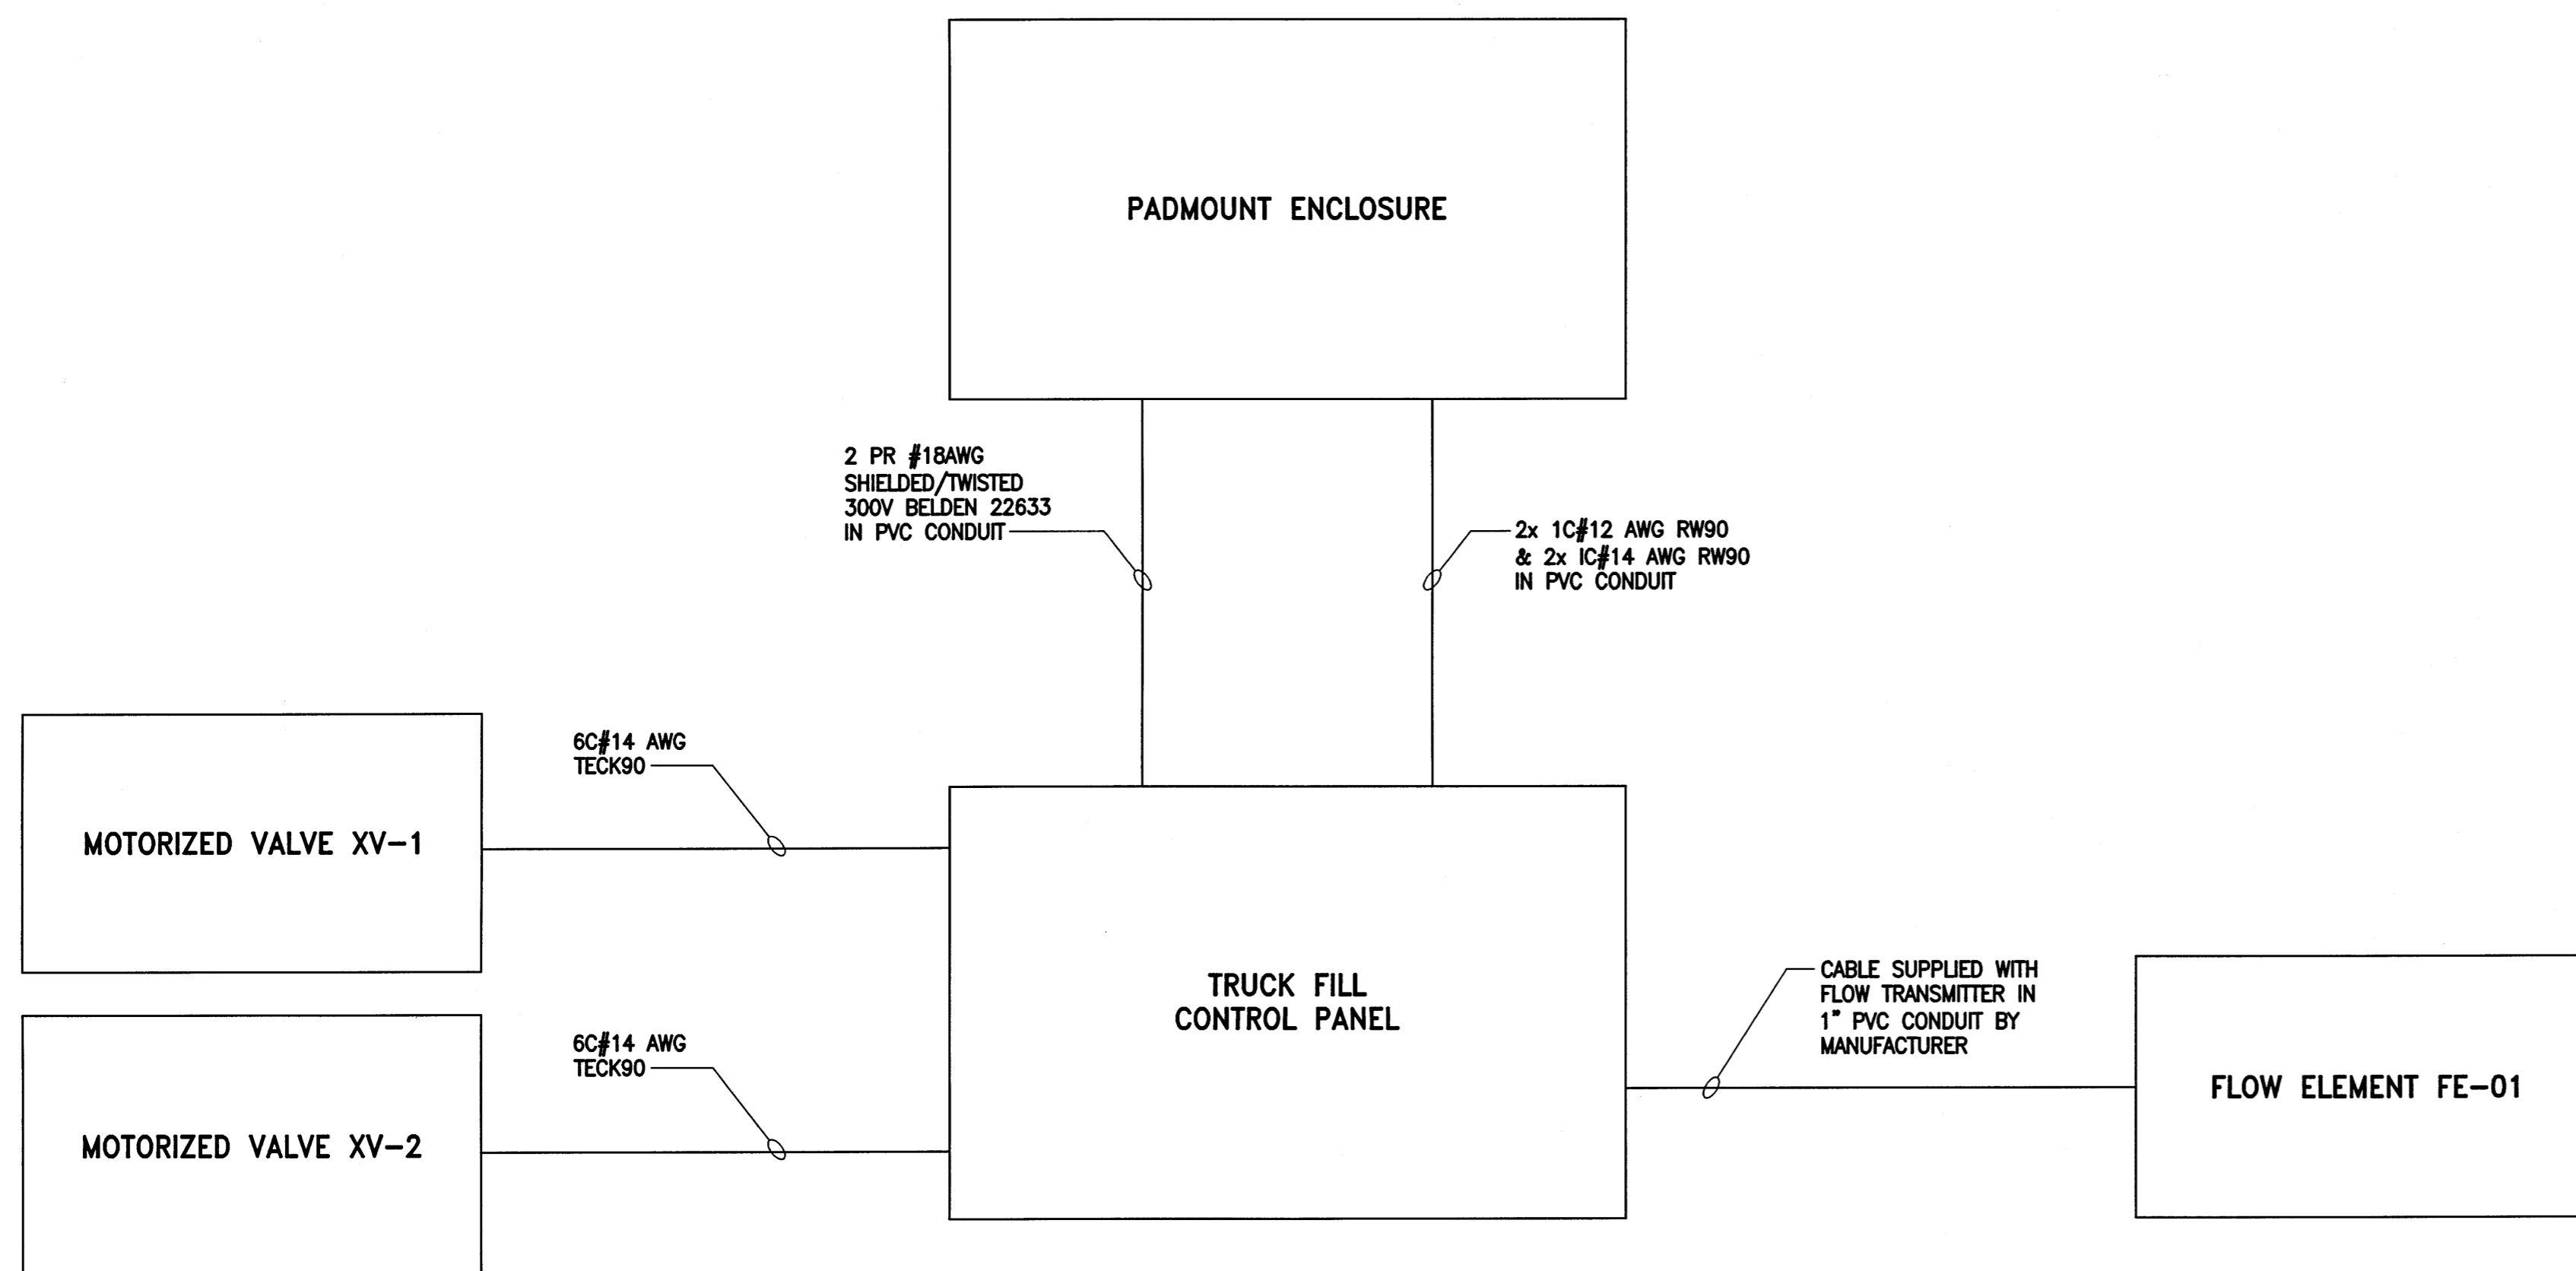

Certificate of Authorization
 KGS Group
 No. 245

FOR TENDER ONLY
 NOT TO BE USED FOR CONSTRUCTION

LOCATION APPROVED UNDERGROUND STRUCTURES SUPV. U/G STRUCTURES COMMITTEE DATE NOTE: LOCATION OF UNDERGROUND STRUCTURES AS SHOWN ARE BASED ON THE BEST INFORMATION AVAILABLE. BUT NO GUARANTEE IS GIVEN THAT ALL EXISTING UTILITIES ARE SHOWN OR THAT THE GIVEN LOCATIONS ARE EXACT. CONFIRMATION OF EXISTENCE AND EXACT LOCATION OF ALL SERVICES MUST BE OBTAINED FROM THE INDIVIDUAL UTILITIES BEFORE PROCEEDING WITH CONSTRUCTION.	B.M. ELEV. CONSTRUCTION COMPLETION DATE: YYYY MM DD	KGS GROUP CONSULTING ENGINEERS & PROJECT MANAGERS WINNIPEG (204) 896-1209 THUNDER BAY (807) 345-2233	ENGINEER'S SEAL 	THE CITY OF WINNIPEG WATER AND WASTE DEPARTMENT ENGINEERING DIVISION BRADY ROAD RESOURCE MANAGEMENT FACILITY (BRRMF) DISPOSAL CELL CONSTRUCTION AND LEACHATE COLLECTION STORAGE (300,000 LITRE) TANK SHEET 44 OF 44 CITY DRAWING NUMBER 1-0400A-E0025-001
	DESIGNED BY LU DRAWN BY JPL SCALE: HORIZONTAL - VERTICAL - 0 ISSUED FOR TENDER 06/15/17 NO. REVISIONS DATE BY		CHECKED BY JMS APPROVED BY MAP RELEASED FOR CONSTRUCTION CONSULTANT DRAWING NUMBER 15-0107-014_E10	