


BASEMENT REFLECTED CEILING PLAN
INTRUSION ALARM AND MONITORING SYSTEMS
 SCALE 1:100

INTRUSION ALARM AND MONITORING SYSTEMS NOTES: "X"

SUPPLIED & INSTALLED BY OTHERS.
 ALSO SEE NOTES & SPECIFICATIONS (FOR REFERENCE USE ONLY).
 ALL WIRING & CABLING SHALL BE CONCEALED IN DOOR JAMB &/OR IN WALL CAVITY FOR FINISH SPACES. ALL WIRING & CABLING IN CEILING SPACE SHALL BE PLENUM RATED AS PER LATEST CEC.

- MOTION DETECTORS MOUNTED 2400mm AFF.
- HIGH LEVEL ALARM CONNECT TO DRY CONTACTS OF SUMP PUMP CONTROL TO MONITORING PANEL.
- HEAT OR SMOKE DETECTORS CONNECT TO MONITORING PANEL.
- CABLE TRAY FOR ROUTING WIRING/CABLING OF INTRUSION ALARM & MONITORING SYSTEM COMPONENTS.
- GLASS BREAKER DETECTOR CONNECT TO MONITORING PANEL.
- KEY PAD/STATUS DISPLAY CONNECT TO BUILDING ALARM CONTROL PANEL (BACP) IN BASEMENT NETWORK ROOM.
- SECURITY ALARM IN CEILING SPACE CONNECT TO BACP.
- PROVIDE IN-DUCT SMOKE DETECTOR & ALL NECESSARY COMPONENTS TO BE MOUNTED ON AHU-1 RETURN DUCT. WIRE WITH RELAY & ALL NECESSARY COMPONENTS TO BUILDING ALARM CONTROL PANEL, HEAT & SMOKE DETECTOR CONTACTS. CONFIGURE TO SHUT-DOWN AHU-1 WHEN HEAT &/OR SMOKE DETECTOR IS ACTIVATED.

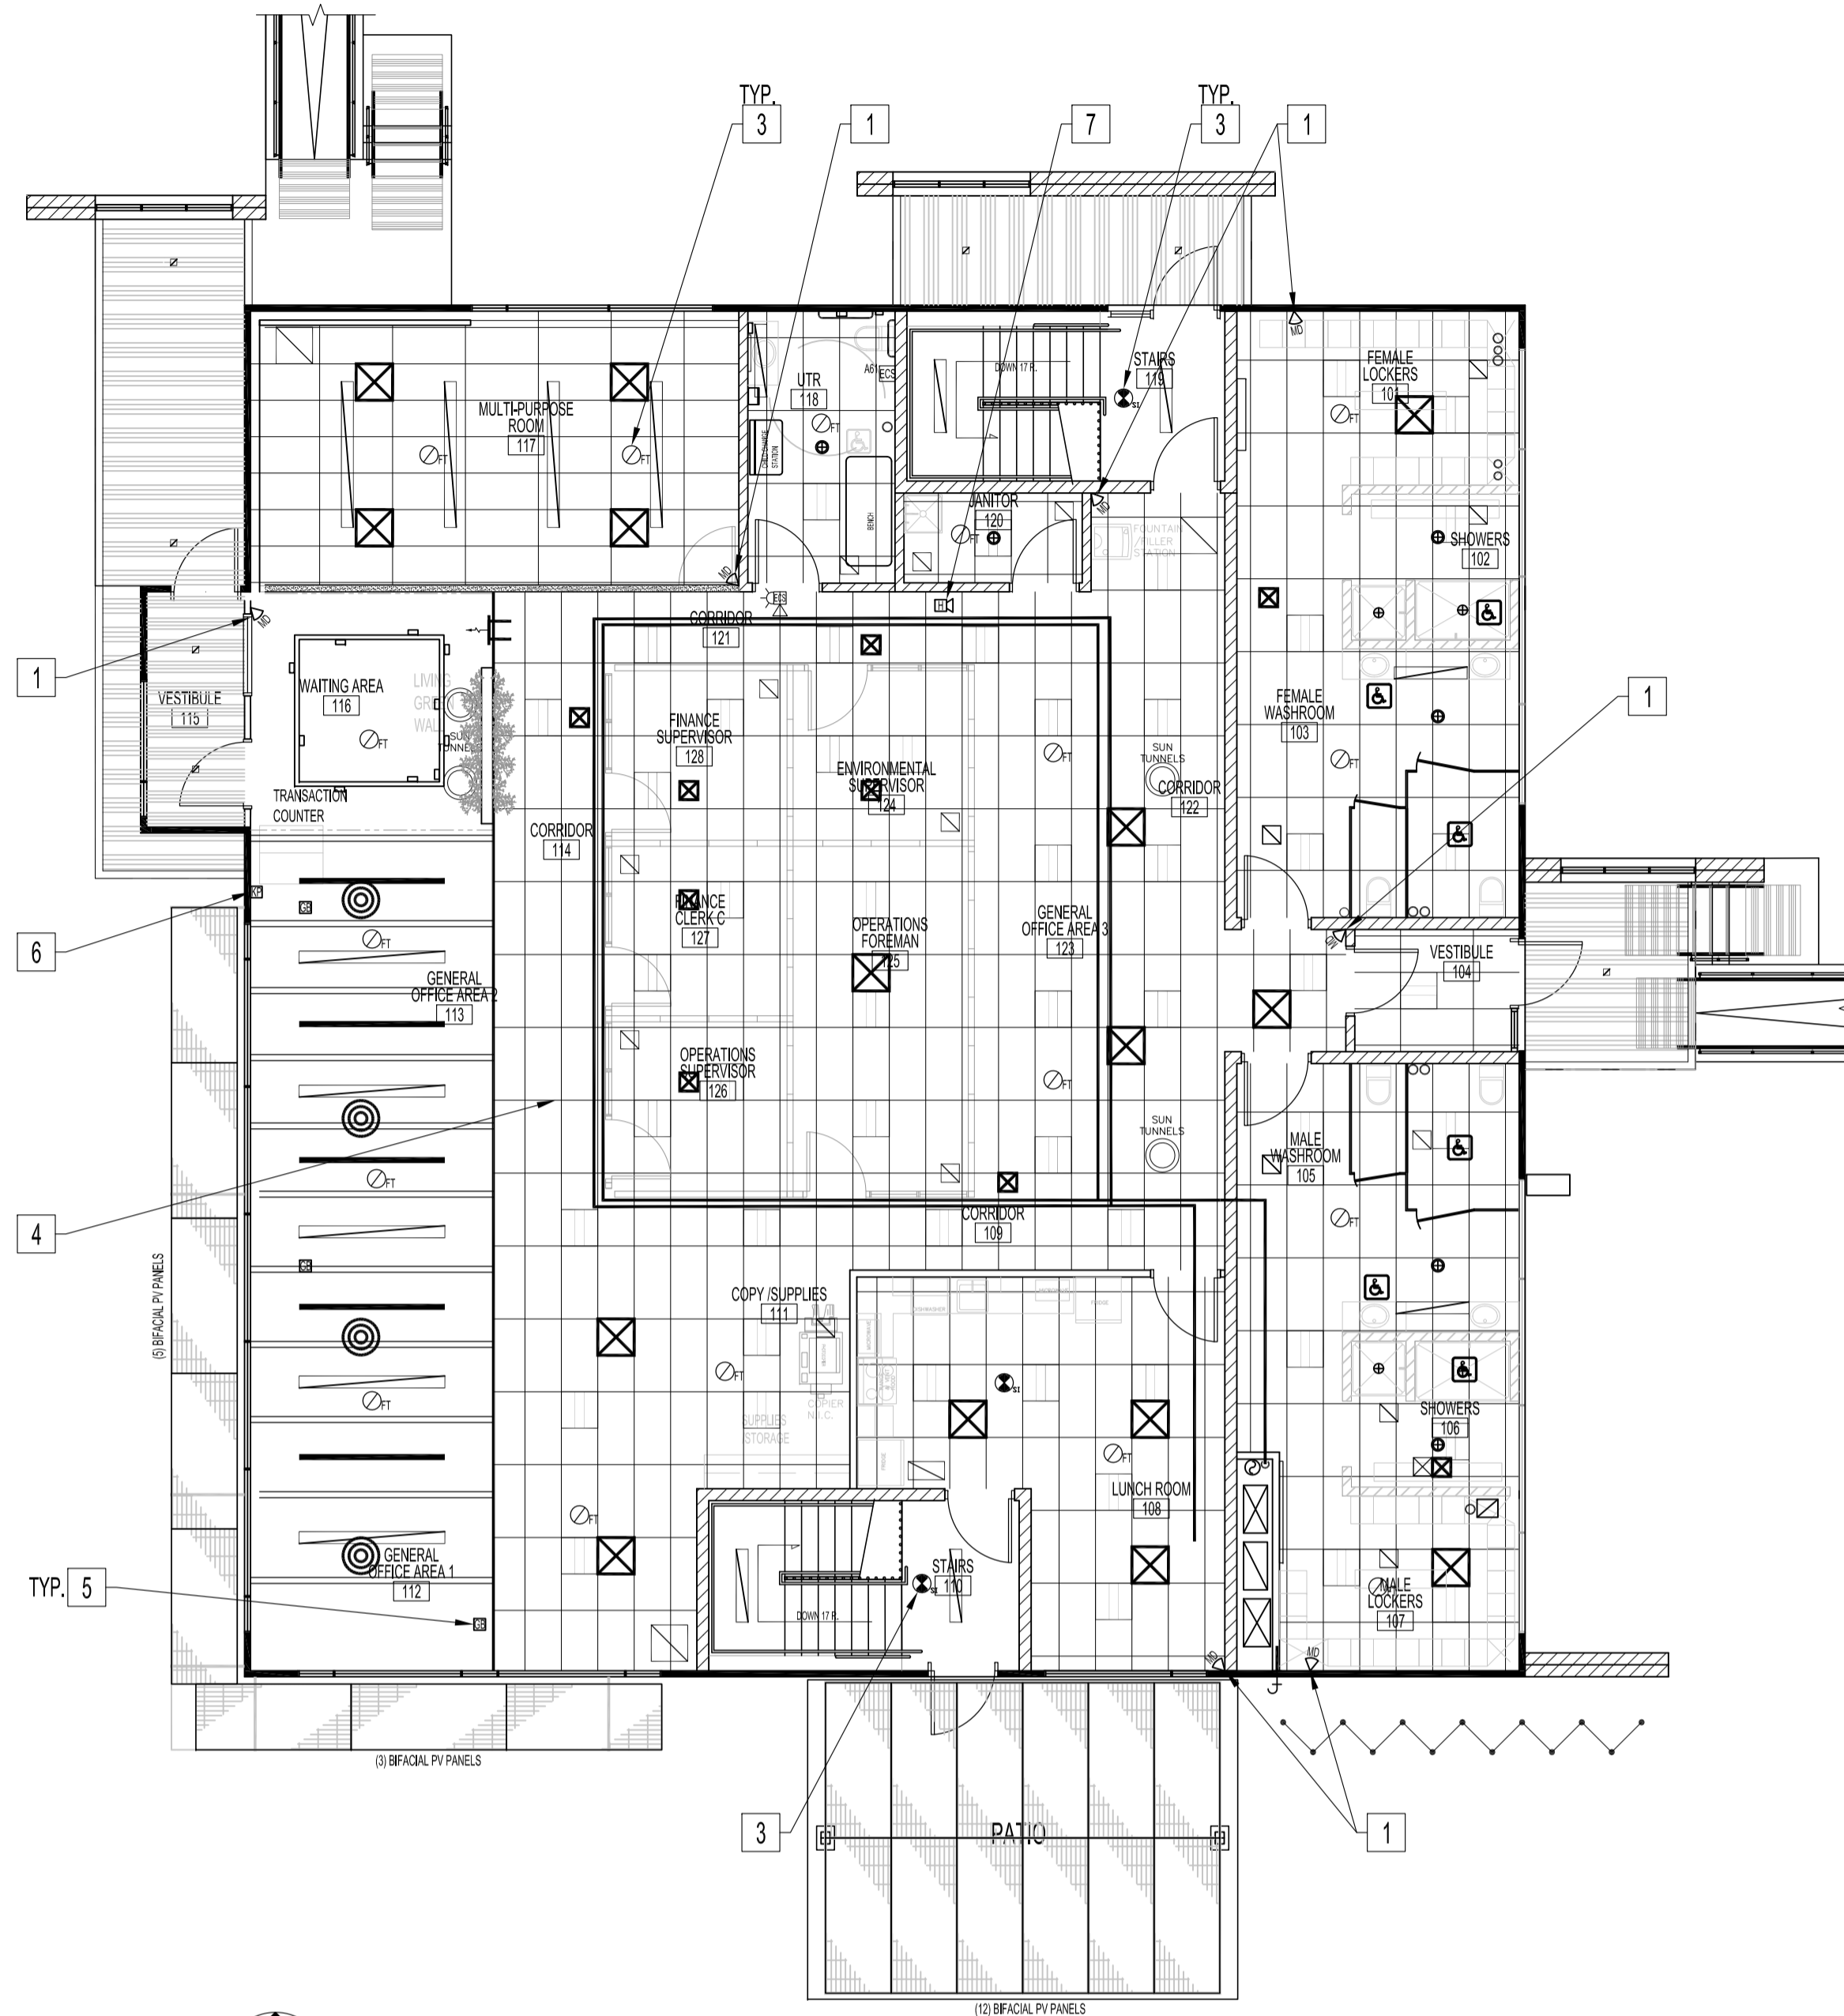

MAIN FLOOR REFLECTED CEILING PLAN
INTRUSION ALARM AND MONITORING SYSTEMS
 SCALE 1:100

NOTES:

- THESE DRAWINGS SHALL NOT BE SCALED. CONSULT WITH CONTRACT ADMINISTRATOR ON ANY CONCERNS.
- THIS DRAWING IS FOR REFERENCE USE ONLY BY THIRD PARTY INTRUSION MONITORING ALARM COMPANY TO COORDINATE THEIR SUPPLY AND INSTALLATION OF INTRUSION DEVICES, MONITORING DEVICES & ROUTING OF CABLING DURING THIS PROJECT CONSTRUCTION STAGE. THE COORDINATION BETWEEN THIS PROJECT SCOPE & THE THIRD PARTY MONITORING ALARM COMPANY IS TO ELIMINATE THE RISKS OF SURFACE MOUNTED CONDUITS IN FINISH SPACES & THE PROTECTION OF THE FACILITY THROUGH MONITORING OF OPTIONS SUCH AS: HEAT DETECTORS, SMOKE DETECTORS, HIGH WATER SUMP PUMP LEVEL & SPACE LOW TEMPERATURE.
- DIMENSIONS & UNITS SHOWN IN WHOLE NUMBERS ARE IN MILLIMETRES (MM).
- DIMENSIONS & UNITS SHOWN TO DECIMAL PLACES ARE IN METRES (M).
- ALSO REFER TO SHEET E1 & ELECTRICAL SPECIFICATIONS.

0	ISSUED FOR REFERENCE USE ONLY	DTA	2017.03.20
No.	REVISION/DESCRIPTION	BY	DATE

SEAL



DRAWN	DTA	CHECKED	DESIGNED	DTA	APPROVED
DATE	2017.03.20	USER	APPROVAL		

THE CITY OF WINNIPEG
 PLANNING, PROPERTY AND
 DEVELOPMENT DEPARTMENT
 MUNICIPAL ACCOMMODATIONS DIVISION
 3-65 GARRY STREET, R3C 4K4

PROJECT
 BRADY ROAD LANDFILL
 ADMINISTRATION BUILDING
 DEVELOPMENT FOR BRADY LANDFILL
 1777 BRADY ROAD

SHEET TITLE
 REFLECTED CEILING PLANS
 ELECTRICAL (REFERENCE USE ONLY)
 INTRUSION ALARM AND MONITORING SYSTEMS

SCALE	PROJECT No:	SHEET No:
AS SHOWN	2015-037-02	E8