


CONTRACTOR TO CONFIRM ALL DIMENSIONS AND REPORT ANY DISCREPANCIES TO CONTRACT ADMINISTRATOR PRIOR TO CONSTRUCTION. LOCATION OF UNDERGROUND STRUCTURES AS SHOWN ARE BASED ON THE BEST INFORMATION AVAILABLE BUT NO GUARANTEE IS GIVEN THAT ALL EXISTING UTILITIES ARE SHOWN OR THAT THE GIVEN LOCATIONS ARE EXACT. CONFIRMATION OF EXISTENCE AND EXACT LOCATION OF ALL SERVICES MUST BE OBTAINED FROM THE INDIVIDUAL UTILITIES BEFORE PROCEEDING WITH CONSTRUCTION.

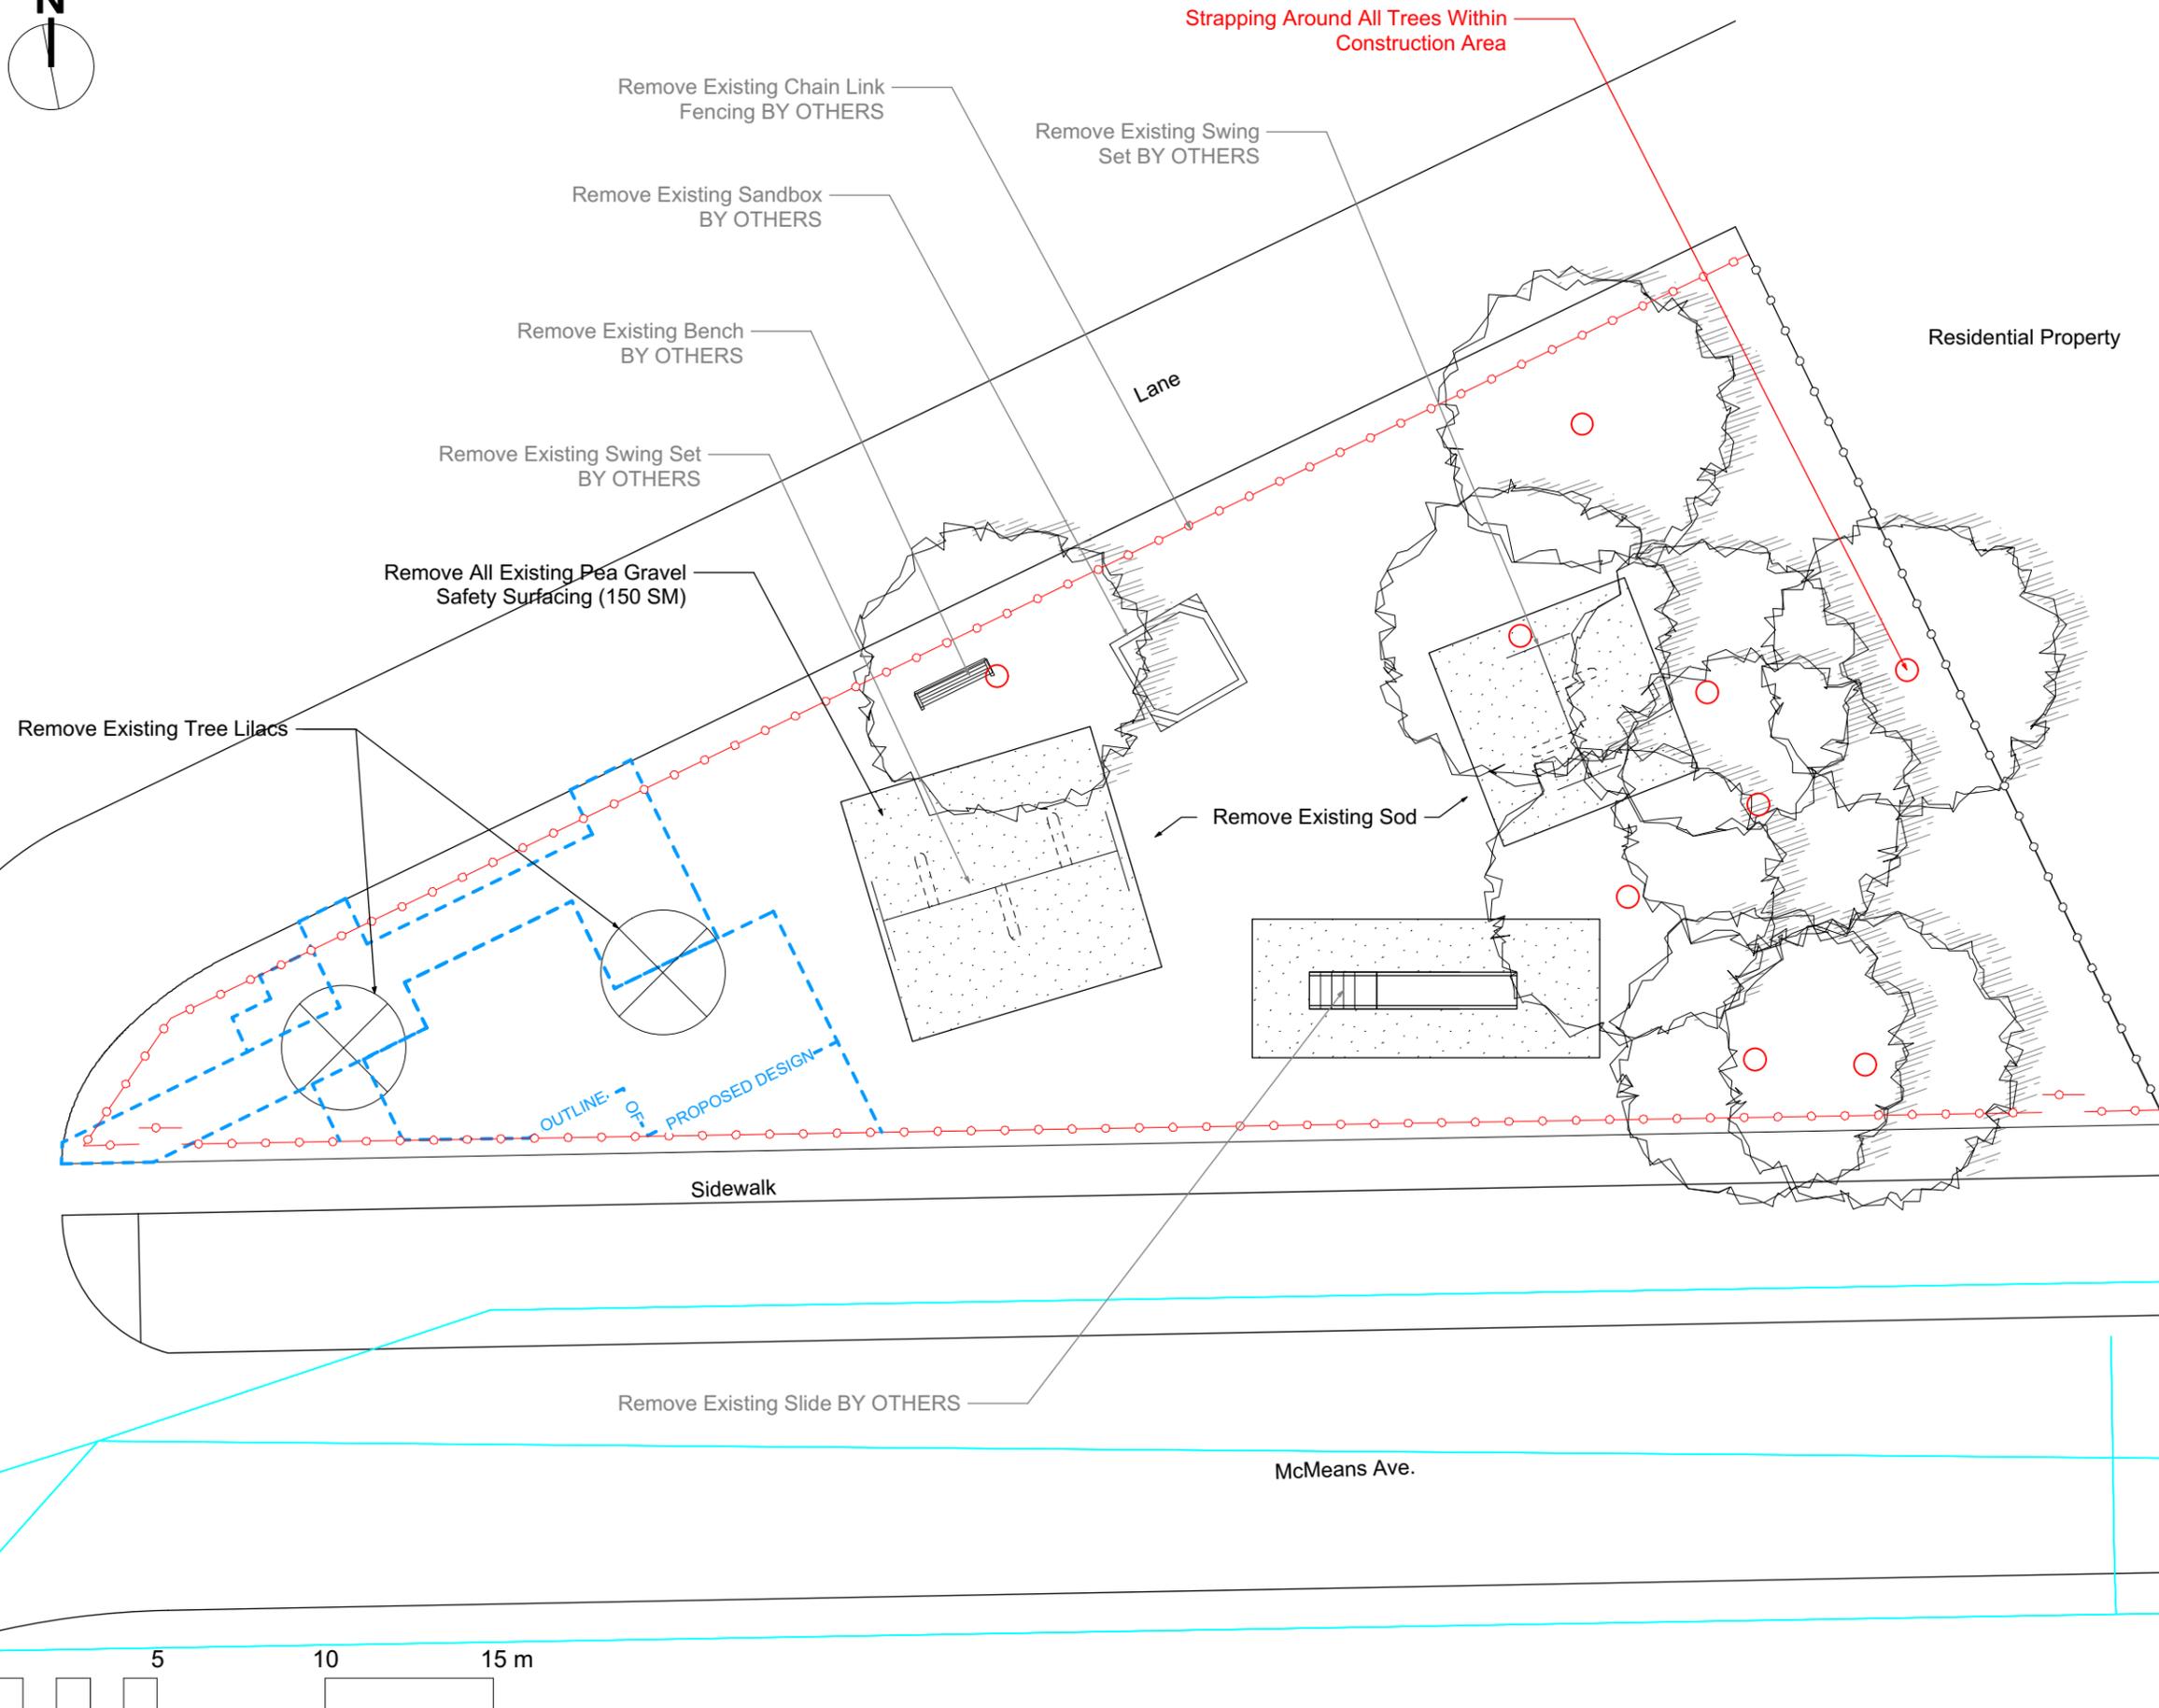

NOTES:

- CHAIN LINK FENCE TO REMOVE (118 LM)
- CHAIN LINK FENCE TO REMAIN
- EXISTING PEA GRAVEL SAFETY SURFACING
- TREE TO BE PROTECTED
- WATER MAIN
- SEWER / CB LEAD

DESIGNED BY	IM	CHECKED BY	
-------------	----	------------	--

DRAWN BY	IM	APPROVED BY	
----------	----	-------------	--

HORIZ. SCALE	1:200
VERT. SCALE	

DATE	July 2017
------	-----------

MANAGER, PARK AND OPEN SPACES	DATE
----------------------------------	------

MANAGER, URBAN DESIGN DIVISION	DATE
-----------------------------------	------

DRAWING TITLE
Bidhu Jha Park
Existing Conditions and Removals

SITE ADDRESS 455 McMeans Ave W	DRAWING NO. M.060-A1 BID OPPORTUNITY NO. 612-2017
-----------------------------------	--