


FIELD

CONTROL PANEL

SCADAPACK 357E 5606
I/O BOARD 350 CPU

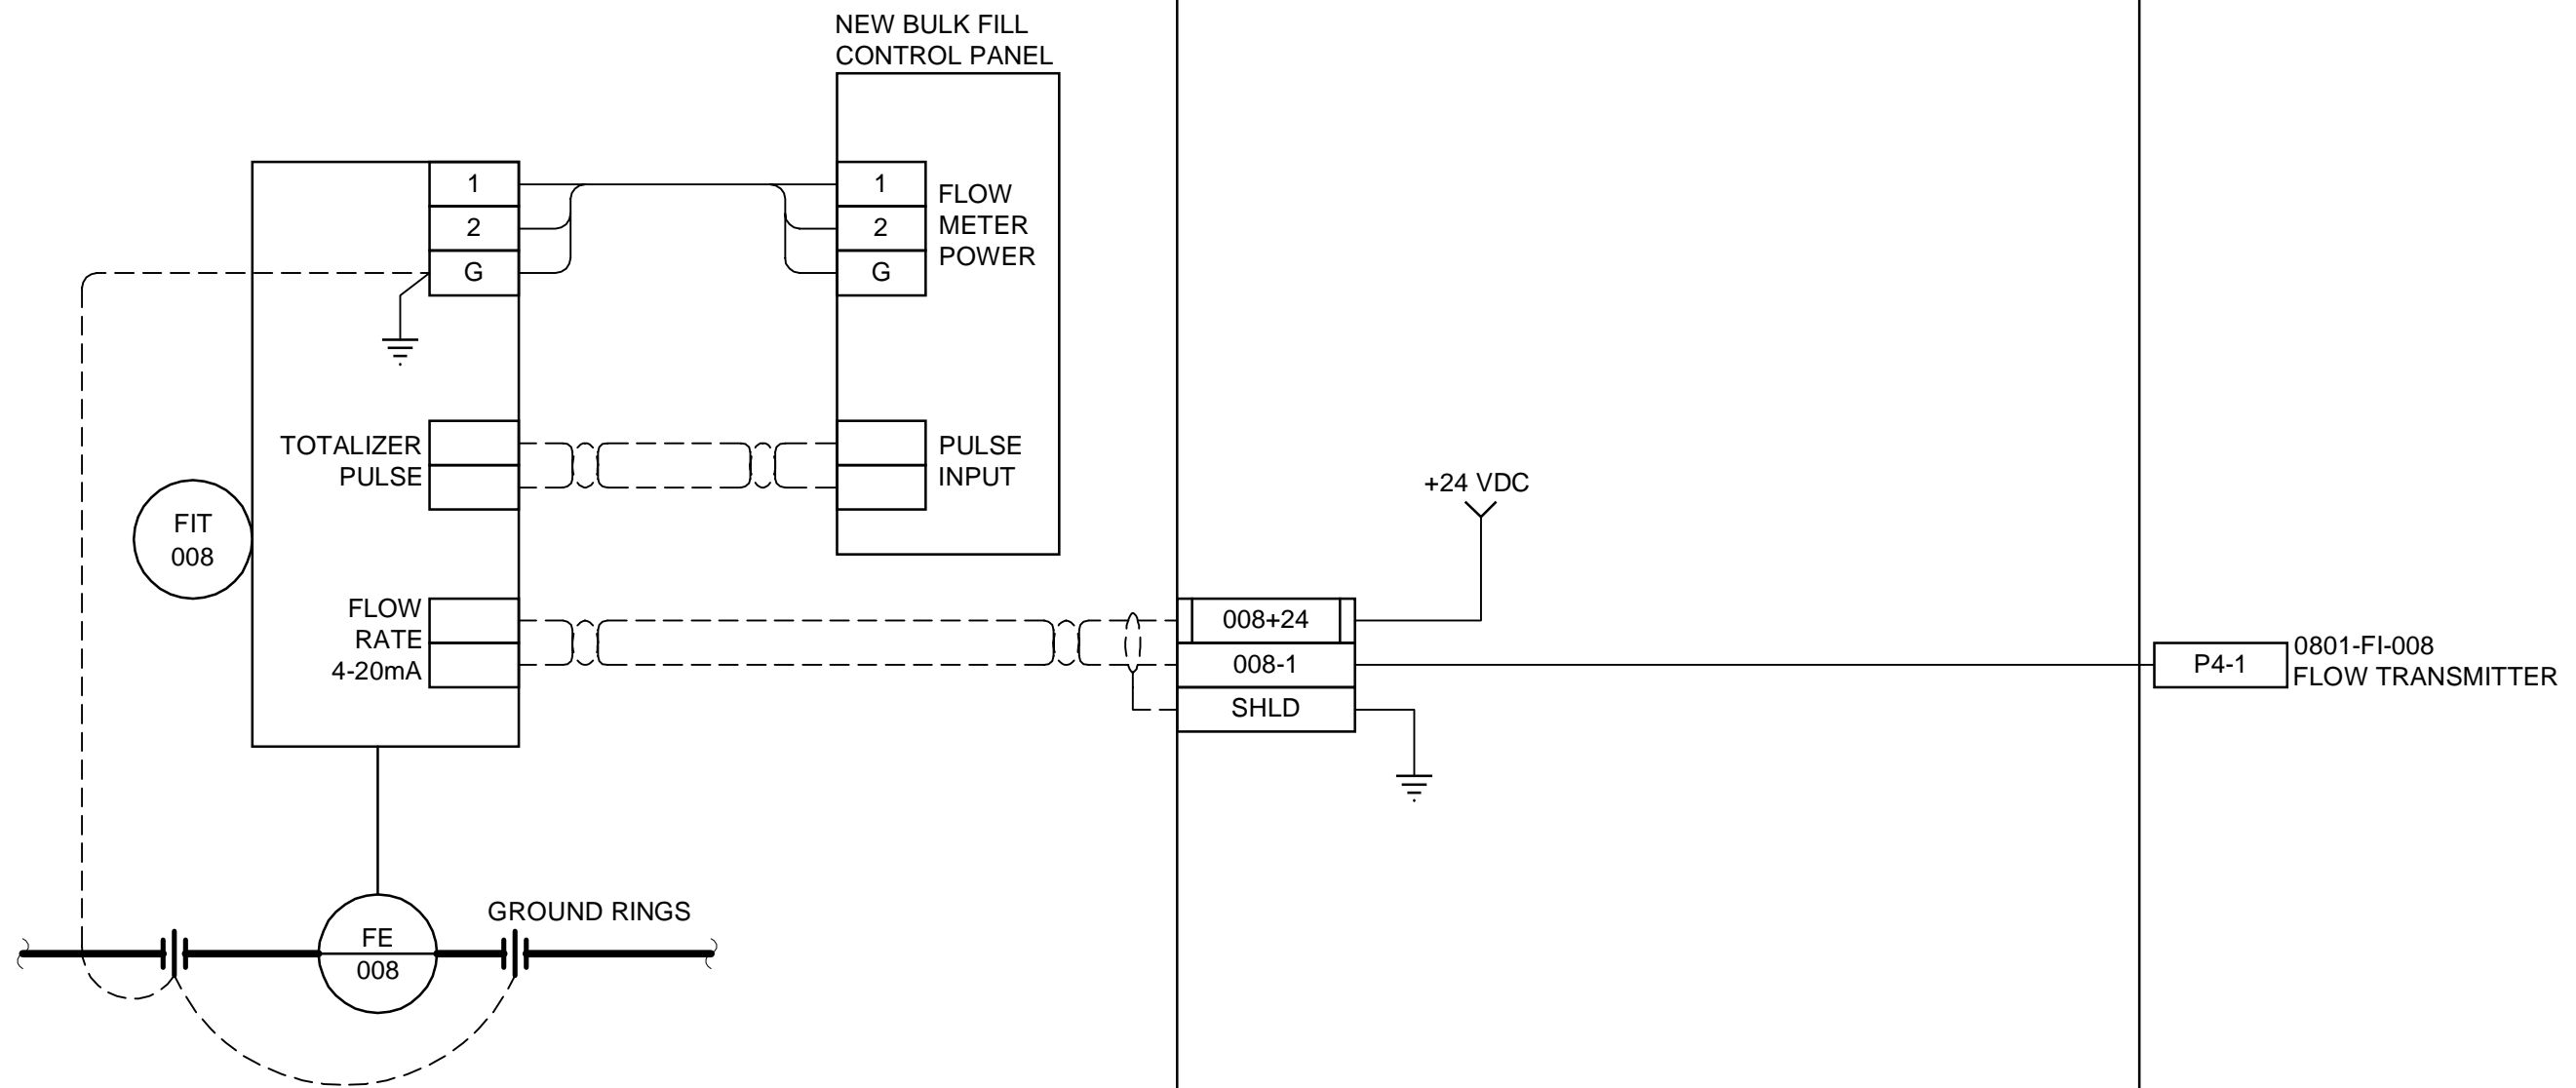

NOTES:

1. CONFIGURE FLOW METER, FIT-008 FOR 4-20mA PASSIVE OUTPUT.

File Name: c:\project\wise\working directory\active\408\k0462543175009-21-mccarthy-loops.dwg

0	ISSUED FOR BID OP 634-2017	17/11/23	B.L.M.
NO.	REVISION	DATE	BY

DATE: 17/07/06 PROJECT No. 175009

THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT
ENGINEERING DIVISION

DESIGNED BY	B.L.M.	CHECKED BY	B.L.M.
DRAWN BY	S.C.K.	APPROVED BY	

2017 REHABILITATION OF PUBLIC WATER SERVICE
OUTLETS: PAVEMENT WORKS, BUILDING SUPPLY
AND REPAIRS, DEMOLITION AND ELECTRICAL
McCARTHY STREET
0802-FIT-008 LOOP DIAGRAM

SHEET 32 OF 33
CITY DRAWING NUMBER
D-14938