
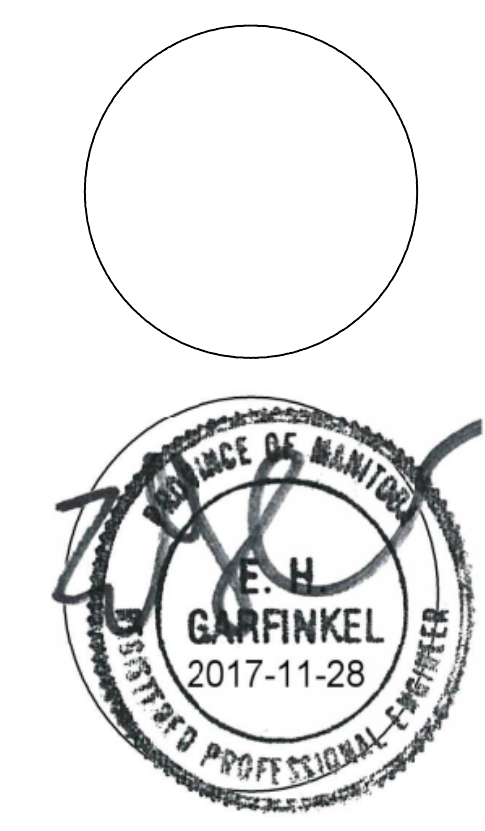


**NOTES:**

1. PROVIDE SELF CONTAINED EMERGENCY LIGHTING HEAD, WIRE AND CONNECT TO LIGHTING CIRCUIT IN THE AREA.
2. PROVIDE LUMINAIRE IN ELEVATOR PIT.
3. PROVIDE COMBINATION SELF-CONTAINED EXIT SIGN AND EMERGENCY LIGHTING HEAD, WIRE AND CONNECT TO EXISTING LIGHTING CIRCUIT IN THE AREA.
4. REFER TO ARCHITECTURAL REFLECTED CEILING FOR DEVICE LOCATIONS.
5. COORDINATE LOCATION OF LIGHTING IN ELEVATOR PIT ON SITE WITH EQUIPMENT.

Rev. No.	Date	Revision Notes
1.	2017.11.28	Issued for Construction

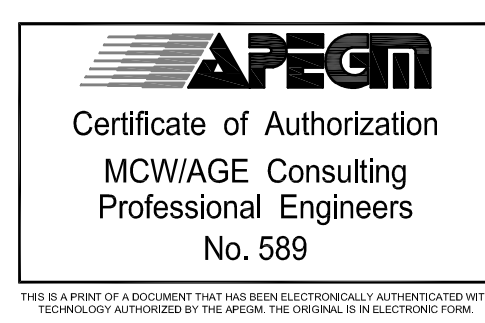

This drawing must not be scaled. The contractor shall verify all dimensions and other data on site prior to commencement of work. Discrepancies, errors, and omissions are to be reported to Public City Architecture Inc. prior to proceeding with the Work.

Drawings and specifications as instruments of service are the property of Public City Architecture Inc.; the copyright in the same being reserved.

No reproduction or revision to these drawings may be made without the permission of Public City Architecture Inc., and when made, must bear their name. All prints to be returned to Public City Architecture Inc. upon request.

Project  
**Cornish Library Renovation**

Drawing  
**BASEMENT - LIGHTING RENOVATION LAYOUT**

Drawn By: TL  
 Scale: As noted  
 Reviewed By: ATS  
 Drawing No.: **EL2.0**

Date: 2017.11.28  
 Project No.: 1503a

**1 BASEMENT - LIGHTING RENOVATION LAYOUT**  
 EL2.0 SCALE: 1:50