



1 AIR HANDLING UNIT (AHU-1 & AHU-2) CONTROLS SCHEMATIC (TYP.)  
SCALE: N.T.S.

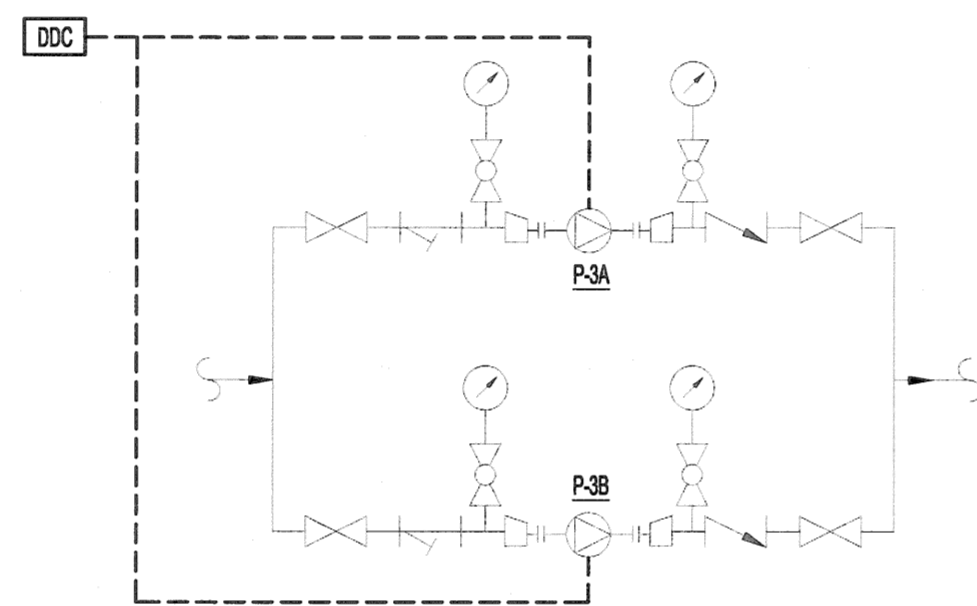

2 HYDRONIC CIRCULATION PUMP (PU-3A & PU-3B) CONTROL SCHEMATIC  
SCALE: N.T.S.

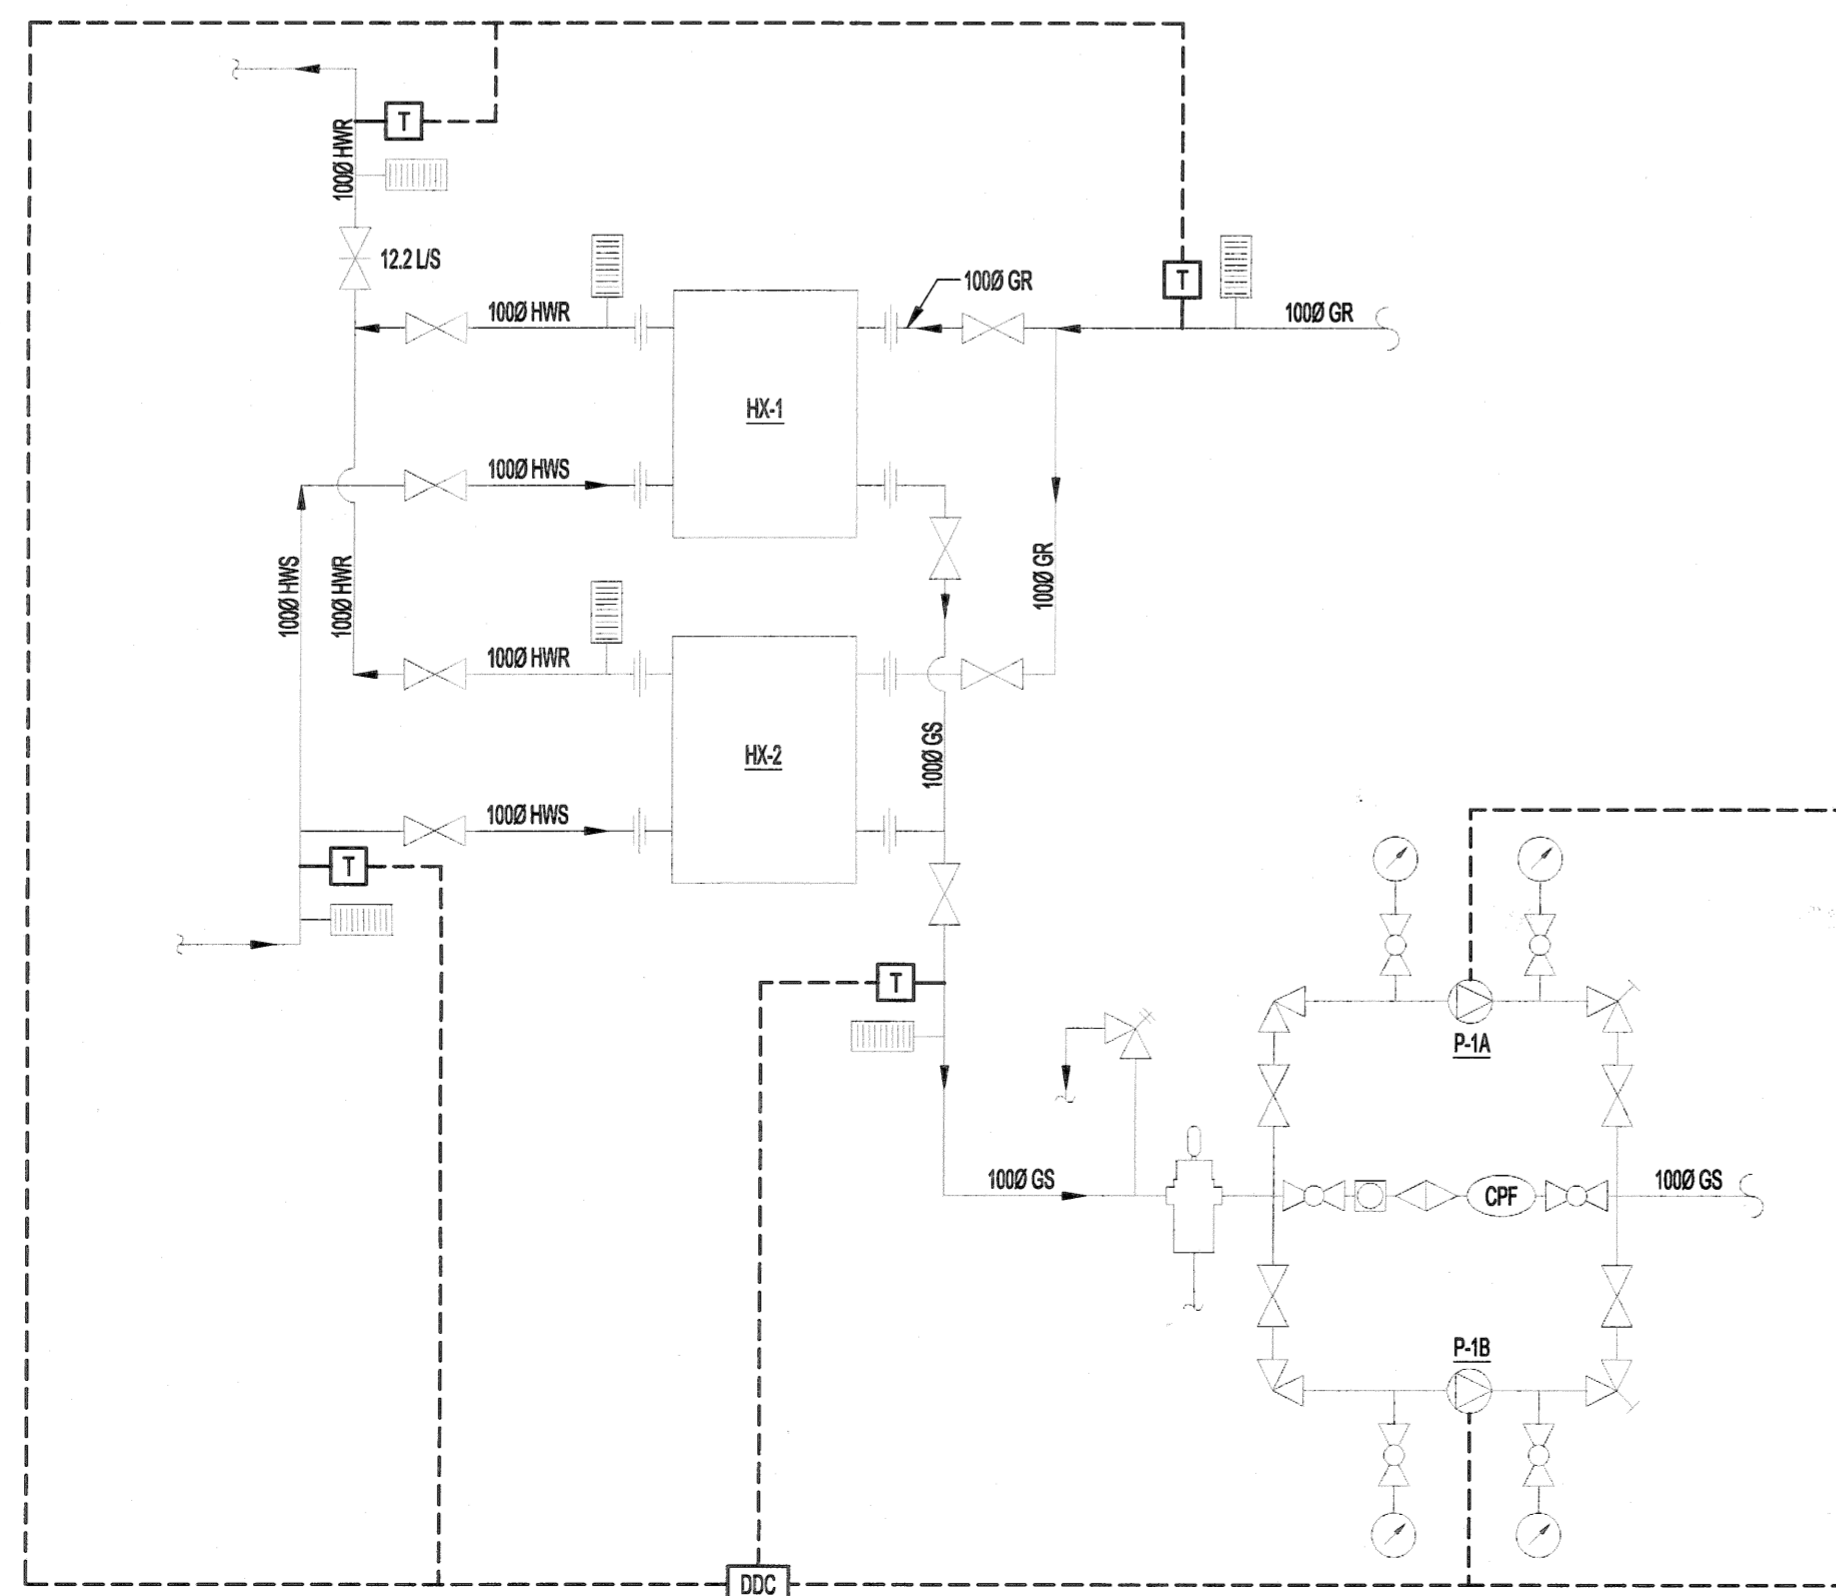

3 GLYCOL CIRCULATION PUMP (P-1A & P-1B) CONTROL SCHEMATIC  
SCALE: N.T.S.

SCALE VERIFIED BY: *[Signature]*



**NOTES:**

THESE DRAWINGS SHALL NOT BE SCALED.

THE CONTRACTOR SHALL VISIT THE SITE AND SATISFY ONESELF ALL DIMENSIONS, DATUM, AND DETAILED INFORMATION SHOWN ARE CORRECT.

THE CONTRACTOR IS TO REVIEW AND COORDINATE ALL ARCHITECTURAL, MECHANICAL, ELECTRICAL AND STRUCTURAL DRAWINGS FOR ADDITIONAL OPENINGS THROUGH FLOORS, WALLS, AND CEILINGS FOR DUCT, PIPE & ELECTRICAL RISERS AND ALL OPENINGS NOT SHOWN ON DRAWINGS.

ALL OPENINGS THROUGH THE FIRE SEPARATIONS AS A RESULT OF THE WORK OF THIS CONTRACT ARE TO BE FIRE STOPPED AND SEALED WITH ULC APPROVED FIRE STOPPING TO MAINTAIN THE INTEGRITY OF THE FIRE SEPARATION, AND PROVIDE AND SMOKE-TIGHT BARRIER.

ALL PRODUCTS AND MATERIALS TO BE USED AND INSTALLED SHALL CONFORM WITH MANUFACTURER'S SPECIFICATIONS & APPLICABLE CODES.

THE CONTRACTOR SHALL BE RESPONSIBLE TO PATCH AND MAKE GOOD ALL EXISTING CONSTRUCTION AFFECTED BY THE REMOVAL OF ALL ITEMS FORMING THE PART OF THE RENOVATION WORK.

WHERE NEW FLOORING AND BASE IS TO BE INSTALLED IN EXISTING AREAS (REFER TO FLOOR PLAN AND ROOM SCHEDULE) THE EXISTING FLOORING SURFACE AND BASE MUST BE REMOVED, UNLESS OTHERWISE NOTED. ALL FLOOR SURFACES SHALL BE PREPARED IN ACCORDANCE TO MANUFACTURER'S RECOMMENDATIONS FOR INSTALLATION OF NEW FLOOR.

WHERE PAINTING OF EXISTING WALLS IS INDICATED ON THE ROOM SCHEDULE, THESE WALLS MUST BE CLEANED OF ANY EXISTING WALL COVERING, PATCHED & PREPARED TO ACCEPT NEW MATERIAL, UNLESS OTHERWISE NOTED.

**LEGEND:**

- CONTROL WIRING
- EQUIPMENT PIPING
- GS GLYCOL SUPPLY
- GR GLYCOL RETURN
- DDC DIRECT DIGITAL CONTROL
- DP DIFFERENTIAL PRESSURE SENSOR
- OIA OUTSIDE AIR
- EIA EXHAUST AIR
- P PUMP
- HX HEAT EXCHANGER
- ⊙ PUMP
- T TEMPERATURE SENSOR
- H HUMIDITY SENSOR

No.	REVISION/DESCRIPTION	BY	DATE
0	ISSUED FOR TENDER		18.03.08



DRAWN	CHECKED	DESIGNED	APPROVED
ML		MAP	
DATE 18.01.25	USER	APPROVAL	

THE CITY OF WINNIPEG  
PLANNING, PROPERTY AND  
DEVELOPMENT DEPARTMENT  
MUNICIPAL ACCOMMODATIONS DIVISION  
3-65 GARRY STREET, R5C 4K4

PROJECT  
REPLACEMENT OF ROOF TOP UNITS  
SERVING LAP POOL  
AT PAN AM POOL  
25 POSEIDON BAY

SCALE	PROJECT No:	SHEET No:
AS SHOWN	17-0107-023	M12