

ALL DRAWINGS AND SPECIFICATIONS ARE THE PROPERTY OF THE CONSULTANT AND NO REPRODUCTION MAY BE MADE WITHOUT THE CONSENT OF THE CONSULTANT AND THE CONTRACTOR SHALL VERIFY ALL DIMENSIONS, PATTERNS AND LEVELS PRIOR TO REPORTING ANY ERRORS OR OMISSIONS TO THE ENGINEER FOR ADJUSTMENTS. THIS DRAWING SHALL NOT BE SCALED.

WHA WATER HAMMER ARRESTORS

SMITH "HYDROTRON" WATER HAMMER ARRESTORS SERIES #5000, STAINLESS STEEL, PRESSURIZED CHAMBERS, BELLOWS, SIZE ACCORDING TO MANUFACTURER'S RECOMMENDATIONS CHART BELOW TO ELIMINATE WATER HAMMER AND SHOCK FROM PIPING SYSTEM. PROVIDE WATER HAMMER ARRESTORS ON HOT AND COLD WATER SUPPLIES TO ALL QUICK VALVES, SOLENOIDS, AND PLUMBING FIXTURES, AND LOCATE IN AN UPRIGHT POSITION BETWEEN THE LAST TWO FIXTURES ON A LINE, OR HORIZONTALLY AT THE END OF LINE CLOSEST TO SUPPLY SOURCE.

SIZE	FIXTURE UNITS	MODEL NO.	CONN. SIZE
A	1 - 11	5005	1/2" (12MM)
B	12 - 32	5010	3/4" (19MM)
C	33 - 60	5020	1" (25MM)
D	61 - 113	5030	1-1/4"(32MM)
E	114 - 154	5040	1-1/2"(38MM)
F	155 - 330	5050	2" (50MM)

P-1 POTABLE WATER PUMP

GRUNDFOS CR SERIES VERTICAL MULTISTAGE CENTRIFUGAL PUMP, MODEL # CR15-4, CAST IRON SUCTION AND DISCHARGE, STAINLESS STEEL CASING, BOWLS, AND IMPELLERS, EPDM ELASTOMERS, CARTRIDGE MECHANICAL SEAL WITH SILICON CARBIDE VS SILICON CARBIDE FACES, 1/3 HP, TEFC ENCLOSURE, 115/1/60 ELECTRIC MOTOR, CONNECTIONS: 1/4" 250# ANSI FLANGED, CAPACITY: 2 USGPM @ 40 PSI.

PT-1,2 PRESSURE TANKS

GOULDS V60 STAND MOUNTED PRESSURE TANK, 19.9 GAL CAPACITY.

WST-1 POTABLE WATER STORAGE TANK

EQUINOX E-250WS POLYETHYLENE INDOOR WATER AND STORAGE TANK, 250 GAL CAPACITY.

HT-1 SEWAGE HOLDING TANK

GUARDIAN HOLDING TANK G-1500-H7, 1500 GALLON CAPACITY, DEEP CONFIGURATION. PROVIDE COMPLETE WITH SLEEVE EXTENSION FOR DEEP CONFIGURATION.

HWT-1 DOMESTIC HOT WATER TANK

AO SMITH MODEL DEL-20 ELECTRIC DOMESTIC HOT WATER TANK, RATED AT 2 KW. VESSEL CONSTRUCTED FOR 150 PSI WORKING PRESSURE, GLASS LINED, INSULATED, MANUAL TEMPERATURE CONTROL, LOW WATER CUT OFF, 20 GALLON STORAGE CAPACITY, 208V.

WH-1 WALL HYDRANT

WATTS HY-330 WALL HYDRANT, CONCEALED MODERATE CLIMATE 3/4" (19MM) WITH NICKEL BRONZE BOX AND DOOR, CHROME PLATED HYDRANT FACE, INTEGRAL VACUUM BREAKER, GALVANIZED WALL CASING, ALL BRONZE HEAD AND HYDRANT KEY. LENGTH TO SUIT WALL THICKNESS.

WATER SOFTENERS

1. SUMMARY

- 1.1. PROVIDE A \$5000.00 ALLOWANCE FOR FUTURE WATER SOFTENER.
- 1.2. THIS SECTION PROVIDES GUIDANCE ON SELECTING AND INSTALLING A DOMESTIC WATER SOFTENER.
- 1.3. SPECIFYING A SUITABLE WATER SOFTENER REQUIRES INPUT FROM A LOCAL WATER SAMPLE AND ESTIMATED WATER CONSUMPTION.
- 1.4. THE CONTRACTOR SHALL COLLECT A LOCAL WATER SAMPLE AND HAVE IT ANALYZED FOR WATER HARDNESS. REPORT SHALL INDICATE MG/L OR GRAINS PER GALLON (GPG) OF CALCIUM AND MAGNESIUM, AND MG/L OR PARTS PER MILLION (PPM) OF IRON.
- 1.5. THE CONTRACTOR SHALL INPUT THIS DATA INTO THE CALCULATIONS IN PART 2 AND APPLY THE RESULTANT INFORMATION TO THE REMAINDER OF THIS SECTION TO COMPLETE THE SPECIFICATION.

2. PRODUCTS

- 2.1. SIZING CALCULATION:
 - 2.1.1. RECORD LEVELS OF CALCIUM AND MAGNESIUM. IF READING IN MG/L, DIVIDE THE READING BY 17.1 TO OBTAIN GRAINS PER GALLON (GPG).
 - 2.1.2. RECORD LEVEL OF IRON. MULTIPLY MG/L OR PARTS PER MILLION (PPM) X3 TO OBTAIN GRAINS PER GALLON (GPG).
 - 2.1.3. ADD: GPG CALCIUM AND MAGNESIUM + GPG IRON = TOTAL GPG.
 - 2.1.4. FOR THIS APPLICATION, IT IS ESTIMATED THAT THE VOLUME OF WATER USAGE PER DAY WILL BE 1000 GALLONS. IT IS ESTIMATED THE MAXIMUM FLOW RATE THROUGH THE SOFTENER WILL BE 20 GALLONS PER MINUTE (GPM).
 - 2.1.5. MULTIPLY: TOTAL GPG X 1000 GALLONS X 7 DAYS = THEORETICAL GRAINS REQUIRED
 - 2.1.6. DIVIDE: THEORETICAL GRAINS REQUIRED / 20,000 = CUBIC FEET OF RESIN BEADS REQUIRED.
 - 2.1.7. THE SPECIFIED WATER SOFTENER SHALL BE SIZED FOR:
 - 2.1.7.1. THE CUBIC FEET OF RESIN BEADS CALCULATED, AND
 - 2.1.7.2. THE ESTIMATED FLOW RATE (GPM).
- 2.2. SYSTEM REQUIREMENTS
 - 2.2.1. THE WATER SOFTENING SYSTEM SHALL BE A TURN-KEY COMPLETE SYSTEM BY ONE SUPPLIER. SOFTENING SYSTEM COMPONENTS SHALL INCLUDE RESIN TANK(S), BRINE TANK(S), BRINE FORMING SYSTEM, BRINE DISTRIBUTION AND METERING SYSTEM, REGENERATING MANIFOLD, STANDALONE CONTROL SYSTEMS INCLUDING A 7 DAY TIME CLOCK, AND 99.7% PURE SALT IN FORMED SHAPE PELLETS.

3. INSTALLATION

- 3.1. INSTALL AND SETUP AS PER MANUFACTURER'S REQUIREMENTS.
- 3.2. COMPONENTS SHALL BE PLACED AND SECURED TO AVOID FORCES ON CONNECTED PIPING.
- 3.3. REGENERATION DISCHARGE PIPE SHALL TERMINATE ABOVE A FUNNEL FLOOR DRAIN VIA AN AIR GAP.
- 3.4. INPUT INITIAL SYSTEM PARAMETERS INCLUDING WATER HARDNESS DATA.
- 3.5. SET CORRECT TIME ON THE SYSTEM INTERNAL TIME CLOCK. SET REGENERATION TIME FOR SUNDAY 2:00 AM UNLESS OTHERWISE NOTED.
- 3.6. FILL THE BRINE TANK WITH 99.7% PURE SALT IN FORMED SHAPE PELLETS. DO NOT USE ROCK SALT.
- 3.7. PROVIDE ONE EXTRA BAG OF SALT AND LEAVE NEXT TO BRINE TANK.

OUTSIDE SERVICES

1. PROVIDE PIPING SYSTEMS INCLUDING ALL NECESSARY CONNECTIONS TO SANITARY SEWER AND DOMESTIC WATER SERVICE.
2. RESPONSIBILITY FOR RESTORATION OF PAVED PUBLIC STREETS TO ORIGINAL CONDITION IF THEY HAVE BEEN AFFECTED AS A RESULT OF THE WORK IN THIS SECTION.
3. CONFIRMATION OF EXACT LOCATION AND INVERT ELEVATIONS OF SERVICES PRIOR TO COMMENCING WORK. IF ANY DISCREPANCIES SHOULD BE DISCOVERED, THEN NOTIFY THE CONTRACT ADMINISTRATOR IMMEDIATELY.
4. CONFORM WITH THE REQUIREMENTS OF THE PLANS AND SPECIFICATION, THE LOCAL AUTHORITIES HAVING JURISDICTION AND THE CITY OF WINNIPEG CONSTRUCTION SPECIFICATIONS. IN THE CASE OF CONFLICTING REQUIREMENTS, BE GOVERNED BY THE MOST SEVERE REGULATIONS.
5. SUBMIT SHOP DRAWINGS IN ACCORDANCE WITH SPECIFICATIONS.
6. EXAMINE AREA WHERE WORK IS TO BE PERFORMED FOR:
 - 6.1. ANYTHING THAT AFFECTS EXECUTION AND QUALITY OF WORK.
- 6.2. PIPING CLEARANCES.
7. WHERE, UNDER THIS CONTRACT, IT IS NECESSARY TO CONNECT EXISTING WEAR MAINS TO THOSE WHICH ARE TO BE LAID, ALL PRECAUTIONARY MEASURES DEEMED NECESSARY BY THE CONTRACT ADMINISTRATOR TO PROTECT EXISTING MAINS, AND TO CAUSE THE LEAST INCONVENIENCE TO USERS OF EXISTING MAINS, SHALL BE CARRIED OUT BY THE OUTSIDE SERVICES CONTRACTOR AT NO ADDITIONAL CHARGE TO THE CITY. THIS CHARGE, IF ANY, TO BE INCLUDED. NO VALVE OR OTHER CONTROL ON THE SYSTEM SHALL BE OBTAINED FOR ANY PURPOSE BY THE OUTSIDE SERVICES CONTRACTOR WITHOUT APPROVAL OF THE CONTRACT ADMINISTRATOR, AND ALL CONSUMERS AFFECTED BY SUCH OPERATIONS SHALL BE NOTIFIED BY THE OUTSIDE

SERVICE CONTRACTOR, AT LEAST ONE HOUR BEFORE THE OPERATION AND ADVISED OF THE PROBABLE TIME WHEN SERVICE WILL BE RESTORED.

8. THE OUTSIDE SERVICE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL DAMAGES TO ANY UNDERGROUND OR SURFACE UTILITY STRUCTURES, DRAIN, SEWER, WATER SERVICE, VALVE, SERVICE BOX OR OTHER OBSTRUCTION ENCOUNTERED IN THE PROGRESS OF THE WORK. ANY SERVICE OR OTHER UTILITY DAMAGE, SHALL BE REPAIRED OR REPLACED AT THE OUTSIDE SERVICE CONTRACTOR'S EXPENSE TO THE ENTIRE SATISFACTION OF THE CONTRACT ADMINISTRATOR.
9. PROCURE ALL PERMITS FOR CROSSING STREETS AND SIDEWALKS AND PERFORM NO EXCAVATION WITHOUT APPROVAL BY CITY ENGINEERING DEPARTMENT AND CONTRACT ADMINISTRATOR.
10. WHERE THE SURFACE OF A STREET, DRIVEWAY, BOULEVARD, OR SIDEWALK HAS BEEN CUT TO INSTALL PIPE, THE CROSSING SHALL BE BACKFILLED WITH GRANULAR FILL AND TAMPERED IN LIFTS AND RESURFACED TO THE ORIGINAL CONDITION, TO THE SATISFACTION OF THE CONTRACT ADMINISTRATOR AND AUTHORITIES HAVING JURISDICTION.
11. THIS CONTRACTOR SHALL MAKE APPLICATION AND PAY FOR ALL PERMITS, ASSESSMENTS, INSPECTION FEES, CONNECTION CHARGES, STREET CUT PERMITS AND ALL OTHER CHARGES PERTAINING TO THE COMPLETION OF INSTALLATION, TO ALL APPROPRIATE GOVERNMENTAL AUTHORITIES.
12. SEWER PIPES SHALL BE LAID ACCORDING TO THE GRADE AND ALIGNMENT SHOWN ON THE PLANS, WITHIN A TOLERANCE OF 1 1/2" (38 MM) VERTICAL AND 1/2" (300 MM) HORIZONTAL. THE OUTSIDE SERVICE CONTRACTOR TO ESTABLISH OWN BATTER BOARDS FOR LINE AND GRADE.
13. ALL PIPES SHALL BE LEFT UNCOVERED FOR INSPECTION AND NO PIPES SHALL BE COVERED UNTIL PERMISSION HAS BEEN GIVEN BY THE CONTRACT ADMINISTRATOR. THE CONTRACTOR SHALL ALLOW 48 HRS. NOTIFICATION PRIOR TO COMMENCEMENT OF WORK. SHOULD ANY PIPE BE COVERED BY THE CONTRACTOR BEFORE THE PERMISSION OF THE CONTRACT ADMINISTRATOR HAS BEEN OBTAINED, THE TRENCH SHALL BE REOPENED AT THE OUTSIDE CONTRACTOR'S EXPENSE.
14. PIPE BEDDING SHALL CONSIST OF A MINIMUM OF 4" (100 MM) SAND SHALL BE SPREAD AND GRADED OVER THE BOTTOM OF THE TRENCH BEFORE PLACING ANY PIPE. AFTER THE PIPE IS PLACED, FREE RUNNING SAND SHALL BE PLACED TO THE TOP OF THE PIPE AND THEN COMPACTED. PARTICULAR CARE SHALL BE TAKEN IN COMPACTING THIS MATERIAL TO GIVE PROPER SUPPORT TO THE PIPE. MORE SAND SHALL THEN BE PLACED AND THOROUGHLY COMPACTED TO 24" (600 MM) ABOVE THE PIPE IN 6" (150 MM) LIFTS. THE REMAINDER OF THE TRENCH WHERE GOING UNDER SIDEWALK PAVING, FLOOR SLABS, ETC. SHALL BE BACKFILLED WITH GRANULAR MATERIAL COMPACTED IN 12" (300 MM) LIFTS TO THE SATISFACTION OF THE CONTRACT ADMINISTRATOR. WHERE THE TRENCHES RUN THROUGH GRASSED AREAS, OR NON-PAVED AREAS, THE REMAINDER OF THE TRENCH MAY THEN BE BACKFILLED WITH CLEAN EARTH MECHANICALLY COMPACTED IN 12" (300 MM) LIFTS. ALL EXCAVATION SHALL BE CARRIED OUT IN STRICT ACCORDANCE WITH ALL GOVERNING CODES AND PROVINCIAL DEPARTMENT OF LABOUR REGULATIONS. ALL EXCESS MATERIAL SHALL BE REMOVED FROM THE SITE OR BE PLACED AS DIRECTED BY THE ARCHITECT AFTER INSTALLATION OF THE BURIED SERVICE.

HEATING, VENTILATION & AIR CONDITIONING

1. PROVIDE SUPPLY, RETURN AND EXHAUST AIR DUCT SYSTEMS FROM AIR HANDLING EQUIPMENT AND FANS AS SHOWN.
2. ALL DUCTWORK INSTALLATION SHALL BE PERFORMED IN ACCORDANCE WITH ASHRAE, SMACNA LATEST EDITION DUCT STANDARDS AND PART 9.36 OF THE NATIONAL BUILDING CODE.
3. THIS CONTRACTOR SHALL SUPPLY AND INSTALL ALL DUCTWORK INCLUDING APPURTENANCES, HANGERS, DAMPERS, ETC.
4. DUCT CONSTRUCTION:
 - 4.1. RECTANGULAR DUCTWORK SHALL BE CONSTRUCTED FROM GALVANIZED SHEET METAL OF THE FOLLOWING U.S. STANDARD GAUGES:

DUCTS UP TO 12" ON LONGEST DIMENSION	26 GA.
DUCTS 13" TO 28" ON LONGEST DIMENSION	24 GA.
 - 4.2. ROUND AND OVAL DUCTWORK SHALL BE SPIRAL CONDUIT CONSTRUCTION OF ZINC COATED STEEL OF THE FOLLOWING U.S. GAUGES:

CONDUIT SIZE	GAUGE OF METAL
8" AND SMALLER	26
9" TO 22"	24
5. BACK-DRAFT DAMPERS SHALL BE PROVIDED WITH THE FOLLOWING MINIMUM REQUIREMENTS:
 - 5.1. BALANCING DAMPERS SHALL BE CONSTRUCTED FROM GALVANIZED STEEL 2 GAUGES HEAVIER THAN THE DUCTWORK IN WHICH THEY ARE INSTALLED C/W LOCKING QUADRANT AND INDICATING DEVICE.
 - 5.2. 16 GA. GALVANIZED STEEL OR ALUMINUM CHANNEL FRAME; 16 GA. GALVANIZED BLADES C/W STIFFENERS, FULL BLADE-LENGTH SHAFT; BRASS, BALL, OR NYLON BUSHING; FELT OR NEOPRENE ANTI-CHATTER BLADE STRIPS; ADJUSTABLE COUNTER-BALANCE.
 - 5.3. SHALL BE BY ONE MANUFACTURER. STANDARD OF ACCEPTANCE: VENTEX, PRICE, TITUS.
6. TURNING VANES SHALL BE CONSTRUCTED TO THE FOLLOWING REQUIREMENTS:
 - 6.1. USE DUCT ELBOWS WHICH HAVE A THROAT RADIUS OF 1-1/2 TIMES THE DUCT DIAMETER.
 - 6.2. WHERE SPACE IS LIMITED, USE DUCT ELBOWS FABRICATED WITH SPACE THROATS AND BACKS AND FITTED WITH ROVANE TURNING VANES.
7. THE FOLLOWING DUCT JOINING METHODS SHALL BE USED:
 - 7.1. PITTSBURGH LOCK OR DOUBLE SLIDE LOCK HAMMERED FLAT FOR LONGITUDINAL JOINTS ON STRAIGHT DUCTWORK.
 - 7.2. PITTSBURGH LOCK FOR CORNER LOCK OF FITTING.
 - 7.3. FLAT DRIVE CLEAT JOINT ON ALL SIDE JOINTS 18" (450MM) AND UNDER IN LENGTH.
 - 7.4. FLAT SLIP CLEAT JOINT ON ALL TRANSVERSE JOINTS 18" (450MM) AND UNDER IN LENGTH.
 - 7.5. ANGLE "S" OR STANDING DRIVE CLEATS ON ALL SIDE JOINTS 19"(475MM) TO 30"(750MM) ON HEIGHT.
 - 7.6. STANDING "S" OR STANDING DRIVE CLEATS ON ALL TRANSVERSE JOINTS 19"(475MM) TO 30"(750MM) IN LENGTH.
 - 7.7. ANGLE "S" OR STANDING DRIVE CLEATS ON ALL TRANSVERSE AND SIDE JOINTS 31"(725MM) TO 72"(1800MM).
 - 7.8. STANDING "S" OR STANDING DRIVE CLEATS REINFORCED WITH 1 1/2"(38MM) X 4.5MM MILD STEEL BAR ON ALL TRANSVERSE AND SIDE JOINTS 73"(1825MM) AND OVER.
8. PROVIDE FIRE DAMPERS WHICH CONFORM TO NFPA REGULATIONS, BEAR ULC LABEL, AND HAVE APPROVAL OF AUTHORITY HAVING JURISDICTION. DAMPERS TO BE TYPE 'B' AND 'C' (UNLESS OTHERWISE NOTED) AND INSTALLED IN DUCTWORK AT FIRE SEPARATIONS WHETHER SHOWN OR NOT. VERIFY LOCATIONS ON ARCHITECTURAL DRAWINGS. ALL FIRE DAMPERS SHALL BE BY ONE MANUFACTURER. STANDARD OF ACCEPTANCE: NAILOR, PRICE, TITUS.
9. ALL NEW DUCTWORK SHALL BE SEALED USING DUCT BOND II HIGH PRESSURE, NON-TOXIC, DUCT SEALER THROUGHOUT ALL SEAMS AND JOINTS.
10. SUPPORT HORIZONTAL DUCTS ON MAXIMUM 8'-0" (24 M) CENTERS BY PERFORATED GALV. STEEL RIVETED STRAP FOR DUCTWORK 36" (915 MM) (EITHER DIMENSION) OR LESS, AND MINIMUM 1" X 1" X 1/8" (25 X 25 X 2 MM) GALV. IRON UNDER DUCTS OVER 36" (915 MM) (EITHER DIMENSION) WITH 3/8" (6 MM) DIAM. THREADED RODS SUSPENDING ANGLES FROM STRUCTURE.
11. PROVIDE ACCESS DOORS WHERE REQUIRED FOR SERVING OF EQUIPMENT AND FIRE DAMPERS.
12. PROVIDE 4" (100 MM) FLEXIBLE DUCT CONNECTIONS ON BOTH INLET AND OUTLET DISCHARGE SIDES OF EACH

FAN.

13. PROVIDE ONE SPARE SET OF FILTERS FOR HRV.

14. DUCT MOUNTED MOTORIZED DAMPERS SHALL BE PROVIDED WITH THE FOLLOWING REQUIREMENTS:
 - 14.1. ALL MOTORIZED DAMPERS SHALL BE INSULATED LOW LEAKAGE TYPE TO TAMCO 9000 OR EQUAL.
 - 14.2. MOTORIZED DAMPERS SHALL BE LOCATED AS NEAR AS POSSIBLE TO THE PLANE OF THE BUILDING ENVELOPE FOR ALL AIR INTAKE AND OUTLET TYPES.
 - 14.3. MOTORIZED DAMPERS SHALL CLOSE AUTOMATICALLY WHEN HVAC SYSTEM IS NOT IN OPERATION.
 - 14.4. MOTORIZED DAMPERS SHALL BE PROVIDED ON ALL AIR INTAKES AND AIR OUTLET DUCTS EXCEEDING 12" @ OR 12"x12" IN SIZE.
15. PROVIDE VIBRATION ISOLATORS FOR ALL MECHANICAL EQUIPMENT, INCLUDING PUMPS, UTILITY FANS, AND VENT SETS, AIR HANDLERS, ROOF-TOPS UNITS, CONDENSING UNITS, COMPRESSED, ETC. AS APPLICABLE. SUBMIT SHOP DRAWINGS PRIOR TO INSTALLATION.
16. PROVIDE WALL CAPS IN ALL SIDEWALL DISCHARGE APPLICATIONS AS INDICATED ON DRAWINGS. WALL CAPS TO BE OF STEEL CONSTRUCTION AND BE BY ONE MANUFACTURER. STANDARD OF ACCEPTANCE: REVERSOMATIC.
17. ALL AIR AND WATER SYSTEMS SHALL BE BALANCED AND TESTED BY A CERTIFIED A.A.B.C. INDEPENDENT BALANCING AGENCY TO PROVIDE QUANTITIES AS SHOWN. PROVIDE THREE(3) SETS OF BALANCE REPORTS FOR REVIEW BY THE CONTRACT ADMINISTRATOR. ALL BALANCING REPORTS SHALL INCLUDE FIRE DAMPER TESTING AND CERTIFICATION.
18. AUTOMATIC SPACE TEMPERATURE CONTROL DEVICES SHALL BE PROVIDED WITH THE FOLLOWING REQUIREMENTS:
 - 18.1. SHALL BE ACCURATE TO WITHIN 2F (1C).
 - 18.2. SHALL BE INSTALLED BETWEEN 4'-7" (1400MM) AND 4'-11" (1500MM) ABOVE THE FLOOR.
 - 18.3. SHALL BE INSTALLED ON INTERIOR WALLS OR EXTERIOR WALLS WITH R20 (3.5 RSI) AND AWAY FROM DIRECT SUNLIGHT AND HEAT SOURCES.
 - 18.4. SHALL DISABLE SIMULTANEOUS HEATING AND COOLING.

CONTROLS


THE POINTS BELOW DESCRIBE THE CONTROL SEQUENCE OF THE H.V.A.C. EQUIPMENT SPECIFIED IN THE SCHEDULES. ALL CONTROLS TO BE SUPPLIED BY MECHANICAL SUB CONTRACTOR AND WIRED BY MECHANICAL SUB CONTRACTOR UNLESS OTHERWISE SPECIFIED. CONTROLS CONTRACTOR SHALL BE A SUBCONTRACTOR OF THE MECHANICAL SUB CONTRACTOR. PROVIDE LOCKABLE COVERS FOR ALL THERMOSTATS, NEW OR EXISTING. ALL CONTROL WIRING SHALL BE PLENUM RATED IN ACCORDANCE WITH THE CANADIAN ELECTRICAL CODE TO MEET THE DEVELOPED SMOKE/FLAME SPREAD RATINGS OF 25/50.

1. HRV CONTROL:
 - 1.1. UNIT SHALL CYCLE BY TIME CLOCK BY UNIT SUPPLIER.
 - 1.2. WIRE CONTROL FOR DEFROST ELECTRIC COIL BY UNIT SUPPLIER. TO ENERGIZE COIL WHEN SUPPLY TEMPERATURE IS BELOW 30F(0C).
 - 1.3. PROVIDE CONTROLS TRANSFORMERS.
2. DOMESTIC WATER PRESSURIZATION PUMP CONTROL:
 - 2.1. PROVIDE PRESSURE SENSOR, TIME CLOCK AND ALL CONTROLS NECESSARY TO ENERGIZE AND DE-ENERGIZE PUMP AS PER PROGRAMMED SCHEDULE.
 - 2.2. PROVIDE CONTROLS TRANSFORMER AS REQUIRED.
3. WELL PUMP CONTROL:
 - 3.1. PROVIDE PRESSURE SENSOR AND ALL CONTROLS NECESSARY TO ENERGIZE AND DE-ENERGIZE PUMP.
 - 3.2. PROVIDE CONTROLS TRANSFORMER AS REQUIRED.
4. WATER SOFTENER CONTROL:
 - 4.1. PROVIDE ALL CONTROLS NECESSARY FOR WATER SOFTENER CONTROL.

MECHANICAL EQUIPMENT SCHEDULES:


EQUIPMENT THAT IS SUPPLIED WITH A FACTORY-INSTALLED DISCONNECTING MEANS FOR THE CONNECTION OF THE SUPPLY SIDE FEEDER CONDUCTORS MUST BE CERTIFIED SO THAT THESE CONDUCTORS CAN BE OF EITHER ALUMINUM OR COPPER.

MECHANICAL AND ELECTRICAL SUB CONTRACTORS ARE RESPONSIBLE FOR THE MUTUAL COORDINATION OF ALL ELECTRICAL REQUIREMENTS OF MECHANICAL EQUIPMENT. COORDINATION IS TO INCLUDE THE COMMUNICATION OF ALL FINAL ELECTRICAL NAMEPLATE INFORMATION FROM THE MECHANICAL SUB CONTRACTOR TO THE ELECTRICAL SUB CONTRACTOR, THE COMMUNICATION OF THE DETAILED CONTROL INFORMATION AS WELL AS ANY ANCILLARY INFORMATION REQUIRED FOR THE FINAL SYSTEMS TO OPERATE AS INTENDED BY THE RESPONSIBLE PROFESSIONAL ENGINEER. THE COORDINATION IS TO OCCUR PRIOR TO THE ORDERING OF EQUIPMENT BY EITHER TRADE. NO EXTRA COMPENSATION WILL BE ALLOWED DUE TO FAILURE TO CARRY OUT THIS COORDINATION. REPORT AT ONCE TO THE CONTRACT ADMINISTRATOR ANY DEFECT, DISCREPANCY, OMISSION OR INTERFERENCE AFFECTING THE SATISFACTORY COMPLETION OF WORK.

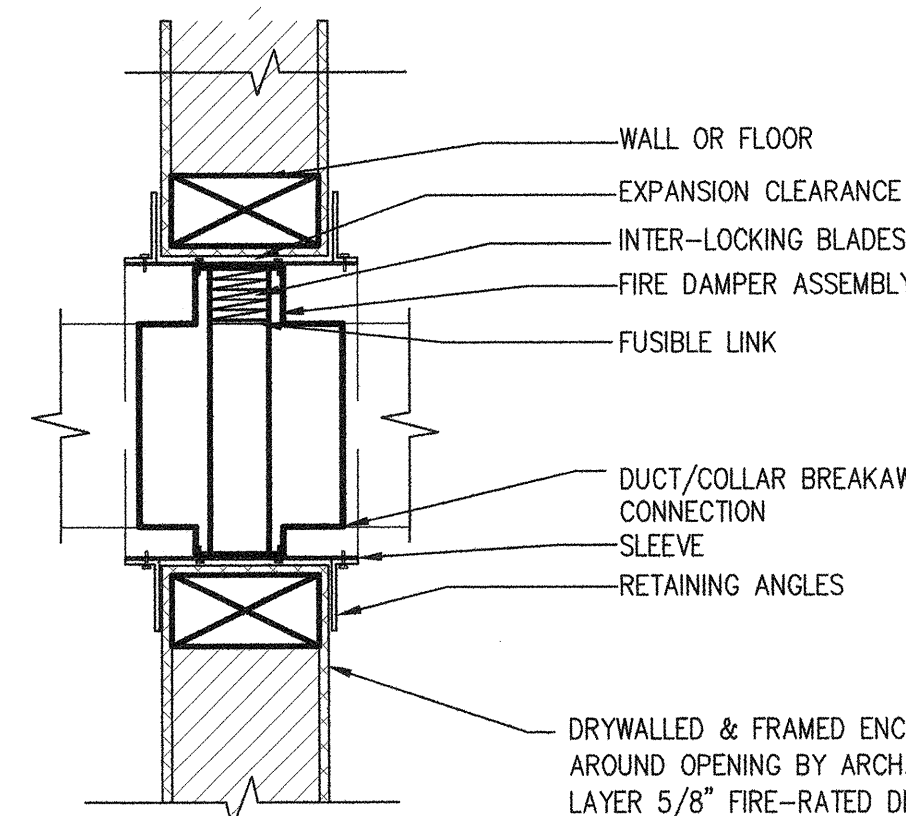


NOTES:
FIRE DAMPER TO BE INSTALLED AS PER MANUFACTURER'S RECOMMENDATION.

DUCT/COLLAR BREAKAWAY CONNECTION TO BE APPROVED.

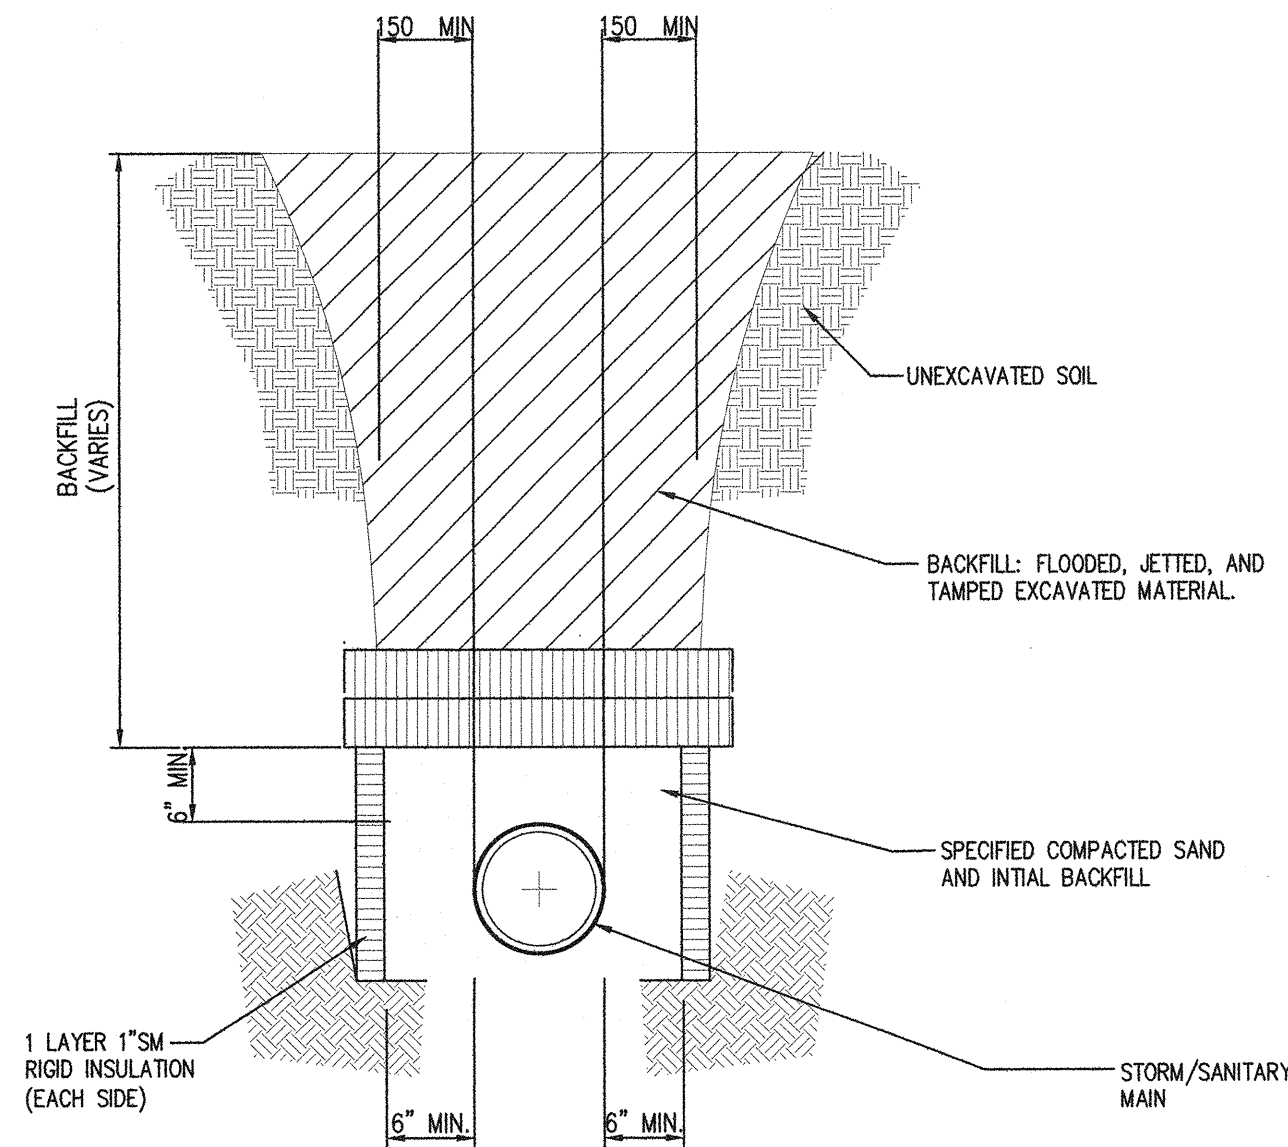

COMMON TRENCH INSTALLATION W/ INSULATION N.T.S.

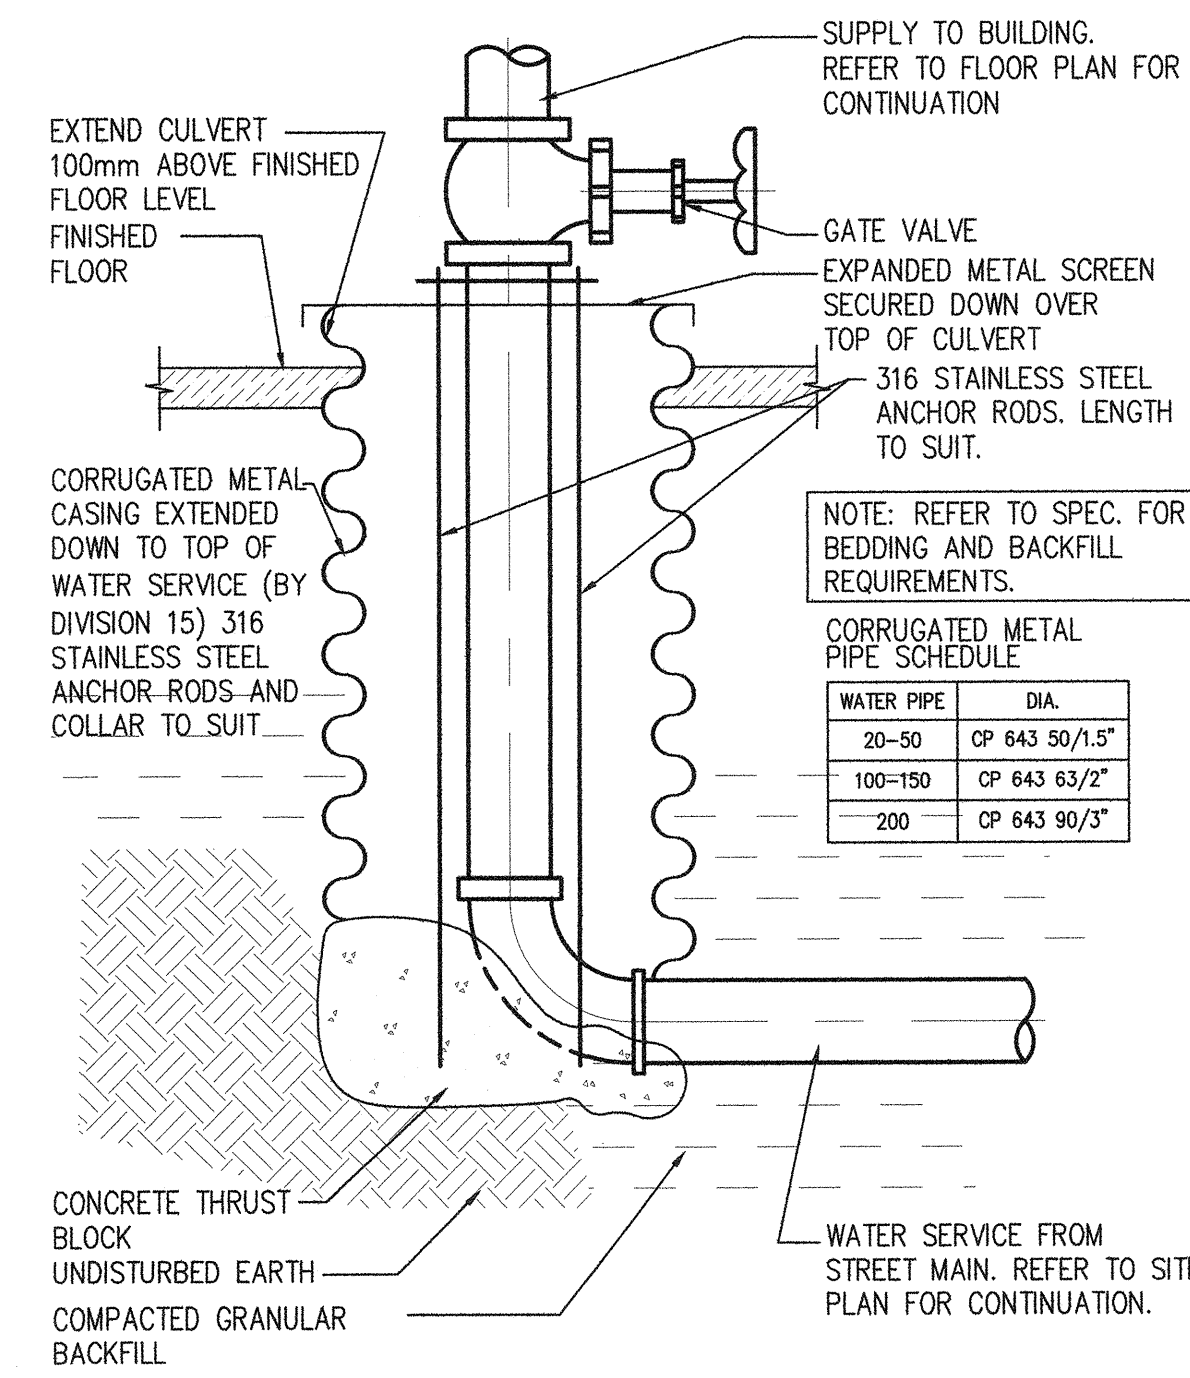

WATER SERVICE AND FROST BOX DETAIL N.T.S.

NOVA 3 ENGINEERING LTD. CONSULTING ENGINEERS

201-120 FORT STREET WINNIPEG, MANITOBA R3C 1C7 WWW.NOVA3.CA TEL: (204) 943-8142 FAX: (204) 942-1276

THIS DRAWING IS THE EXCLUSIVE PROPERTY OF NOVA 3 ENGINEERING LTD. AND MAY ONLY BE REPRODUCED WITH THE WRITTEN PERMISSION OF NOVA 3 ENGINEERING LTD.

THE CONCEPT AND DESIGN INCORPORATED INTO THIS DRAWING ARE BASED ON INFORMATION PROVIDED BY THE CLIENT AND OTHER RELATED SOURCES. PROFESSIONAL ENGINEER ACCEPTS NO RESPONSIBILITY FOR DRAWING AND DESIGN UNLESS DRAWING IS ACCOMPANIED BY ORIGINAL SEALED LETTER OF INTENT OR EQUIVALENT ACCEPTABLE FACSIMILE. PROFESSIONAL ENGINEER ACCEPTS NO RESPONSIBILITY FOR FINAL INSTALLATION CONFORMANCE WITHOUT ORIGINAL SEALED CERTIFICATE OF INSPECTION OR EQUIVALENT ACCEPTABLE FACSIMILE.



Revisions


May 17, 2018 Issued for Construction
Date Revision

Northern Sky Architecture Inc.

100-128 James Avenue R3B 1G6 Winnipeg, Canada
Contact: 204.943.7979
204.943.6767

APEGM Certificate of Authorization
Nova 3 Engineering Ltd.
No.962 Date: 2018/05/24

Stamp

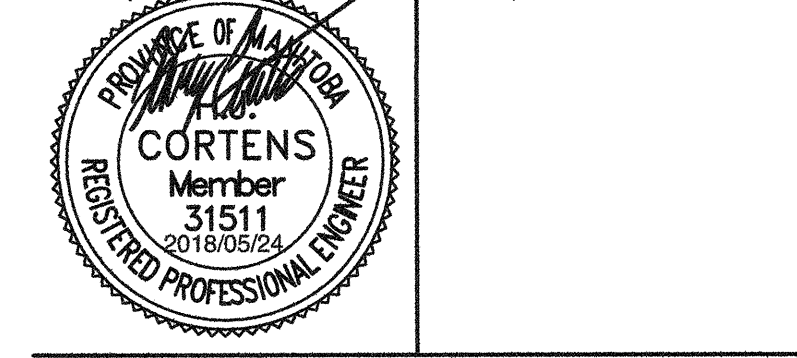

Project

New La Barriere Park Washroom Project
La Barriere Park, Manitoba

drawing title
MECHANICAL -- SPECIFICATION

scale	as noted	designed by	kbb
date	May, 2018	drawn by	hc
project no.	16.235	reviewed by	hc
bld opp. no.	436-2018	sheet	M.3.1 REV.

ISSUED FOR CONSTRUCTION