

GENERAL NOTES:

- DESIGN IS IN ACCORDANCE WITH THE NATIONAL BUILDING CODE OF CANADA, 2015 EDITION PLUS LATEST MANITOBA AMENDMENTS. CONCRETE WALLS ARE DESIGNED IN ACCORDANCE WITH THE RECOMMENDATIONS CONTAINED IN ACI 308R FOR WATERTIGHT STRUCTURES.
- EXCAVATE ALL TOP SOIL, ORGANIC MATERIAL AND LOOSE OR UNSUITABLE FILL TO THE APPROVAL OF THE CONTRACT ADMINISTRATOR.
- WATER-STOPS SHALL BE PROVIDED AT ALL CONSTRUCTION JOINTS. CONSTRUCTION JOINT LOCATIONS ARE TO BE APPROVED BY THE CONTRACT ADMINISTRATOR.
- DO NOT SCALE THE DRAWINGS.
- VERIFY ALL DIMENSIONS, ELEVATIONS AND SCOPE OF WORK PRIOR TO COMMENCEMENT OF CONSTRUCTION.
- VERIFY ALL MECHANICAL OPENINGS.
- VERIFY ANY MAJOR OPENINGS THAT ARE REQUIRED BUT NOT SHOWN ON THE DRAWINGS WITH THE CONTRACT ADMINISTRATOR.
- STRUCTURAL DRAWINGS SHOW THE COMPLETED STRUCTURE. THEY DO NOT SHOW THE COMPONENTS WHICH MAY BE NECESSARY FOR SAFETY DURING CONSTRUCTION.
- THE CONTRACTOR IS RESPONSIBLE FOR SAFETY IN AND ABOUT THE JOB SITE DURING CONSTRUCTION.
- IF ANY UNSOUND STRUCTURAL CONDITIONS ARE OBSERVED OR CREATED DURING CONSTRUCTION, REPORT THEM IMMEDIATELY TO THE CONTRACT ADMINISTRATOR.
- STRUCTURAL DRAWINGS MAY NOT SHOW ALL MECHANICAL OPENINGS. REFER TO MECHANICAL DRAWINGS FOR ACTUAL LOCATIONS AND ELEVATIONS OF OPENINGS. NOTIFY THE CONTRACT ADMINISTRATOR OF ANY ADDITIONAL OPENING REQUIREMENTS.
- DESIGN LOADS ARE AS NOTED BELOW:

ROOF LIVE LOADS:	
HATCHES	3.6 kPa
ALL OTHER AREAS	3.6 kPa
SNOW LOAD	1.9 kPa PLUS APPLICABLE NBC MODIFICATIONS
FLOOR LIVE LOADS:	
WATER LOAD	110 kPa
FOUNDATION WALL LOADS:	
LIVE LOAD	12.0 kPa ADDITIONAL CONSTRUCTION LOAD
LATERAL FORCE	$P = K (\gamma x H + q)$
WHERE	$K = 0.61, \gamma = 22 \text{ kN/m}^3, H = \text{HT. OF FILL (m)}, q = 12.0 \text{ kPa}$
DESIGN FLOOD LEVELS:	
700 YEAR FLOOD	231.010

FOUNDATIONS:

- FOUNDATIONS DESIGNED IN ACCORDANCE WITH RECOMMENDATIONS PROVIDED BY AMEC FOSTER WHEELER ENVIRONMENTAL AND INFRASTRUCTURE.

BACKFILL:

- CLASS 2 BACKFILL SHALL BE PLACED ALONG SOUTH, EAST & WEST SIDES OF CHAMBER IN ACCORDANCE WITH CW 2030.

CAST IN PLACE CONCRETE:

- TO BE READ IN CONJUNCTION WITH CW 2160 AND AS AMENDED IN ACCORDANCE WITH THESE NOTES.
- CONCRETE WORK SHALL BE IN ACCORDANCE WITH THE LATEST EDITION OF CSA A23.1.
- CONCRETE MIX SHALL BE IN ACCORDANCE WITH ALTERNATIVE 1, AND SHALL HAVE THE FOLLOWING PROPERTIES:

a. CLASS OF EXPOSURE:	S-1
b. MINIMUM COMPRESSIVE STRENGTH AT 28 DAYS:	35MPa
c. MAXIMUM SLUMP:	80mm ± 20mm
d. AIR CONTENT:	5 - 8%
e. MAXIMUM WATER/CEMENT RATIO:	0.40
- CONCRETE COVER SHALL BE 50mm.
- CHAMFER ALL EXTERIOR CORNERS 20mm.
- FORMWORK, SHORING AND BRACING SHALL MEET DESIGN CODE AND CSA A23.1 REQUIREMENTS, AND BE CONSTRUCTED ACCURATELY SO THAT RESULTANT FINISHED CONCRETE CONFORMS TO THE SHAPES, LINES AND DIMENSIONS INDICATED ON THE DRAWINGS.
- FOR COLD WEATHER CONCRETING, ALL ICE, SNOW AND FROST SHALL BE REMOVED FROM THE FORMWORK AND THE TEMPERATURE OF ALL CONTACT SURFACES INCLUDING REINFORCING STEEL SHALL BE RAISED ABOVE 10°C FOR AT LEAST 24 HOURS PRIOR TO CASTING CONCRETE. CONCRETE SHALL NOT BE LESS THAN 20°C NOR MORE THAN 30°C WHEN DEPOSITED. CONCRETE SHALL BE ENCLOSED, AND THIS AREA SHALL HAVE A TEMPERATURE OF NOT LESS THAN 20°C FOR 5 DAYS AND NOT LESS THAN 5°C FOR AN ADDITIONAL 5 DAYS.
- THREE CONCRETE TEST CYLINDERS AND ONE SLUMP/AIR TEST SHALL BE TAKEN EACH DAY THAT CONCRETE IS PLACED, AND SHALL BE REPEATED FOR EVERY 20 m³ OF CONCRETE PLACED EACH DAY UNLESS OTHERWISE DIRECTED BY THE CONTRACT ADMINISTRATOR.
- NOTIFY THE CONTRACT ADMINISTRATOR OR TESTING AGENCY 48 HOURS PRIOR TO PLACING CONCRETE.

REINFORCING STEEL:



- TO BE READ IN CONJUNCTION WITH CW 2160 AND AS AMENDED IN ACCORDANCE WITH THESE NOTES.
- ALL REINFORCING STEEL SHALL CONFORM TO CSA G30.18M, GRADE 400W.
- PERFORM CONCRETE REINFORCING WORK IN ACCORDANCE WITH CSA A23.1.
- LAPS SHALL BE AT LEAST 40 BAR DIAMETERS, LOCATE REINFORCING SPLICES NOT INDICATED IN THE DRAWINGS AT POINTS OF MINIMUM STRESS.
- BEFORE PLACING CONCRETE, ENSURE REINFORCING IS CLEAN, FREE OF LOOSE SCALE, DIRT OR OTHER FOREIGN MATTER THAT WOULD REDUCE OR PREVENT BOND TO THE CONCRETE.
- SHOP DRAWINGS SHALL BE SUBMITTED WHICH CLEARLY INDICATE BAR SIZES, SPACING, LOCATIONS AND QUANTITIES OF REINFORCING STEEL. COPIES OF STRUCTURAL DRAWINGS WILL NOT BE ACCEPTED FOR USE AS SHOP DRAWINGS.

STRUCTURAL STEEL:

- ALL STRUCTURAL STAINLESS STEEL SHAPES SHALL BE IN ACCORDANCE WITH ASTM A276/A276M-17 TYPE 304 OR 304L AND STAINLESS STEEL PLATES SHALL BE IN ACCORDANCE WITH ASTM A240/A240M-17 TYPE 304 OR 304L.
- ALL OTHER STRUCTURAL STEEL SHAPES AND PLATES SHALL BE IN ACCORDANCE WITH CSA G40.21-M, GRADE 300W, EXCEPT W, HP AND HSS SECTIONS WHICH SHALL BE GRADE 350W CLASS C.
- ALL GALVANIZING SHALL COMPLY WITH THE LATEST EDITION OF CSA G164, WITH MINIMUM ZINC COATING OF 800g/m². TOUCH UPS TO BE MADE WITH GALVALLOY OR GAL-VIZ.
- ALL BOLTS TO BE ASTM A316 STAINLESS STEEL, UNLESS OTHERWISE INDICATED.

OTHER NOTES:

- ALL ALUMINUM IN CONTACT WITH CONCRETE SHALL BE PAINTED WITH BITUMINOUS ISOLATION COATING AT THE ALUMINUM/CONCRETE INTERFACE.
- GRATING FOR MID-LEVEL SUPPORT PLATFORM SHALL BE TYPE NG 2" DEEP MOLDED GRATING WITH ACCESSORIES AS SUPPLIED BY NATIONAL GRATING OR APPROVED EQUIVALENT.

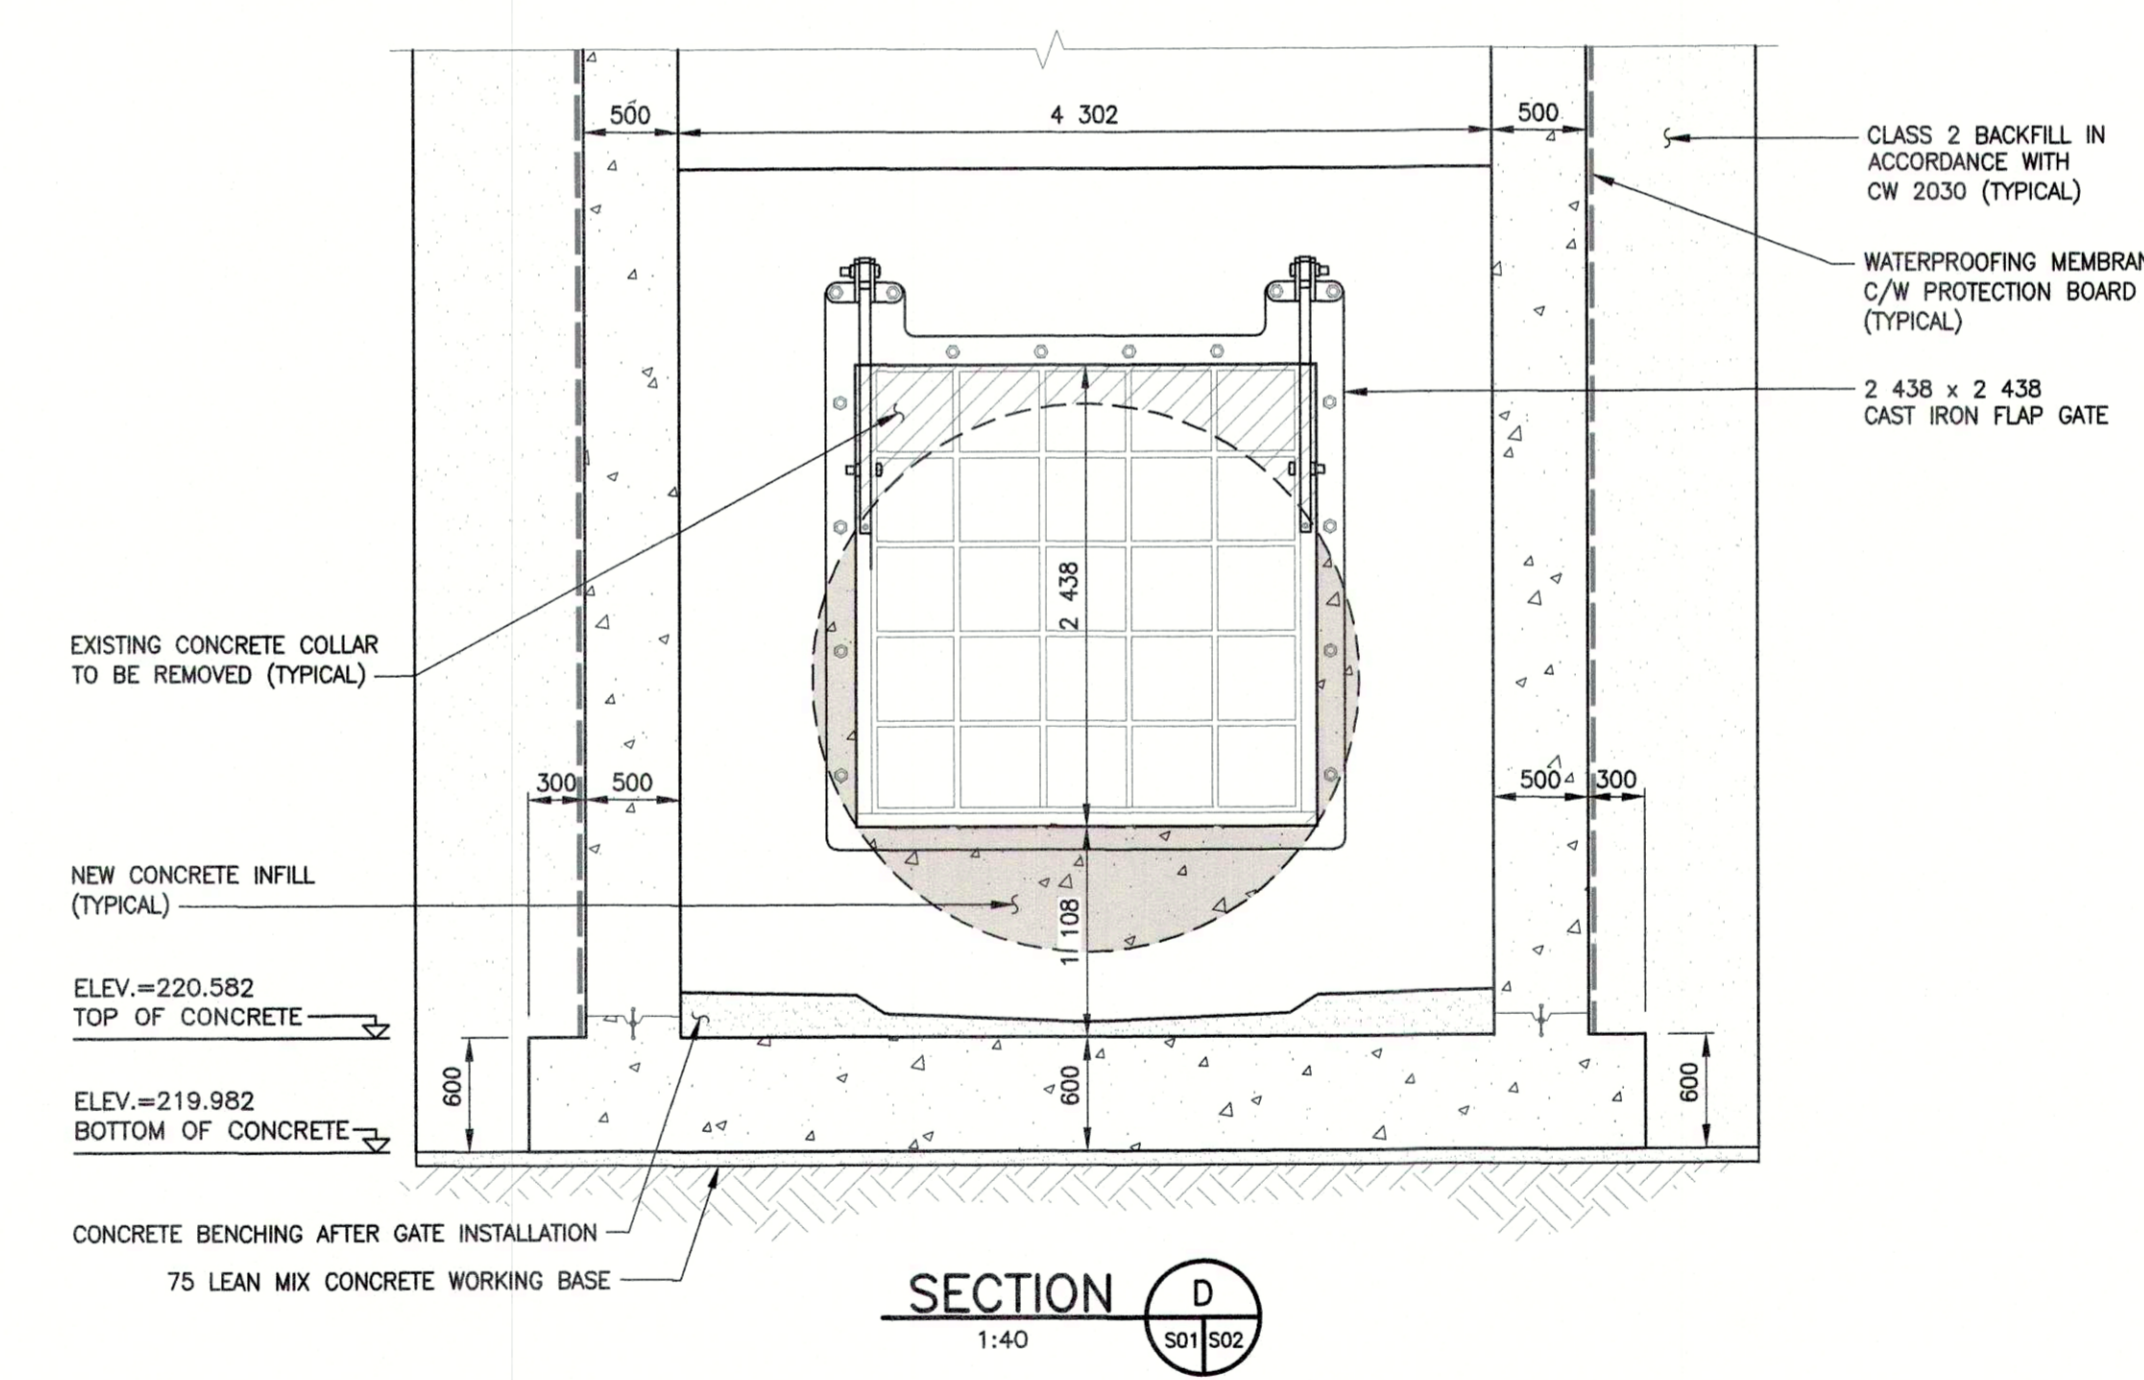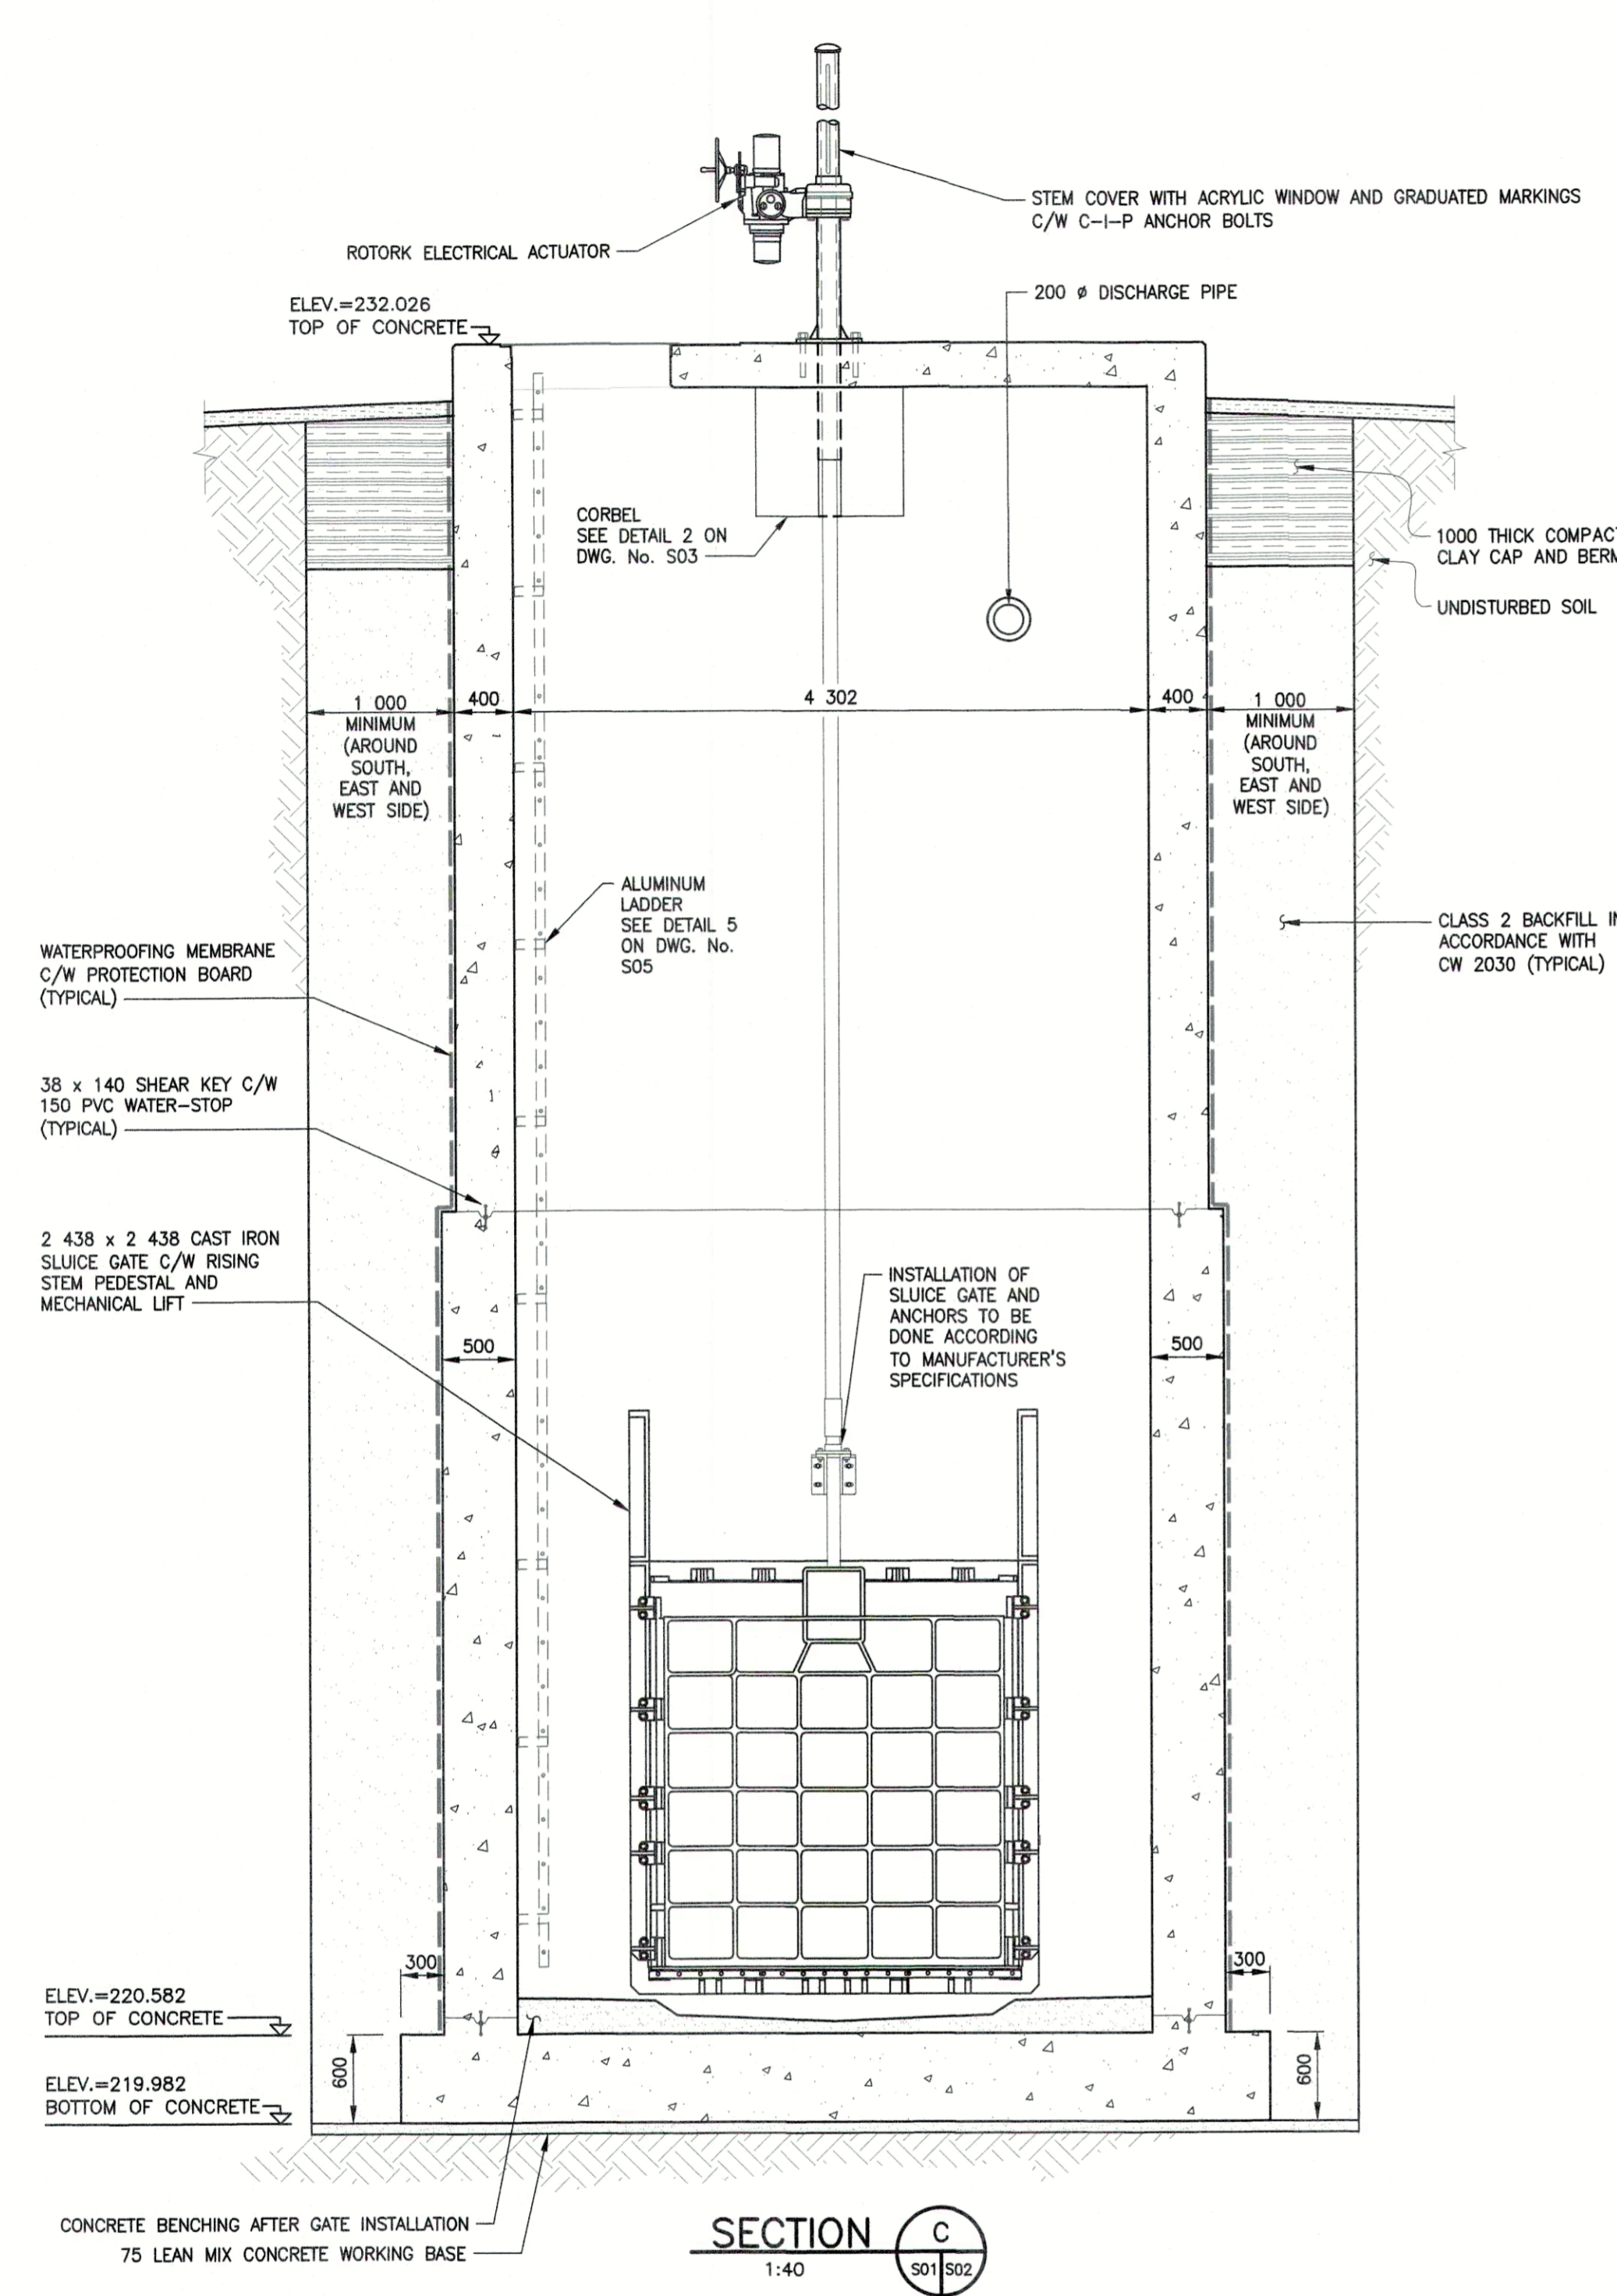

SECTION C
1:40

SECTION D
1:40

ELEV.=232.026
TOP OF CONCRETE

ELEV.=220.582
TOP OF CONCRETE

ELEV.=219.982
BOTTOM OF CONCRETE

MINIMUM (AROUND SOUTH, EAST AND WEST SIDE)

1 000

400

4 302

400

1 000

MINIMUM (AROUND SOUTH, EAST AND WEST SIDE)

1000 THICK COMPACTED CLAY CAP AND BERM

UNDISTURBED SOIL

CLASS 2 BACKFILL IN ACCORDANCE WITH CW 2030 (TYPICAL)

ALUMINUM LADDER SEE DETAIL 5 ON DWG. No. S05

WATERPROOFING MEMBRANE C/W PROTECTION BOARD (TYPICAL)

38 x 140 SHEAR KEY C/W 150 PVC WATER-STOP (TYPICAL)

2 438 x 2 438 CAST IRON SLUICE GATE C/W RISING STEM PEDESTAL AND MECHANICAL LIFT

INSTALLATION OF SLUICE GATE AND ANCHORS TO BE DONE ACCORDING TO MANUFACTURER'S SPECIFICATIONS

CONCRETE BENCHING AFTER GATE INSTALLATION
75 LEAN MIX CONCRETE WORKING BASE

SECTION D
1:40

EXISTING CONCRETE COLLAR TO BE REMOVED (TYPICAL)

NEW CONCRETE INFILL (TYPICAL)

ELEV.=220.582
TOP OF CONCRETE

ELEV.=219.982
BOTTOM OF CONCRETE

500

4 302


500

CLASS 2 BACKFILL IN ACCORDANCE WITH CW 2030 (TYPICAL)

WATERPROOFING MEMBRANE C/W PROTECTION BOARD (TYPICAL)

2 438 x 2 438 CAST IRON FLAP GATE

CONCRETE BENCHING AFTER GATE INSTALLATION
75 LEAN MIX CONCRETE WORKING BASE

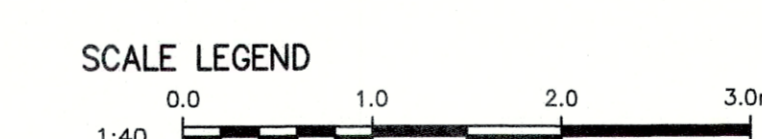

METRIC

WHOLE NUMBERS INDICATE MILLIMETRES
DECIMALIZED NUMBERS INDICATE METRES

**ENGINEERS
GEOSCIENTISTS
MANITOBA**
Certificate of Authorization
WSP Canada Group Limited
No. 6657

G.R.M. ELEV.		DESIGNED BY BB/MRI		CHECKED BY EH	
		DRAWN BY KD		APPROVED BY JPL	
		H.R.L. SCALE AS NOTED		RELEASED FOR CONSTRUCTION Signed by KZ September 14, 2018	
		VERTICAL AS NOTED		DATE 13/09/2018	
NO.	REVISIONS	DATE	BY	DATE	BY
1	ISSUED FOR TENDER	13/09/2018	BB		

WSP WSP Canada Group Limited
93 Lombard Avenue, Suite 111
Winnipeg MB R3B 3B1
T+ 1 204-943-3178
F+ 1 204-943-4948
www.wsp.com

ENGINEER'S SEAL
R.B. BOWLES
Member
34037
REGISTERED PROFESSIONAL ENGINEER

THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT

OUTFALL GATE CHAMBER UPGRADES
AUBREY STREET
SRS OUTFALL GATE CHAMBER

CONSULTANT DRAWING NUMBER
5516047 - S02

SHEET OF
04 OF 33

CITY DRAWING NUMBER
LD-8016

BID OPPORTUNITY: 865-2018
PLOT DATE: 13/09/2018

CONCRETE DETAILS (SHEET 2 OF 2)

NOTE: These design documents are prepared solely for the use by the party with whom the design professional has entered into a contract and there are no representations of any kind made by the design professional to any party with whom the design professional has not entered into a contract.