

1
M2.3
SCALE: 1/8" = 1'-0"


MAIN FLOOR PLAN - TRACK 13-24 - NEW CONSTRUCTION - FIRE PROTECTION

GENERAL NOTES

- A. THIS BUILDING MAY CONTAIN ASBESTOS. REFER TO FRONT END SPECIFICATION FOR INFORMATION.
- B. THE SPRINKLER SYSTEM SHALL BE DESIGNED AND INSTALLED IN ACCORDANCE WITH NFPA 13 MANITOWA BUILDING CODE, MANITOWA FIRE CODE, LOCAL BUILDING BY-LAWS, THE AUTHORITY HAVING JURISDICTION AND THE SPECIFICATION.
- C. REFER TO ROOF DETAILS AND SPECIFICATIONS FOR ALL NEW AND CAPPED OPENINGS.


KEY NOTES

- 1. SPRINKLER SYSTEM AT HIGH LEVEL NOT SHOWN. PROVIDE NEW SPRINKLER HEADS UNDER NEW DUCTWORK AS REQUIRED. PROVIDE LOWER LEVEL SPRINKLER HEADS UNDER NEW DUCTWORK AS FAR AWAY FROM BUS TAIL PIPE AS POSSIBLE. LOWER LEVEL SPRINKLER HEADS UNDER NEW DUCTWORK SHALL BE HIGH TEMPERATURE TYPE (200°F ACTIVATION). HIGH LEVEL SPRINKLER HEADS AT UNDERSIDE OF STRUCTURE SHALL BE STANDARD TEMPERATURE TYPE (165°F ACTIVATION).
- 2. RELOCATE EXISTING SPRINKLER MAIN TO SUIT NEW DUCTWORK.

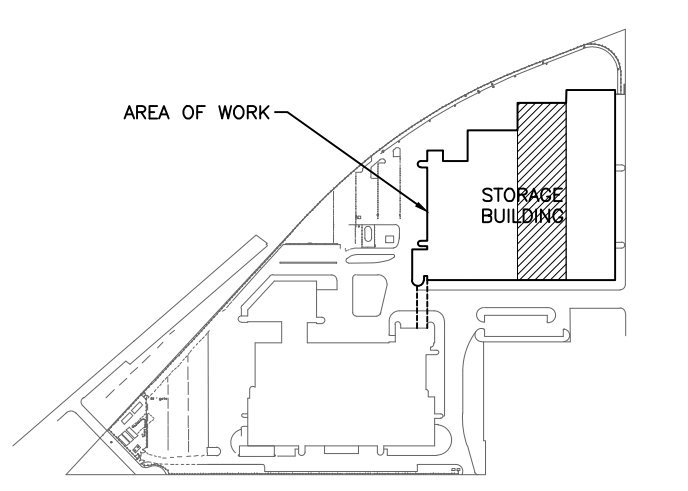

KEY PLAN

NO.	Description	BY	DATE
0	ISSUED FOR CONSTRUCTION	JH	09/11/18

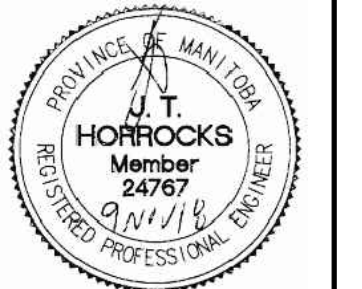

770 Bradford Street
Winnipeg, Canada
T 204 775 0392
SMSeng.com

Project Title
CITY OF WINNIPEG FORT ROUGE TRANSIT BASE - STORAGE TRACK 13-24 - MECHANICAL UPGRADE

Winnipeg Manitoba
Drawing Title
MAIN FLOOR PLAN - TRACK 13-24 - NEW CONSTRUCTION - FIRE PROTECTION

Drawn By	Checked By	Approved By
JC/AS	XZ	JH
Scale	Date	Project No.
AS NOTED	NOVEMBER, 2018	18-240-01
Revision Number	Drawing Number	Sheet Order
0	M2.3	8 OF 12