

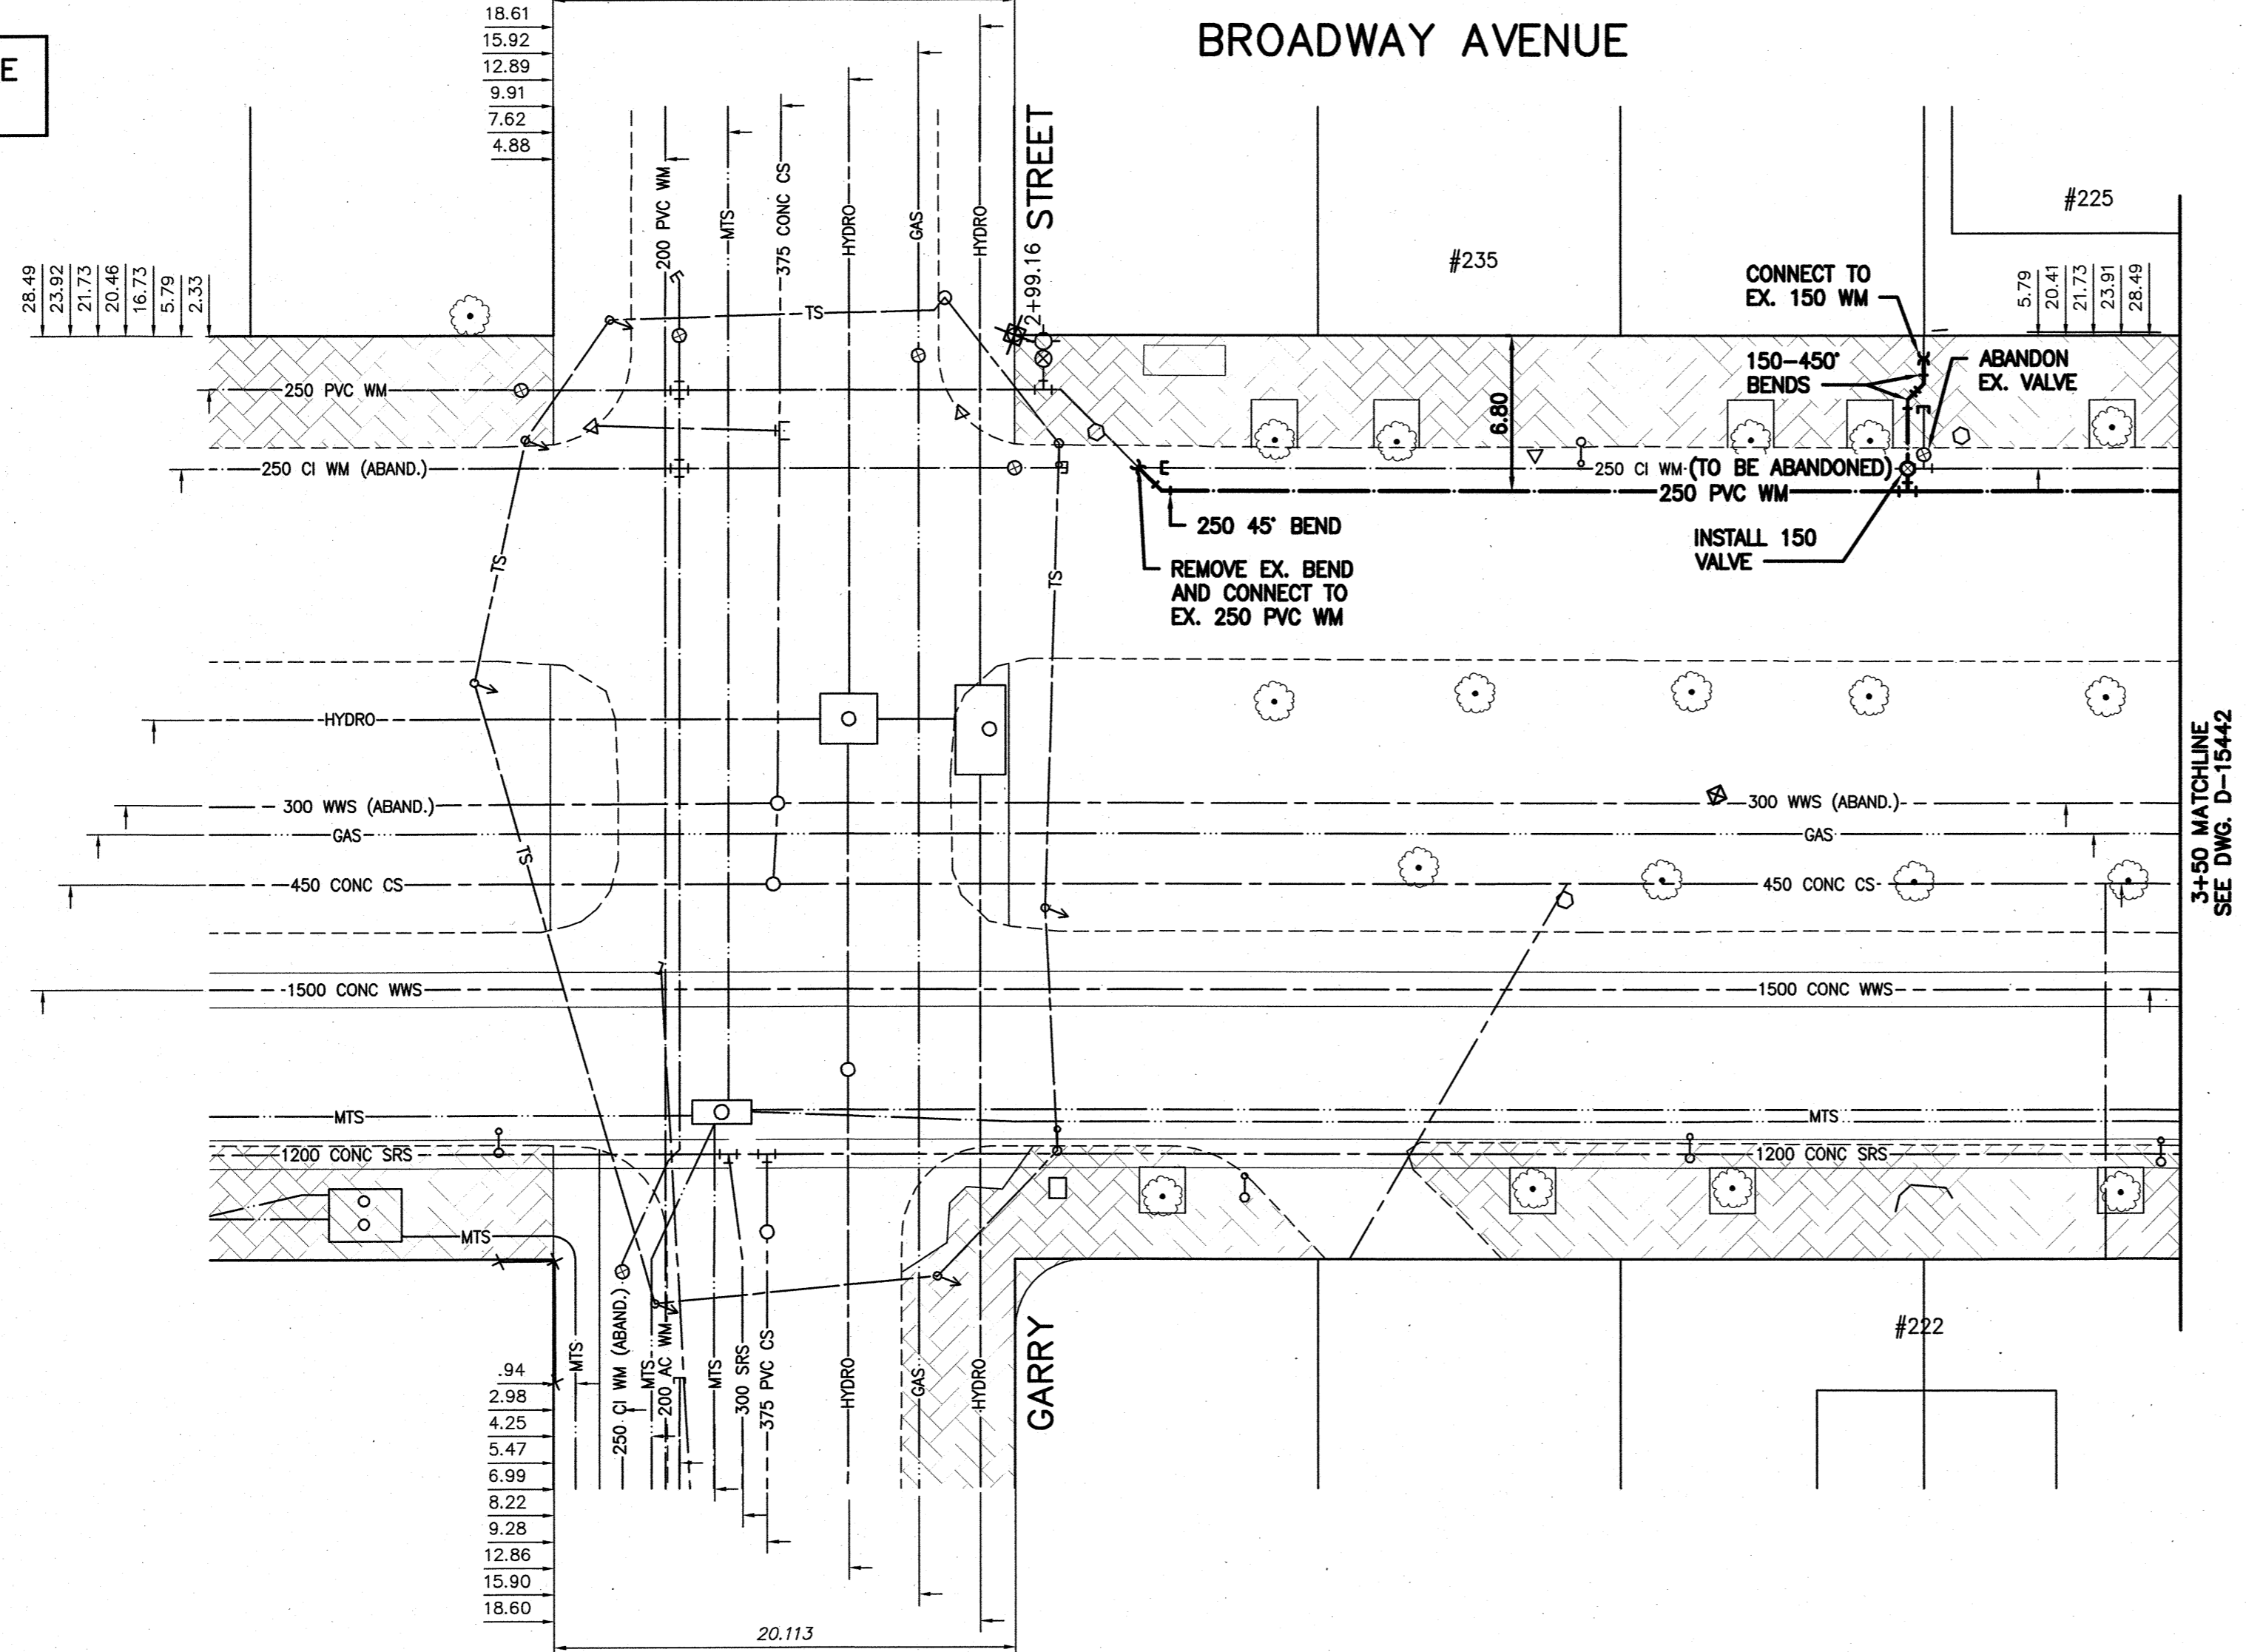


NOTE: CHAINAGES SHOWN ARE ALONG CENTRE LINE OF ROW



WATER SERVICE INFORMATION					
ADDRESS	PIPE SIZE & MATERIAL (STREET)	PIPE SIZE & MATERIAL (PROP.)	SHORT & LONG MEASUREMENT	CORP. LOCATION	REMARKS
* 225 BROADWAY	-	-	-	-	RENEW SERVICE
COMMERCIAL	-	-	39.62 WML OF FORT	-	-
* SERVICES TO BE RENEWED TO R					

NOTE: VALVES TO BE INSTALLED COUNTERCLOCKWISE TO CLOSE

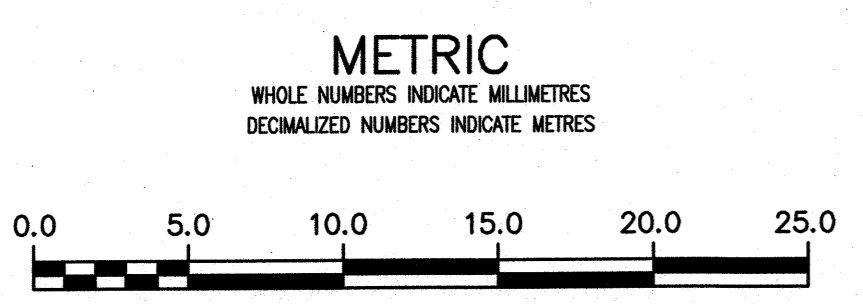


**ENGINEERS GEOSCIENTISTS MANITOBA**  
 Certificate of Authorization  
 Stantec Consulting Ltd.  
 No. 1301

LOCATION APPROVED UNDERGROUND STRUCTURES		B.M. 35-14 ELEV 232.527m		D.B.M. IN LEGISLATIVE GROUNDS, 44.2 M S. OF SIDEWALK OF BROADWAY, 18.6 M W. OF W. SIDEWALK ON KENNEDY ST.	
SUPV. U/G STRUCTURES COMMITTEE	DATE	NO.	REVISIONS	DATE	BY
		02	ISSUED FOR TENDER	2019.04.02	RS
		01	ISSUED FOR 30% REVIEW	2019.02.22	RS



DESIGNED BY	RS	CHECKED BY	RS
DRAWN BY	SC	APPROVED BY	RS
SCALE:	HORIZONTAL 1:250 VERTICAL 1:50		
DATE	2019.01.15	RELEASED FOR CONSTRUCTION DATE	APRIL 2/19
PLOT DATE:	2019 04 01		

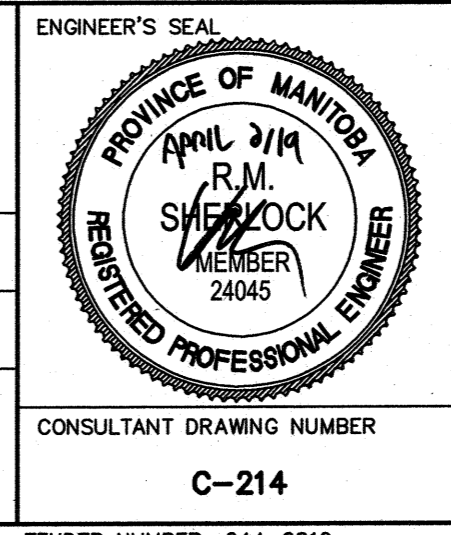

**THE CITY OF WINNIPEG**  
 WATER AND WASTE DEPARTMENT  
 ENGINEERING DIVISION

2019 WATERMAIN RENEWALS  
 CONTRACT 5  
 BROADWAY AVENUE  
 GARRY ST. TO STA. 1+50

SHEET 15 OF 17  
 CITY DRAWING NUMBER  
 D-15441

CONSULTANT DRAWING NUMBER  
 C-214