


DIGESTER 11 ROOF

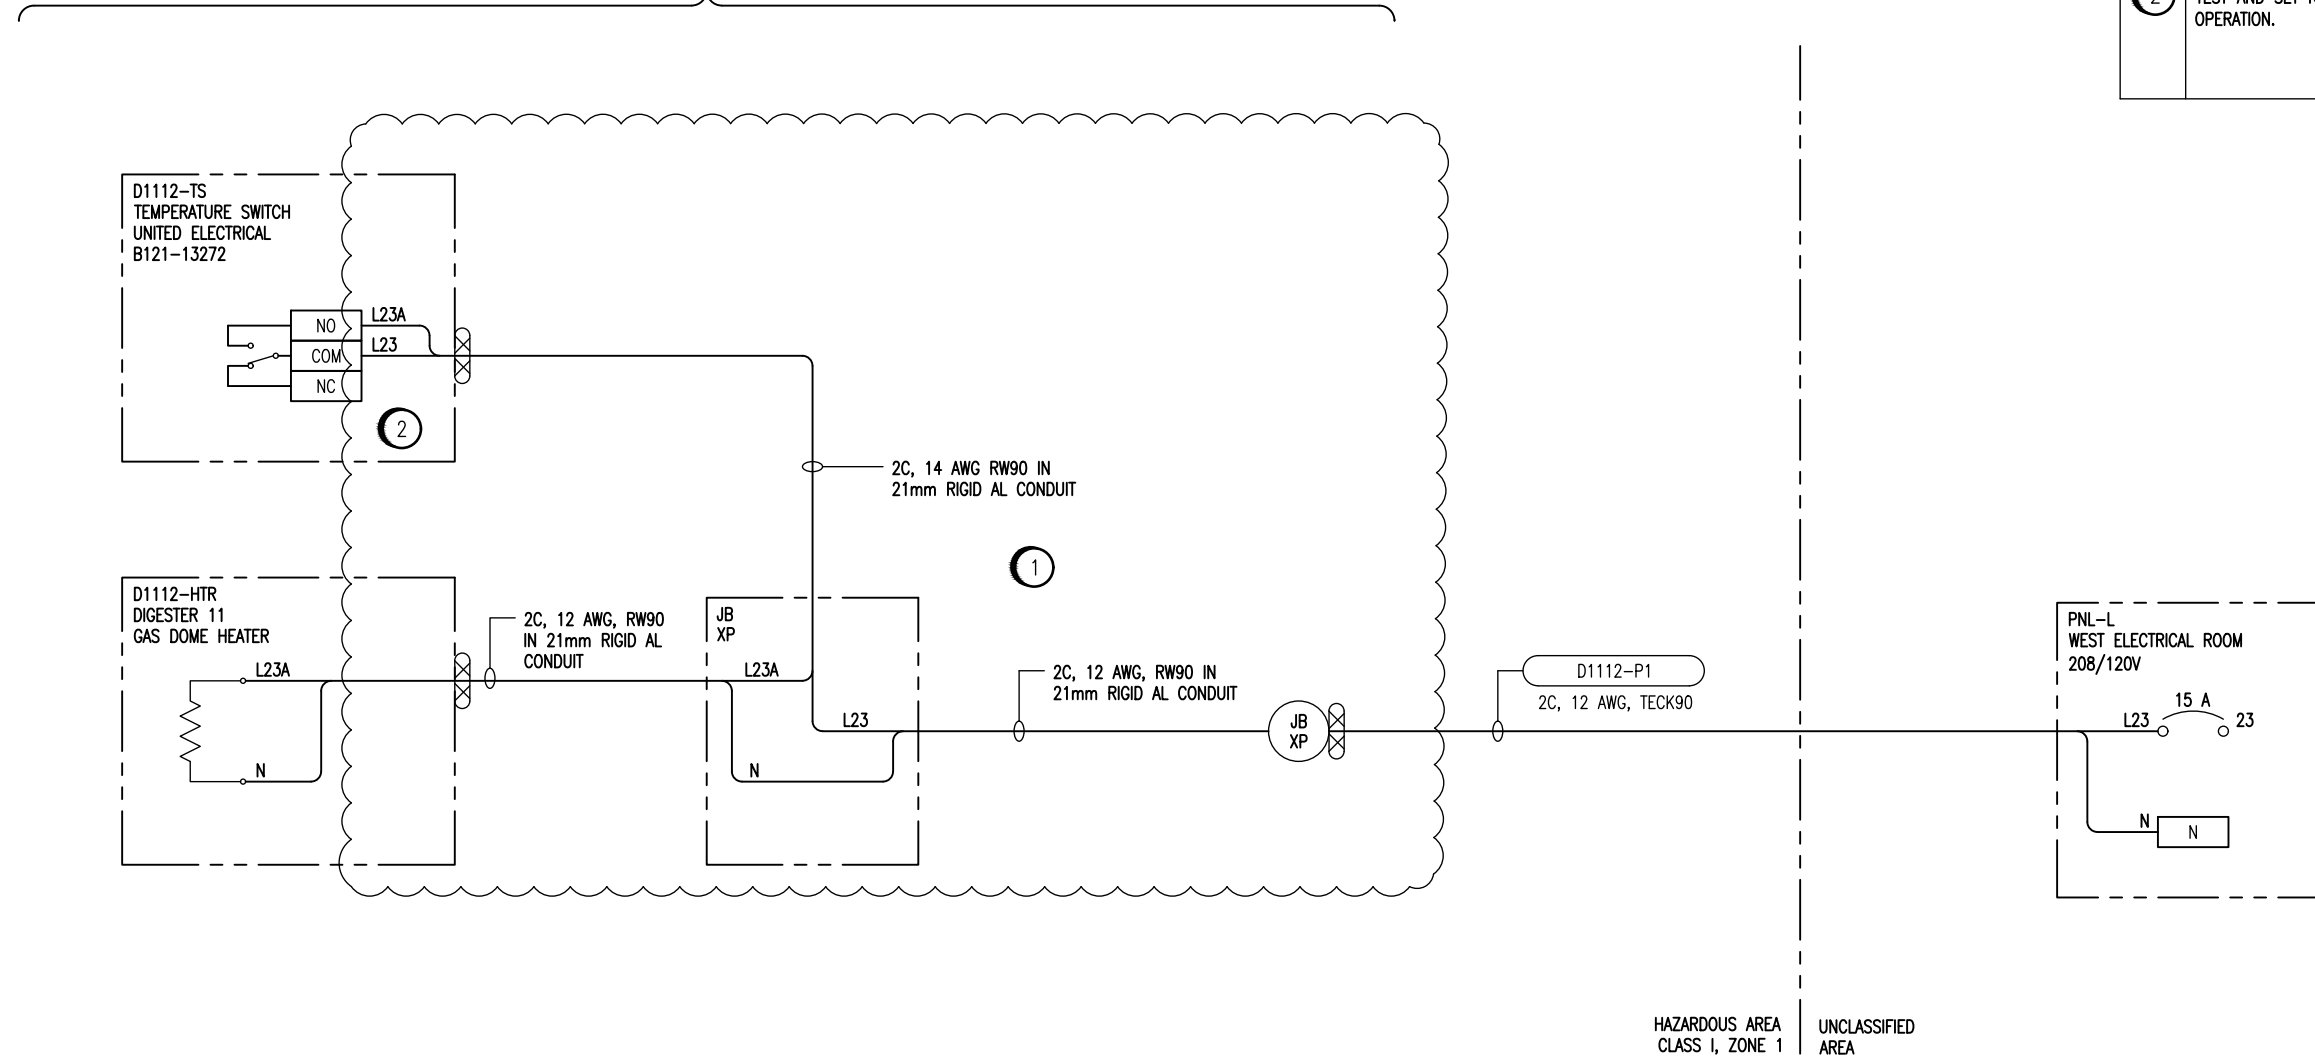

- CONSTRUCTION NOTES:
- 1 REPLACE EXISTING ELECTRICAL INSTALLATION FROM THE EXISTING TECK CABLE IN COMPLIANCE WITH HAZARDOUS LOCATION REQUIREMENTS. THE HEATER AND TEMPERATURE SWITCH MAY BE REUSED.
 - 2 TEST AND SET NO/NC CONTACT AS REQUIRED FOR HEATER OPERATION.

LEGEND

- HAZARDOUS RATED SEAL
- CLASS I, ZONE 1 RATED EXPLOSION-PROOF JUNCTION BOX

HAZARDOUS AREA CLASS I, ZONE 1 | UNCLASSIFIED AREA

NOTES:
1. THIS DRAWING DOES NOT DEPICT ALL JUNCTION BOXES.



| NO. | REVISIONS | DATE | DESIGN | CHECK |
|-----|-------------------------|------------|--------|-------|
| 00 | ISSUED FOR CONSTRUCTION | 2019-08-01 | CJR | CJR |

| | |
|----------------------------------|---------------------------|
| | |
| DESIGNED BY: C. REIMER | CHECKED BY: C. REIMER |
| DRAWN BY: S. FUNK | APPROVED BY: C. REIMER |
| SCALE: NTS | DATE: 2019-05-25 |
| ISSUED FOR CONSTRUCTION | |
| BY: K. SCHIMKE | DATE: 2019-08-01 |
| BID OPPORTUNITY NO.: 630-2019 | |

ENGINEER'S SEAL

THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT

NORTH END SEWAGE TREATMENT PLANT
DIGESTERS
WIRING DIAGRAM
D1112-HTR
DIGESTER 11 DOME HEATER

| | | | |
|---------------------|-------|------|------|
| CITY DRAWING NUMBER | SHEET | REV. | SIZE |
| 1-0101D-E0027 | 001 | 00 | B |