


B SIZE - 279mm x 432mm

File Name: \\192.168.0.228\y-doria\Projects\2019\19-0107-002\Elec\19-0107-002\_E22.dwg - Tab: E22 Plotted By: aguse 07/12/2019 [Fri 1:13pm]

XFMR-F70

CP-F80

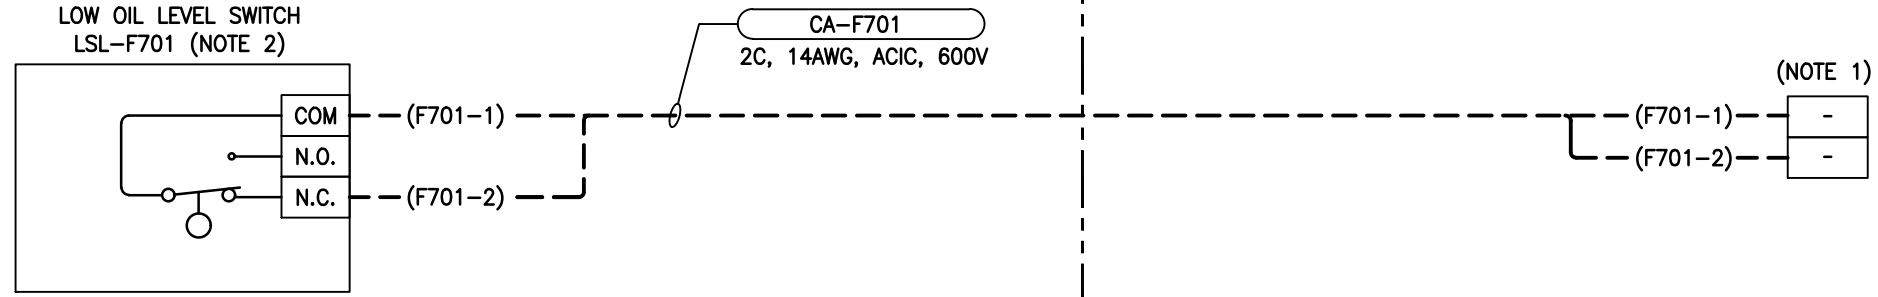

**NOTES:**

1. CONTRACTOR SHALL LEAVE CABLE COILED ON CABLE TRAY IN ELECTRICAL ROOM FOR FUTURE TERMINATION TO THE RTU.
2. LEVEL SWITCH CONTACT TO BE OPEN WHEN OIL LEVEL IS NORMAL AND CLOSED UPON A LOW OIL LEVEL.

**LEGEND:**

- FIELD WIRING
- MANUFACTURER WIRING


**ENGINEERS  
GEOSCIENTISTS  
MANITOBA**

**Certificate of Authorization**

**KGS Group**

**No. 245**

<b>KGS GROUP   CONSULTING ENGINEERS</b>					ENGINEER'S SEAL	
DESIGNED BY: L. UPPAL		CHECKED BY: J. BOUCHARD				
DRAWN BY: J. deLEON		APPROVED BY: J. BOUCHARD				
SCALE: AS NOTED		DATE: 2019/07/12				
RELEASED FOR CONSTRUCTION BY: _____ DATE: _____						
CONSULTANT NO.:		19-0107-002_22				
00	ISSUED FOR TENDER AND CONSTRUCTION	2019/07/12	LU	JAB		
NO.	REVISIONS	DATE	DESIGN	CHECK		

 **THE CITY OF WINNIPEG**  
WATER AND WASTE DEPARTMENT

**CLIFTON FLOOD PUMPING STATION UPGRADES**

**ELECTRICAL  
LOW OIL LEVEL LSL-F701  
LOOP DIAGRAM**

CITY DRAWING NUMBER <b>1-0125F-E0028-001</b>	SHEET	REV. <b>00</b>	SIZE <b>B</b>
---	-------	-------------------	------------------