


B SIZE - 279mm x 432mm

File Name: \\192.168.0.226\y-dalia\Projects\2019\19-0107-002\Elec\19-0107-002_E23.dwg - Tab: E23 Plotted By: aguse 07/12/2019 [Fri 1:13pm]

XFMR-F70

CP-F80

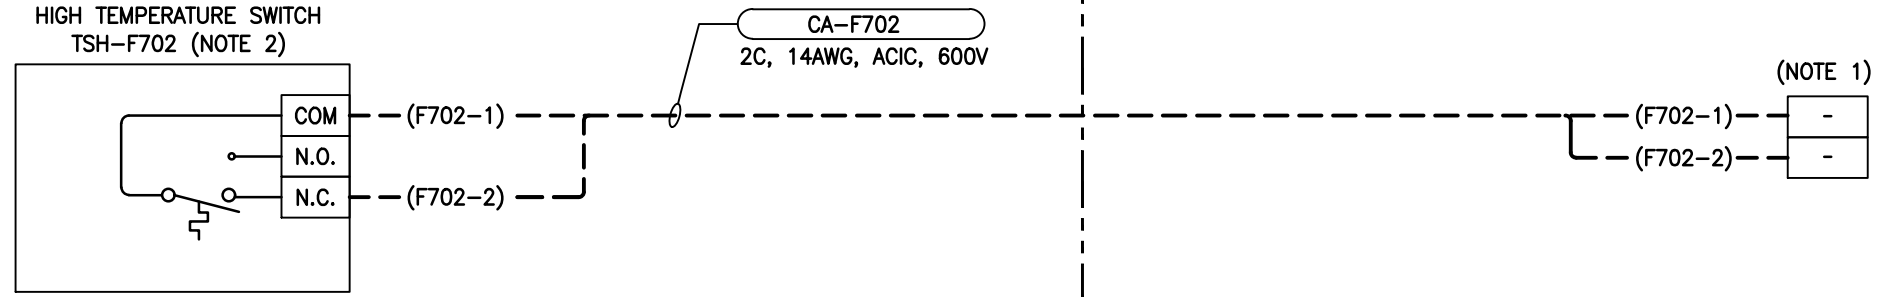

NOTES:

1. CONTRACTOR SHALL LEAVE CABLE COILED ON CABLE TRAY IN ELECTRICAL ROOM FOR FUTURE TERMINATION TO THE RTU.
2. TEMPERATURE SETPOINT AS PER MANUFACTURER'S RECOMMENDATION. TEMPERATURE SWITCH CONTACT TO BE OPEN WHEN TEMPERATURE IS NORMAL AND CLOSED WHEN TEMPERATURE IS ABOVE SETPOINT.

LEGEND:

- FIELD WIRING
- MANUFACTURER WIRING


**ENGINEERS
GEOSCIENTISTS
MANITOBA**

Certificate of Authorization

KGS Group

No. 245

KGS GROUP CONSULTING ENGINEERS					ENGINEER'S SEAL	
					DESIGNED BY: L. UPPAL	CHECKED BY: J. BOUCHARD
					DRAWN BY: J. deLEON	APPROVED BY: J. BOUCHARD
					SCALE: AS NOTED	DATE: 2019/07/12
					RELEASED FOR CONSTRUCTION BY: _____ DATE: _____	
					CONSULTANT NO.: 19-0107-002_E23	
00	ISSUED FOR TENDER AND CONSTRUCTION	2019/07/12	LU	JAB		
NO.	REVISIONS	DATE	DESIGN	CHECK		

 **THE CITY OF WINNIPEG**
WATER AND WASTE DEPARTMENT

CLIFTON FLOOD PUMPING STATION UPGRADES

**ELECTRICAL
HIGH TEMPERATURE SWITCH TSH-702
LOOP DIAGRAM**

CITY DRAWING NUMBER 1-0125F-E0029-001	SHEET	REV. 00	SIZE B
---	-------	-------------------	------------------