




KEY NOTES



- CONNECT NEW HRU PROVIDED BY MECHANICAL. REFER TO SINGLE LINE DIAGRAM AND MOTOR SCHEDULE ON DRAWING E3.1 FOR FURTHER DETAILS.
- PROVIDE NEW PEDESTAL MOUNTED CLASS A GFCI 5-20R RECEPTACLE ON ROOF TOP. INSTALL AS PER CEC 26-704. PROVIDE A NEW 20A-1P BREAKER IN EXISTING PANEL AS SHOWN. NEW BREAKER TO MATCH EXISTING IN ALL RESPECTS. WIRE AND CONNECT WITH 2 #10 RW90 IN CONDUIT.
- PROVIDE AND INSTALL NEW BREAKERS TO EXISTING CDP-RS FOR NEW HRU-9, HRU-10 AND HRU-11. BREAKERS TO MATCH EXISTING IN ALL RESPECTS. REFER TO DRAWING E1.3 FOR CDP-RS LOCATION.

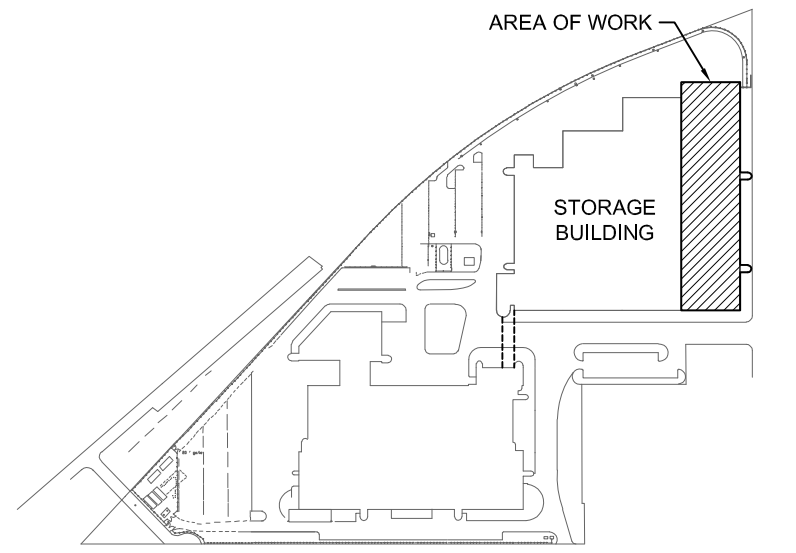

GENERAL NOTES

- ELECTRICAL SUBCONTRACTOR SHALL BE RESPONSIBLE FOR COORDINATING EXACT LAYOUT, ROUTING, ETC. VERIFY EXISTING SERVICES ON SITE.
- ELECTRICAL SUBCONTRACTOR SHALL ENSURE COORDINATION BETWEEN ALL TRADES AND CONTRACT ADMINISTRATOR, ON AND OFF SITE, AS REQUIRED FOR INSTALLATION OF ELECTRICAL EQUIPMENT.
- PROVIDE LIQUID TIGHT CONNECTORS ON ALL OUTDOOR CONDUITS.
- FINAL CONNECTIONS TO EQUIPMENT AND INTER-CONNECTIONS BETWEEN EQUIPMENT WHERE NECESSARY ARE TO BE MADE BY ELECTRICAL SUBCONTRACTOR.
- CONFIRM ALL EQUIPMENT CONNECTIONS AND ELECTRICAL REQUIREMENTS WITH EQUIPMENT SUPPLIER PRIOR TO ROUGH-IN. MAKE ADJUSTMENTS AND INSTALL AS PER SUPPLIER'S REQUIREMENTS AT NO ADDITIONAL CHARGE.
- THIS BUILDING MAY CONTAIN ASBESTOS. REFER TO FRONT END SPECIFICATIONS FOR FURTHER INFORMATION.
- COORDINATE FINAL LOCATION OF ALL EQUIPMENT WITH MECHANICAL.
- ELECTRICAL SUBCONTRACTOR TO VISIT SITE DURING BID AND VERIFY ALL EXISTING SERVICES ON SITE PRIOR TO SUBMITTING BID. REPORT ANY DISCREPANCIES TO CONTRACT ADMINISTRATOR DURING BID PERIOD.
- COORDINATE WITH THE CITY PRIOR TO SHUT-DOWN OR REMOVAL OF EQUIPMENT.
- UPDATE LAMACOID LABELS AND PANEL DIRECTORIES FOR ALL EXISTING PANELS/MCC'S CDP'S AFFECTED BY THE SCOPE OF WORK (DEMOLITION AND NEW CONSTRUCTION).
- EMPLOY ROOFING SUBCONTRACTOR TO SEAL AROUND ALL NEW PENETRATIONS THROUGH ROOF.
- ELECTRICAL SUBCONTRACTOR TO PROVIDE CORE DRILLING FOR ALL REQUIRED PENETRATIONS. X-RAY SCAN PRIOR TO CORING. DO NOT CUT REBAR. PROVIDE FIRE STOPPING FOR PENETRATIONS THROUGH FIRE RATED WALLS.
- REMOVE ALL ABANDONED EQUIPMENT AND SERVICES WITHIN AREA OF WORK.
- FIRE STOP AROUND ALL NEW PENETRATIONS.

NO.	Description	VEK	BY	DDMMYY
0	ISSUED FOR CONSTRUCTION	VEK	16/01/20	

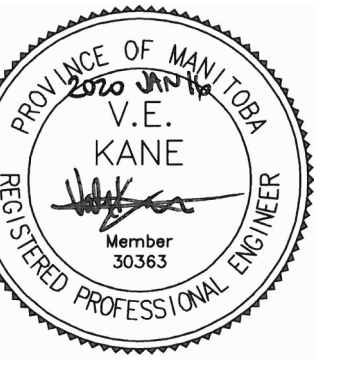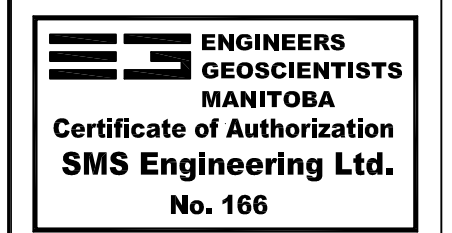

Project Title
**CITY OF WINNIPEG FORT ROUGE
 TRANSIT BASE - STORAGE
 TRACK 25-36 - MECHANICAL
 UPGRADE**
 WINNIPEG MANITOBA

Drawing Title
**ROOF PLAN -
 TRACK 25-36 -
 ELECTRICAL -
 NEW CONSTRUCTION**

Drawn By WPD	Checked By RD	Approved By GW
Scale AS NOTED	Date JANUARY, 2020	Project No. 19-332-02
Revision Number 0	Drawing Number E2.2	Sheet Order 5 OF 6

FILE NAME AND PATH: C:\PROJECTS\2019\19-332-FortRouge\Track 25-36-Mechanical Upgrades\03-Cad\Drawings\A-Electrical\E2.2-RA-1.dwg
 LAYOUT: E2.2 DATE PLOTTED: Monday, October 12, 2019 12:27:27 PM

1
 E2.2
 ROOF PLAN - TRACK 25-36 - ELECTRICAL - NEW CONSTRUCTION (GRID LINES A-P)
 SCALE: 1/16" = 1'-0"

2
 E2.2
 ROOF PLAN - TRACK 25-36 - ELECTRICAL - NEW CONSTRUCTION (GRID LINES P-AA)
 SCALE: 1/16" = 1'-0"