

Annexe B – Photos de la propriété

















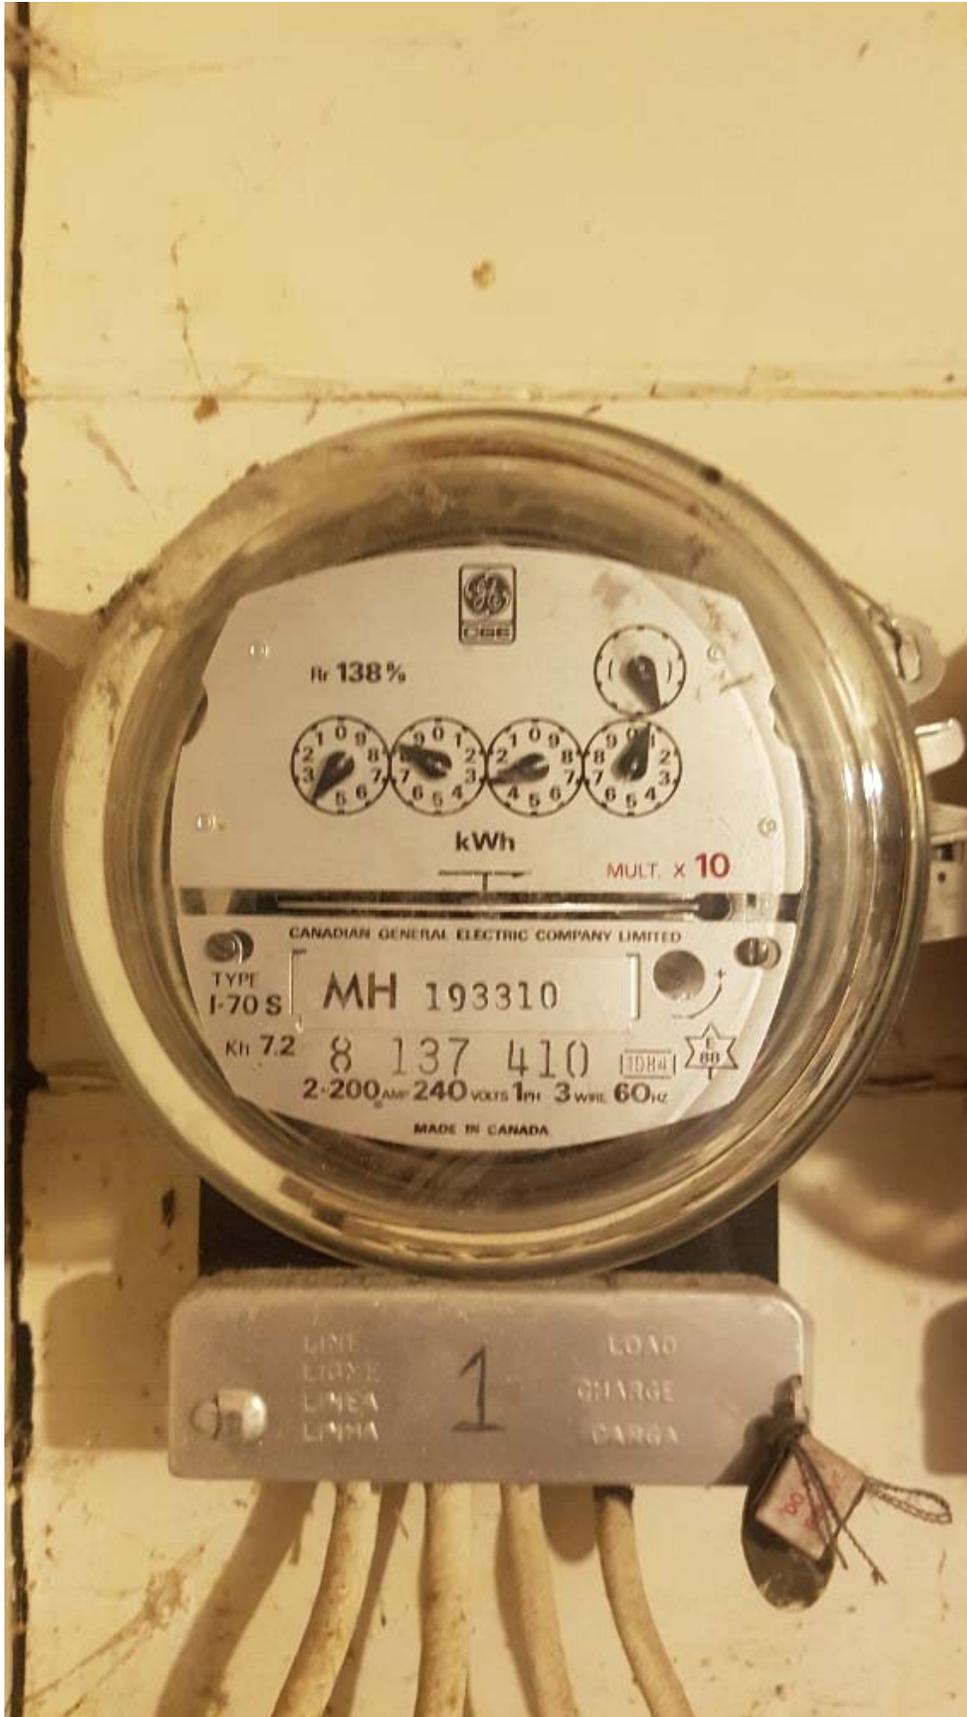

Nr 138%



kWh

MULT. X 10

CANADIAN GENERAL ELECTRIC COMPANY LIMITED

TYPE I-70S

MH 193310

Kh 7.2

8 137 410



2-200 AMP 240 VOLTS 1PH 3 WIRE 60 HZ


MADE IN CANADA

LINE
LINEA

1

LOAD
CARGA



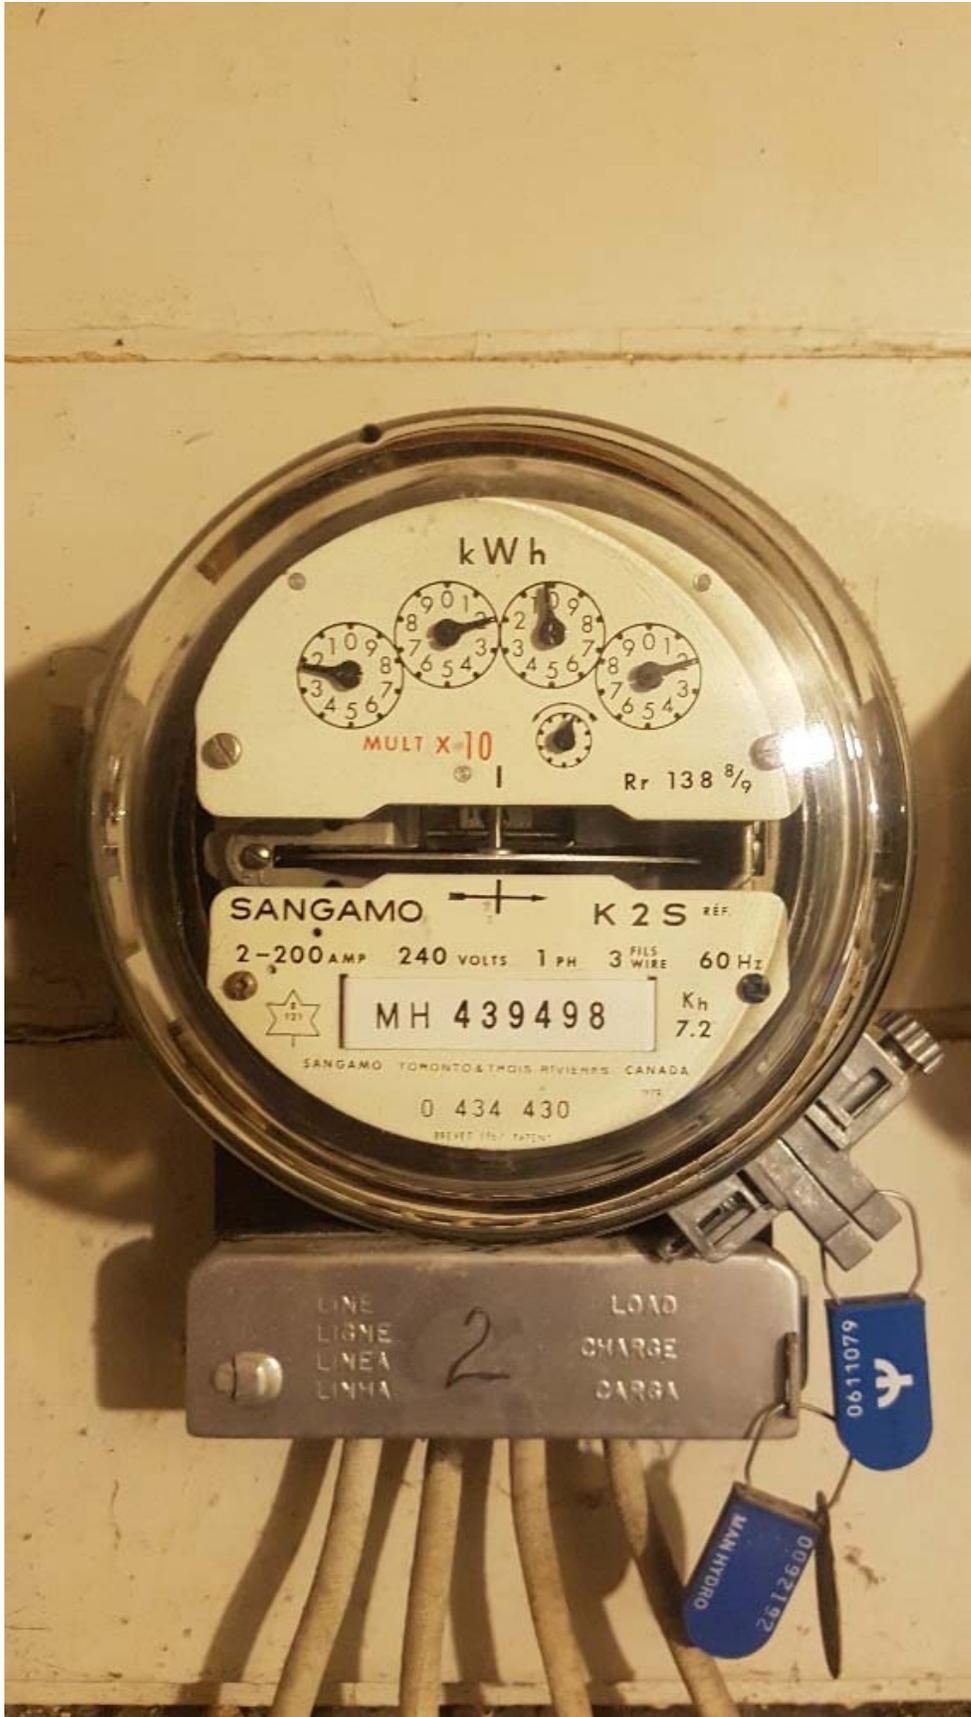

kWh



MULT X-10

Rr 138 8/9

SANGAMO K2S RÉF.

2-200 AMP 240 VOLTS 1 PH 3 WIRE 60 Hz

MH 439498

Kh 7.2


SANGAMO TORONTO & TROIS RIVIÈRES CANADA

0 434 430

LINE LIGNE LINEA LINHA 2 LOAD CHARGE CARGA

0611079

MANHYDRO 0092192

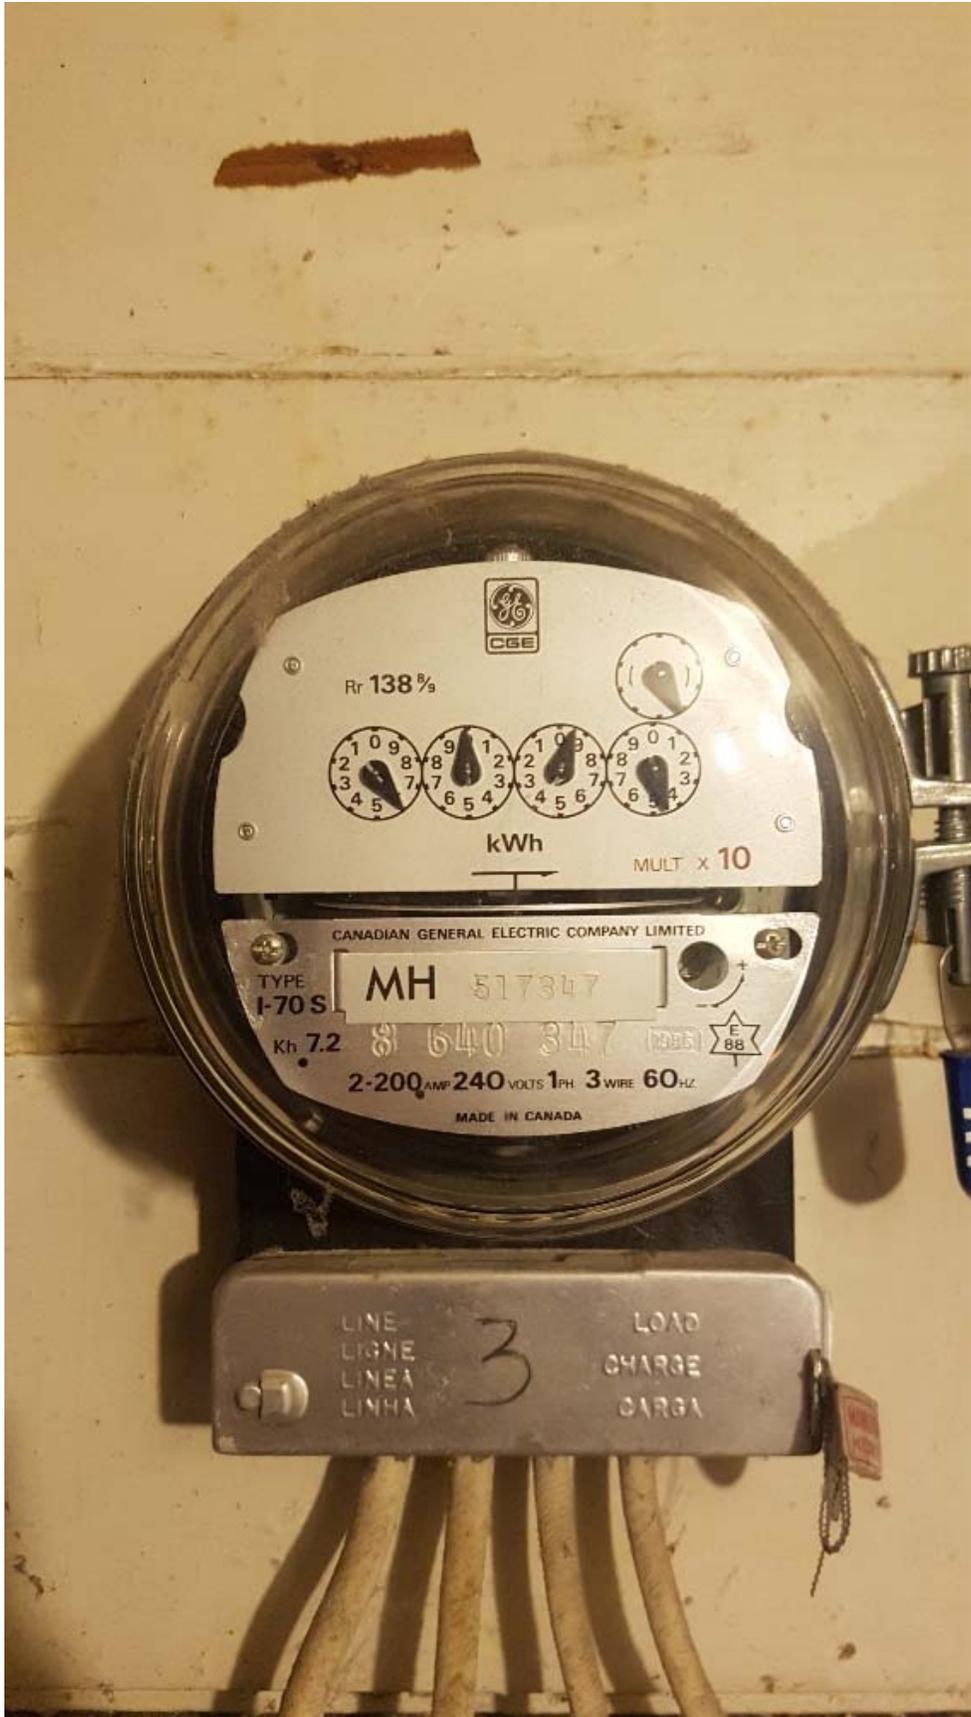

Rr 138 ⁸/₉



kWh MULT x 10

CANADIAN GENERAL ELECTRIC COMPANY LIMITED

TYPE I-70 S

MH 517347

Kh 7.2

8 640 347 (E 88)


2-200 AMP 240 VOLTS 1 PH 3 WIRE 60 HZ

MADE IN CANADA

LINE
LIGNE
LINEA
LINHA

3

LOAD
CARGA
CARGA

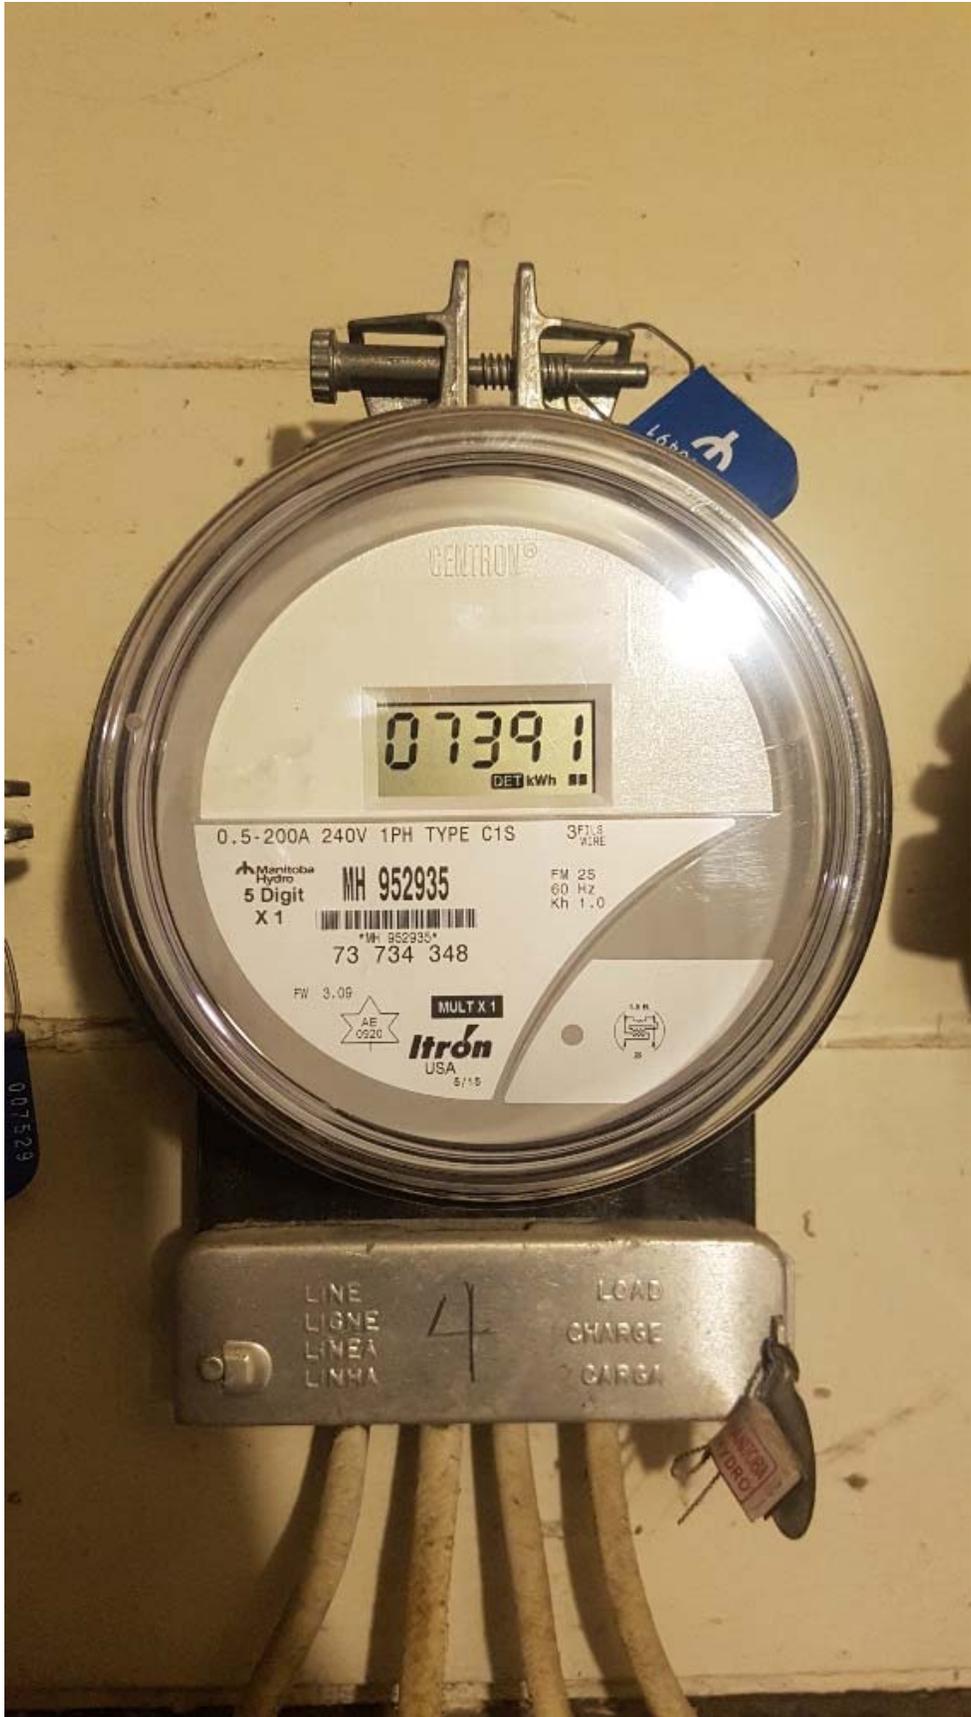

CENTRON®

07391
kWh

0.5-200A 240V 1PH TYPE C1S 3E1.5 WIRE

Manitoba Hydro
5 Digit
X 1

MH 952935

FM 25
60 HZ
Kh 1.0

73 734 348

FW 3.09

MULT X 1



Itron
USA




LINE
LIGNE
LINEA
LINHA

4

LOAD
CHARGE
CARGA

MANITоба
HYDRO

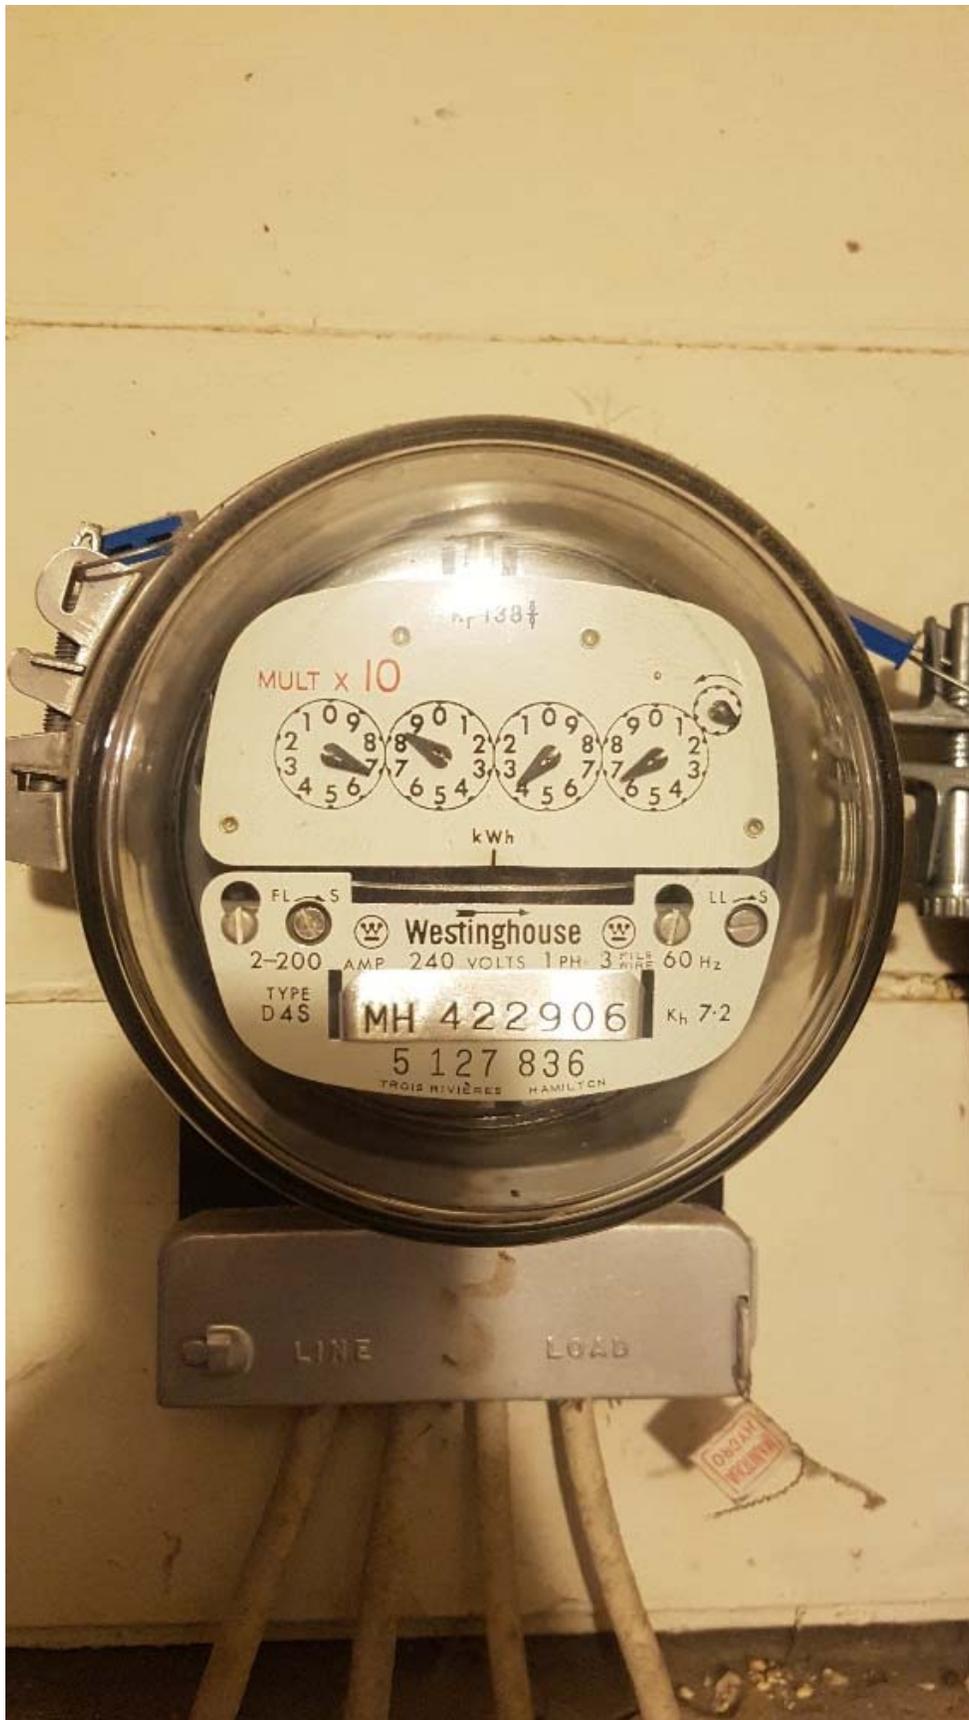

nr 138†

MULT x 10



kWh

FL 5 LL 5

Westinghouse

2-200 AMP 240 VOLTS 1 PH 3 WIRE 60 HZ

TYPE D4S

MH 422906

Kh 7.2


5 127 836


TROIS RIVIERES HAMILTON

LINE

LOAD


DANGER

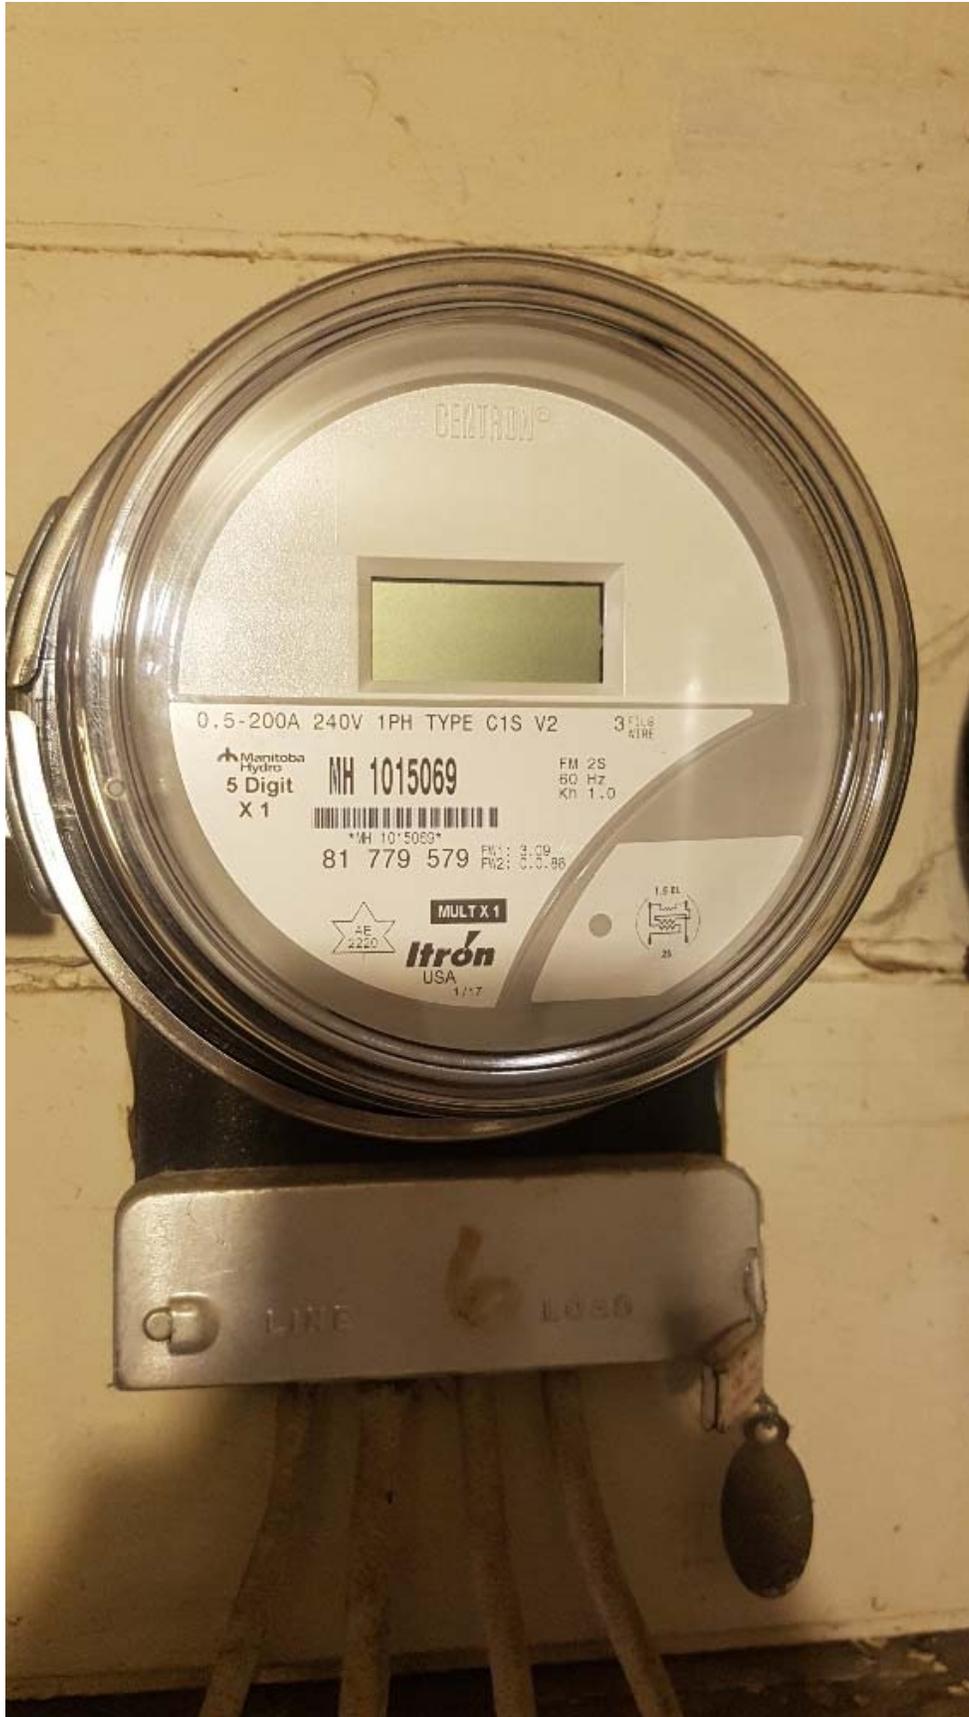

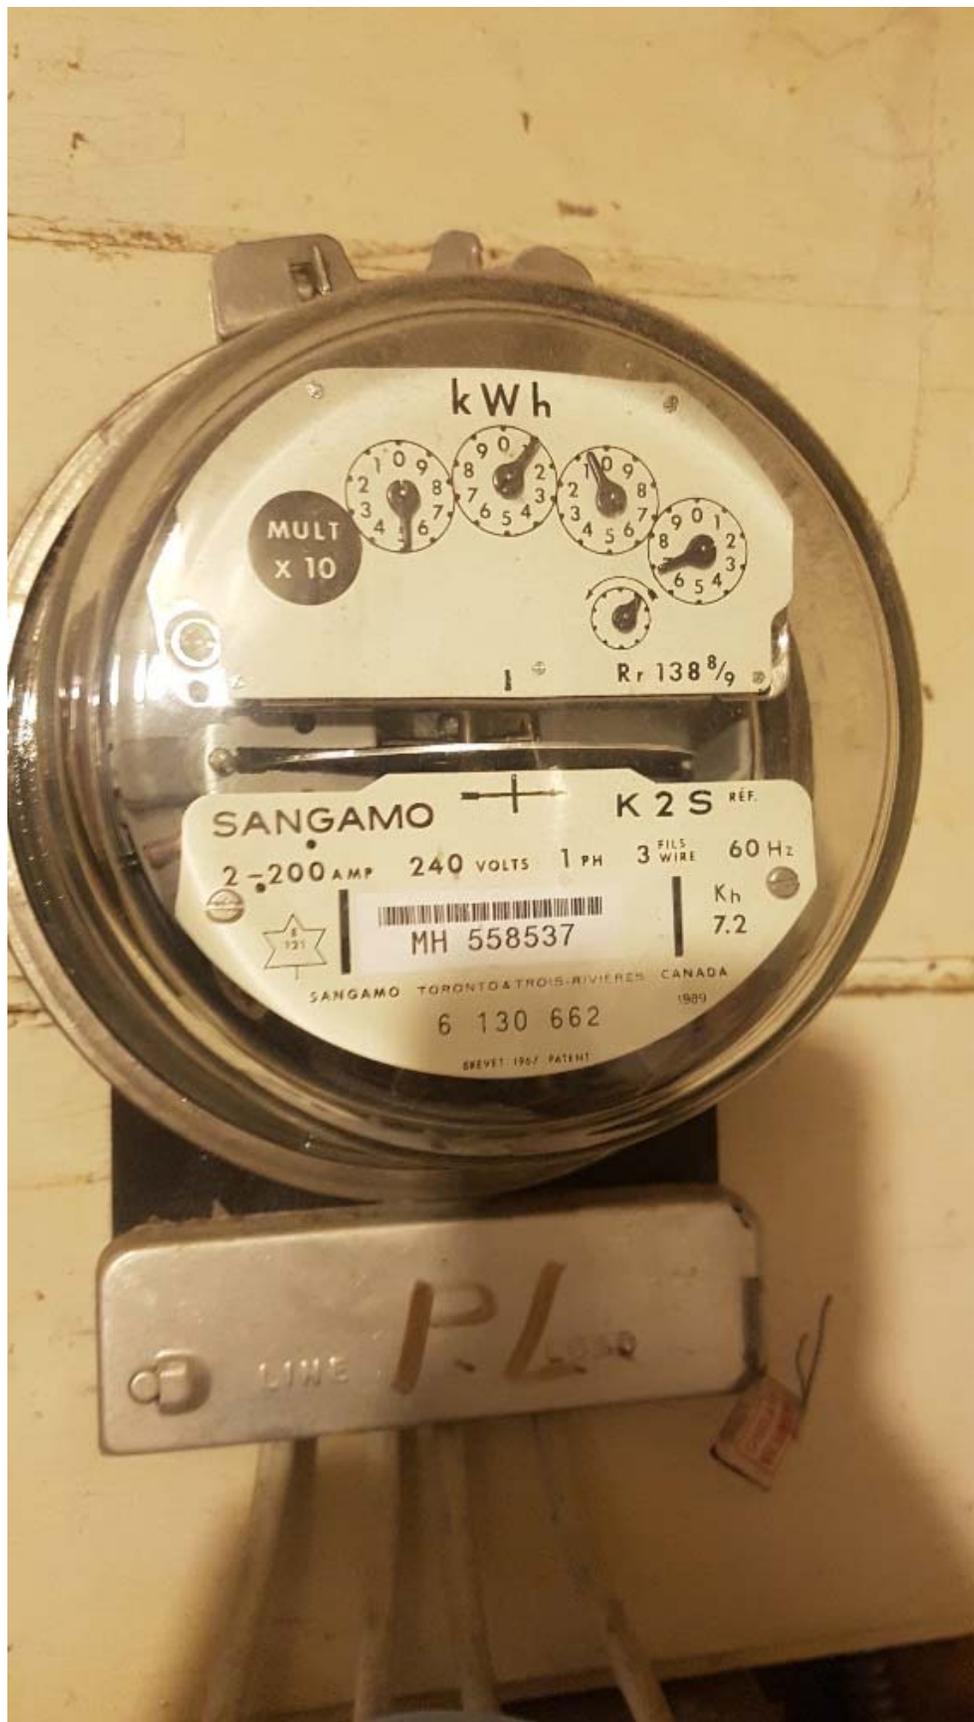

kWh

MULT
x 10

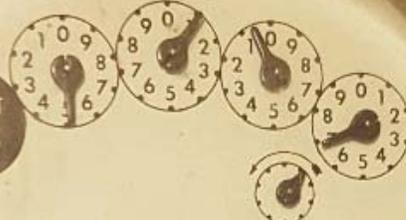

Rr 138 8/9

SANGAMO

K 2 S REF.

2-200 AMP 240 VOLTS 1 PH 3 WIRE 60 Hz



MH 558537

Kh
7.2

SANGAMO TORONTO & TROIS-RIVIERES CANADA

6 130 662

BREVET 1907 PATENT


LINE P.L.









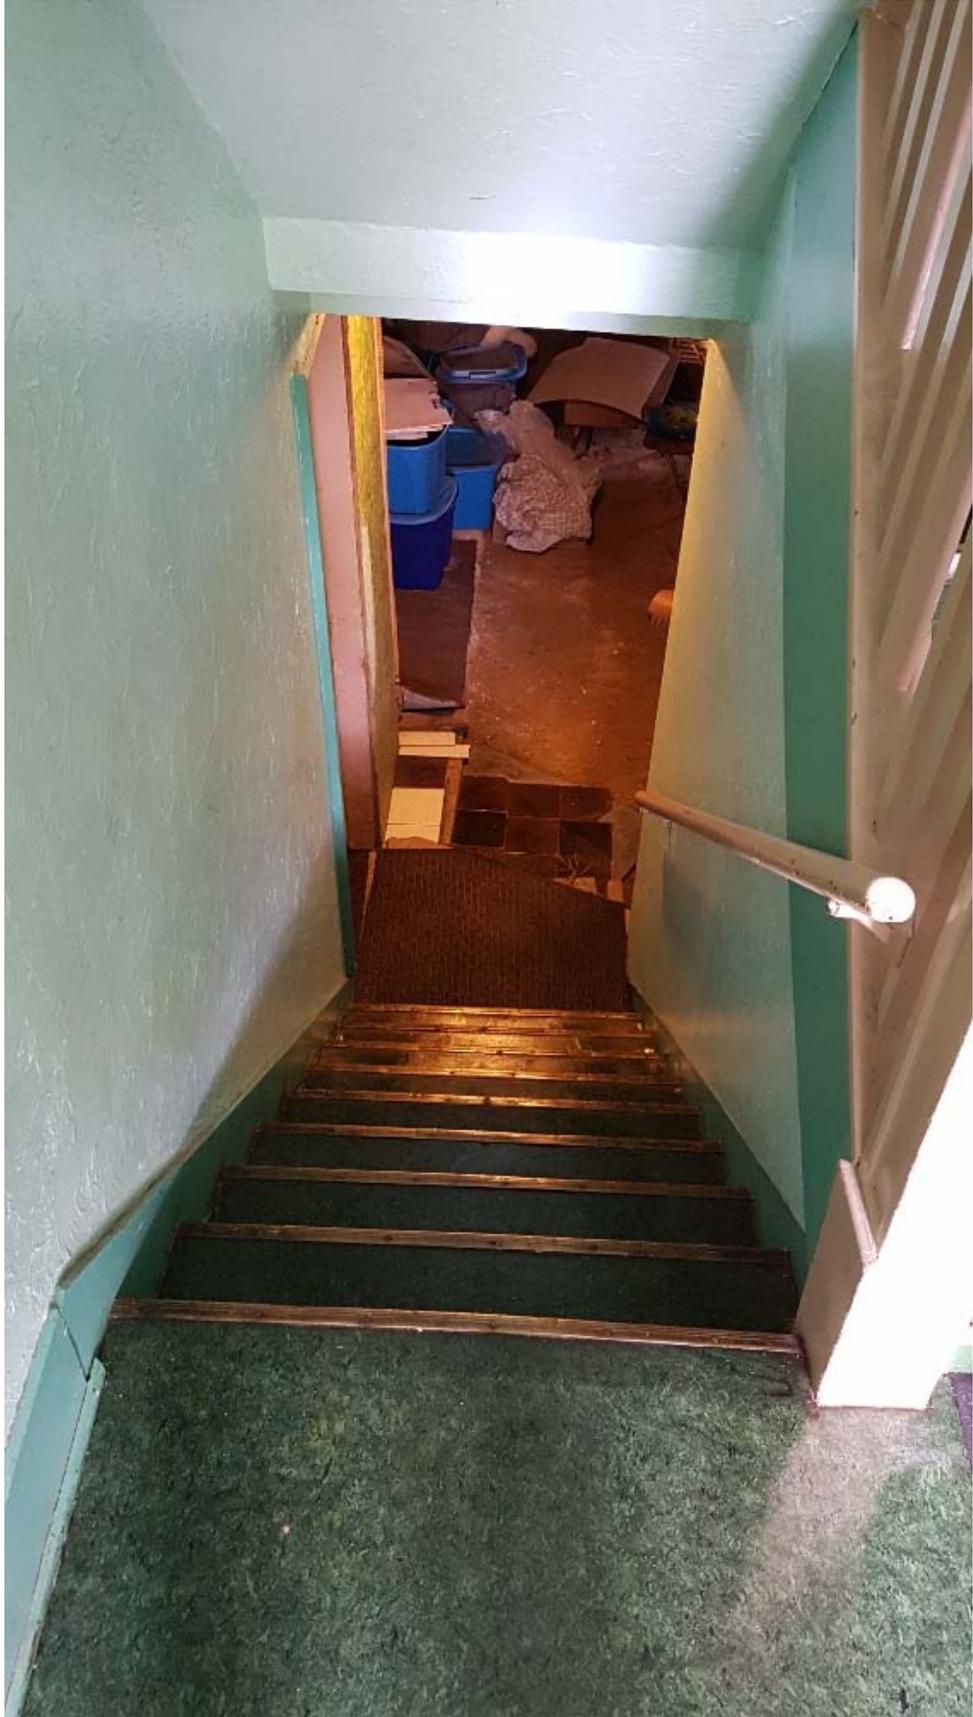













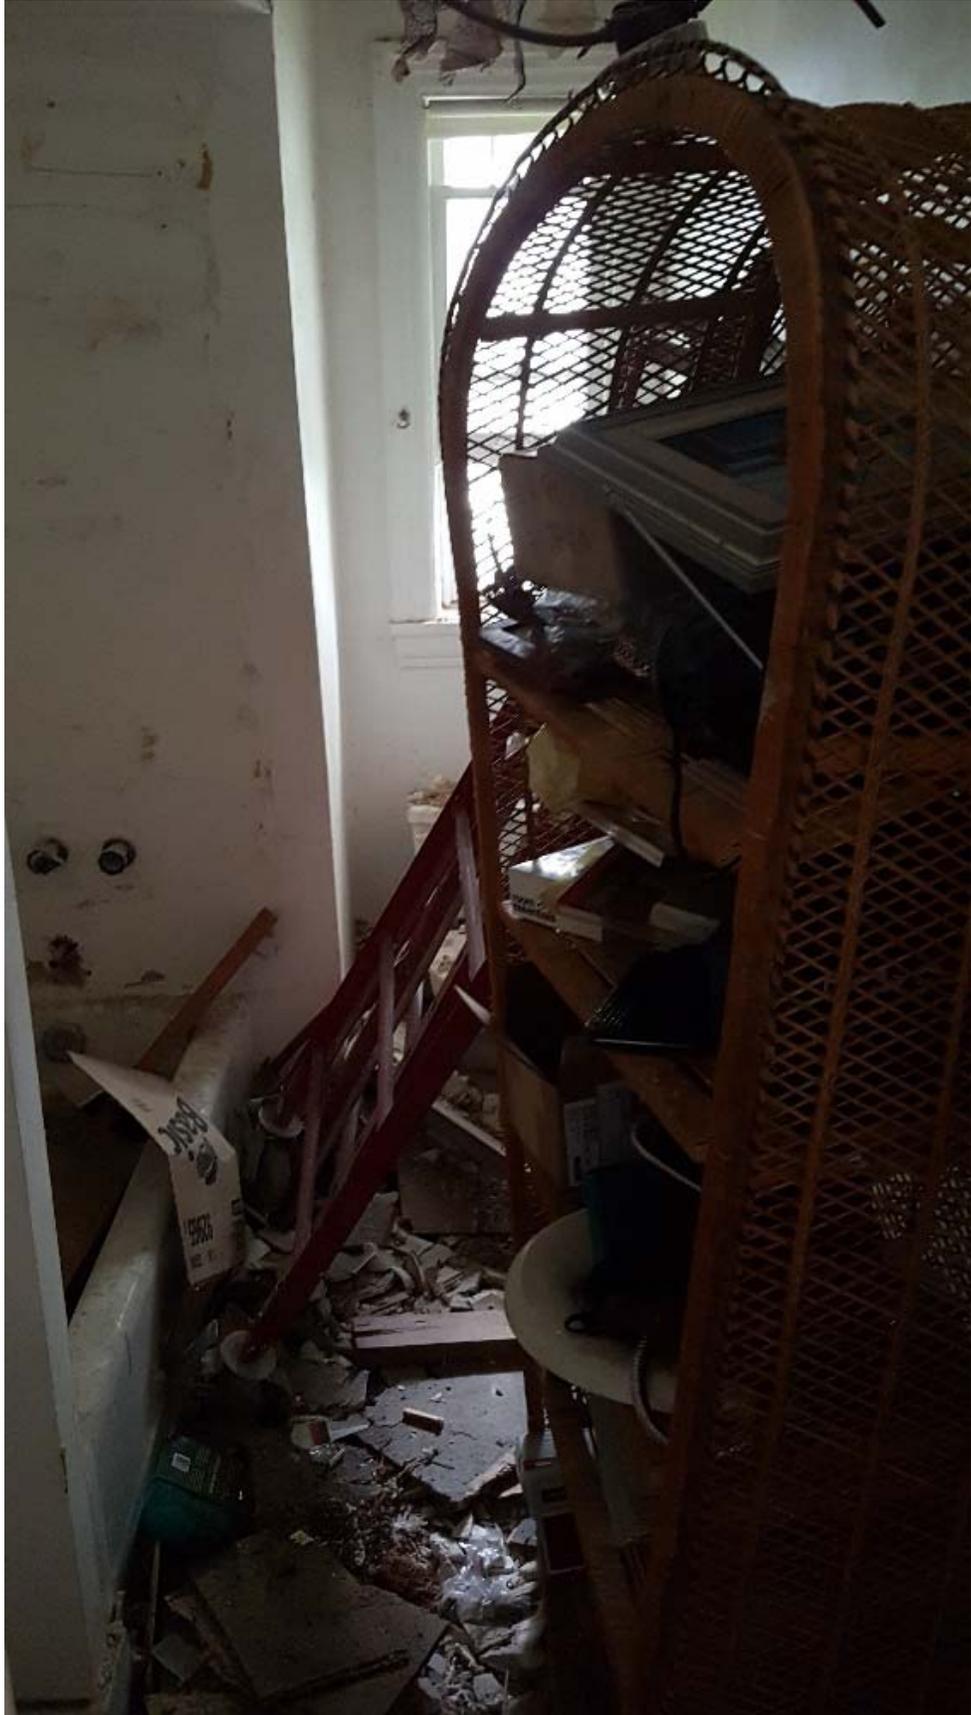









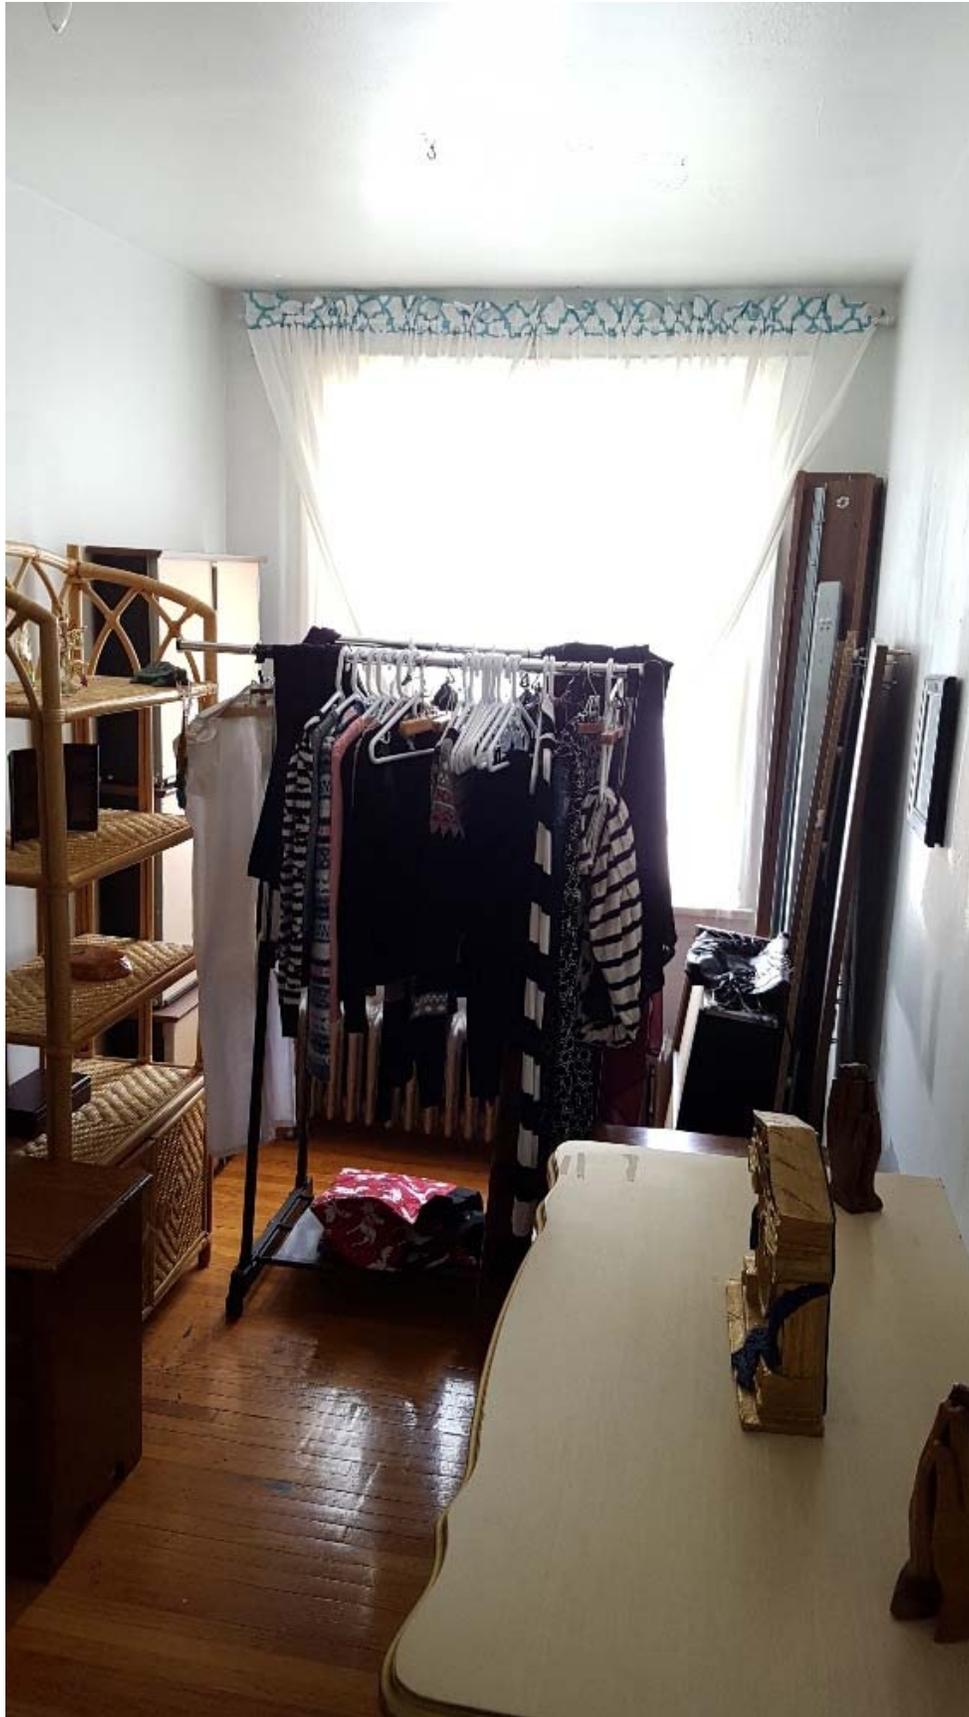




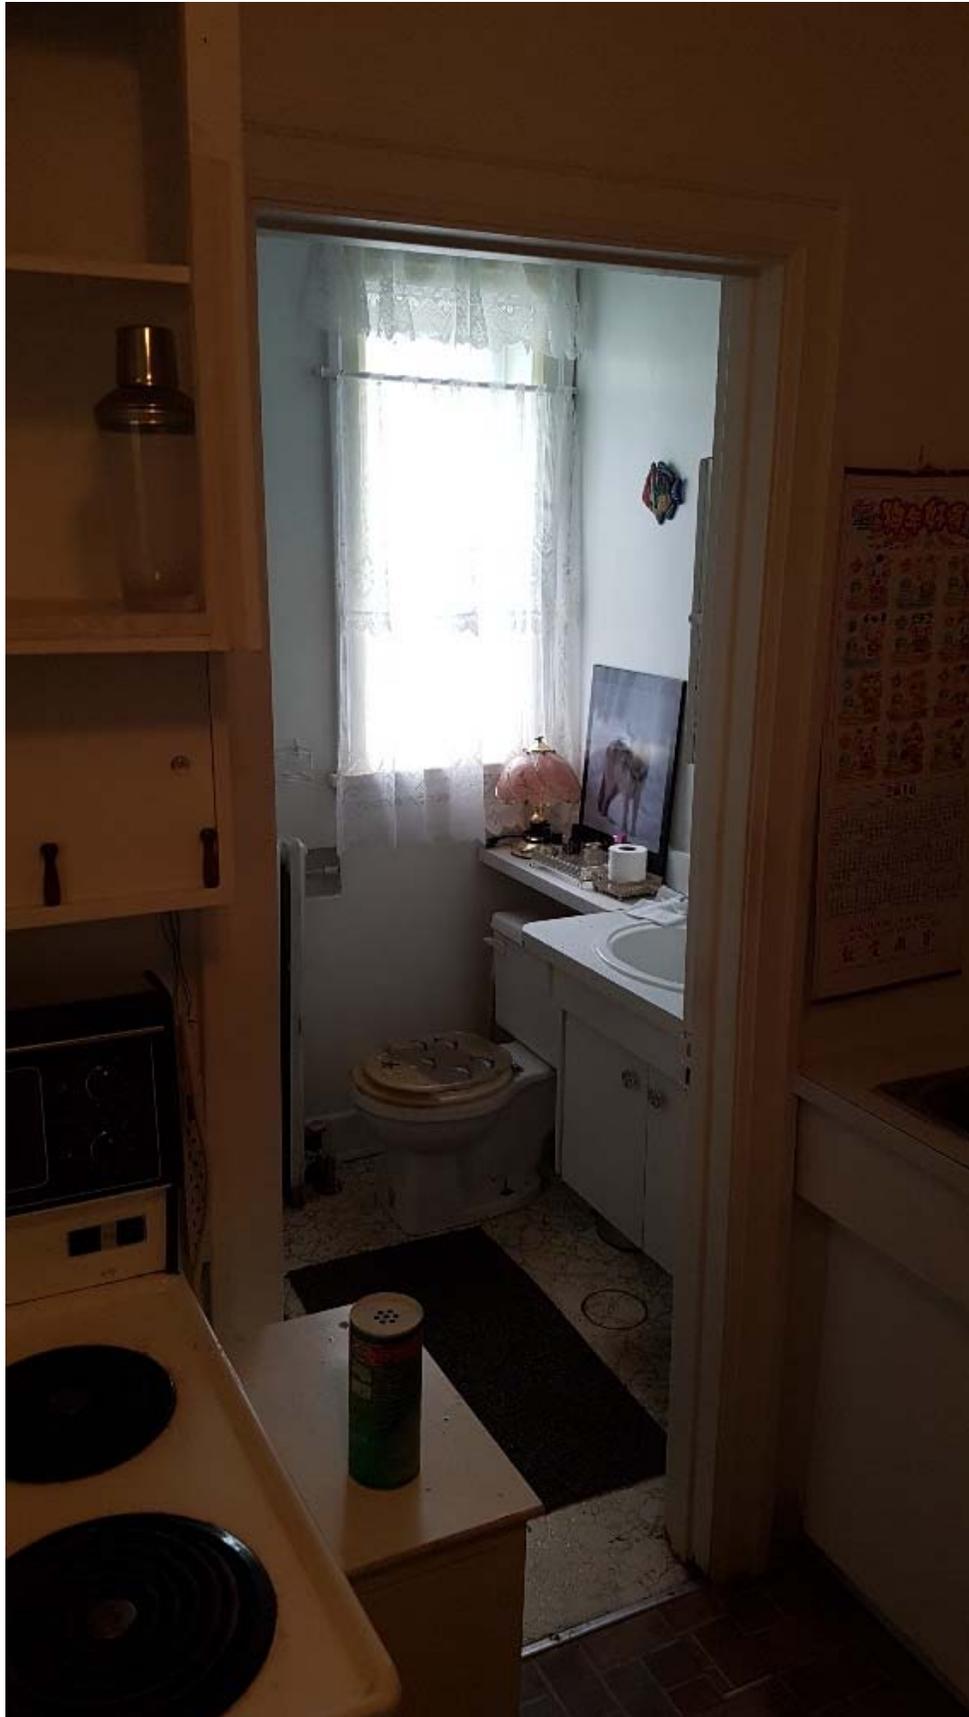

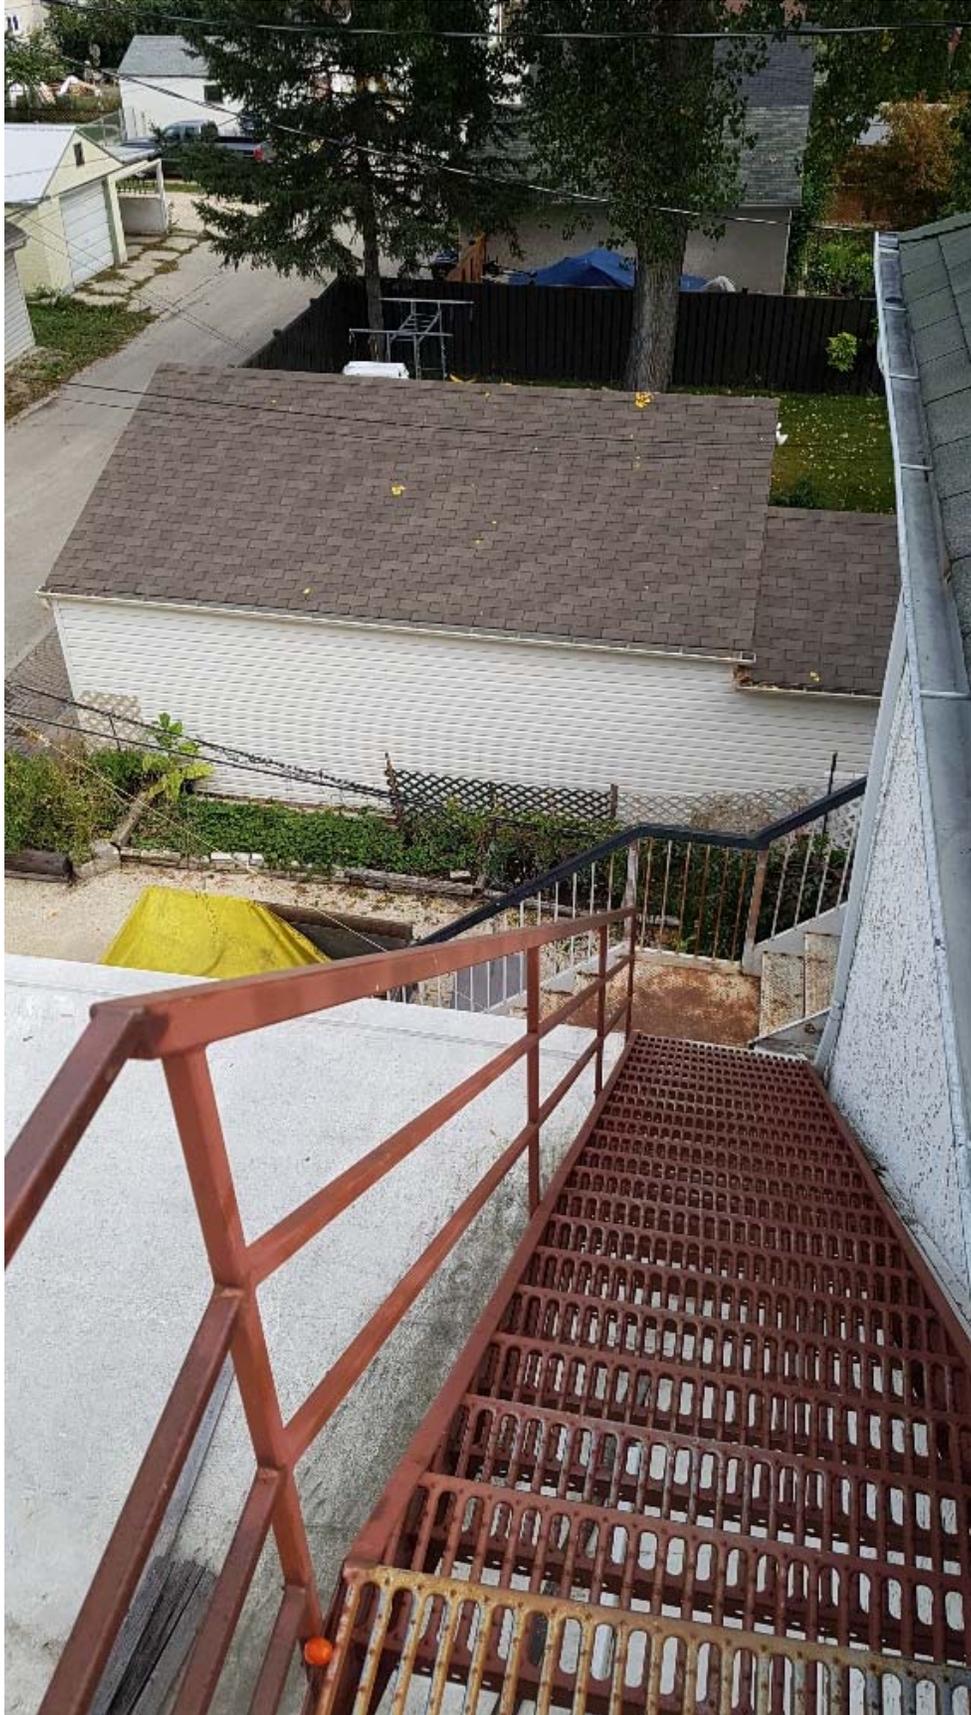



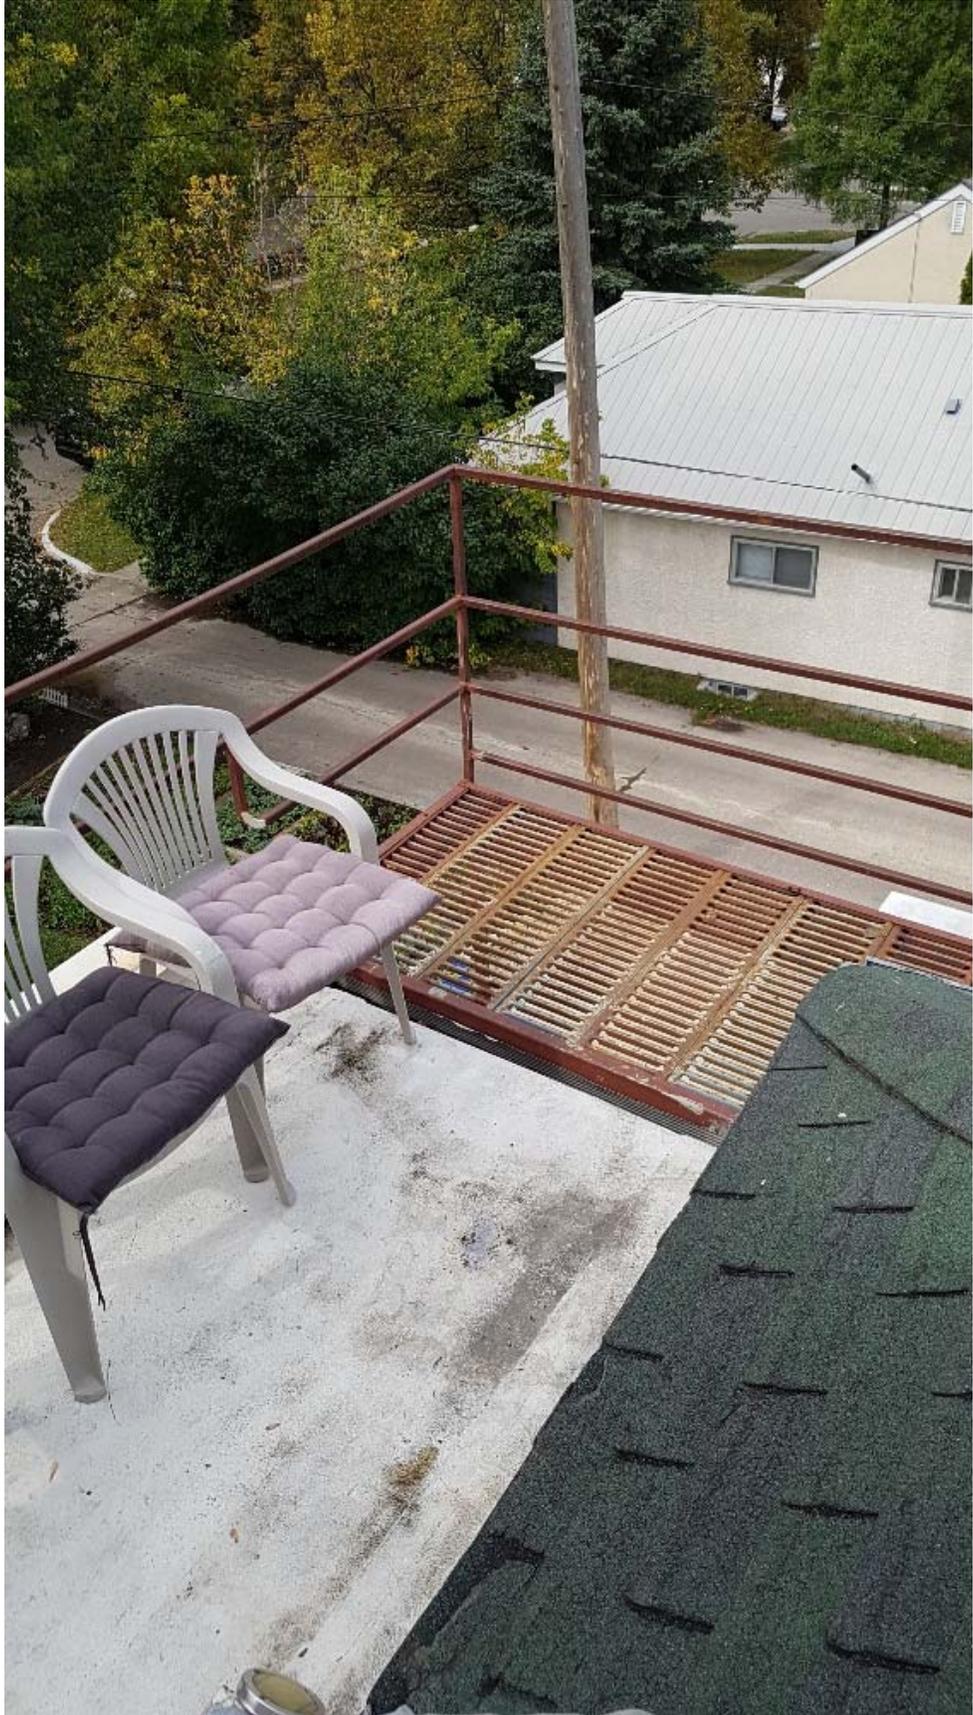
















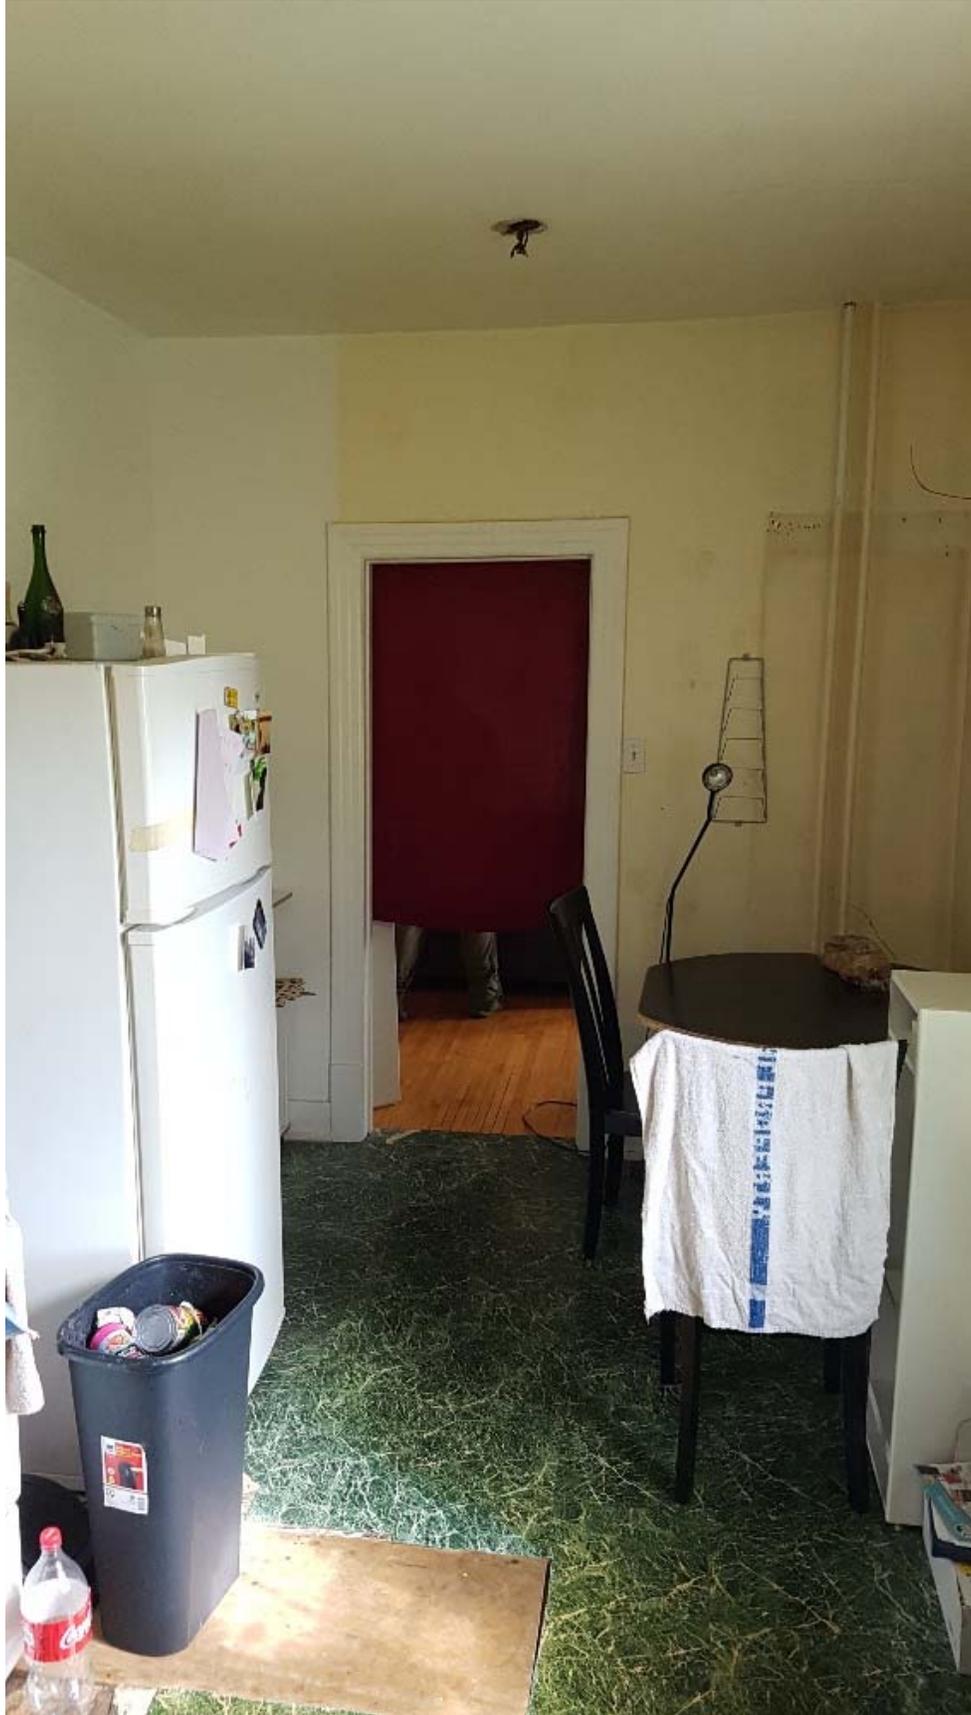



 Manitoba
Hydro

268721

AL 225 R 5 PSI MAOP



180 CU. FT. PER HR. AIR
111 CU. FT. PER REV.
TEMP. COMP. CU. FT. AT 60°F.

CANADIAN METER
COMPANY INC.

89-509721











