





GENERAL NOTES

- A. PROVIDE NEW TYPEWRITTEN PANEL DIRECTORIES TO ACCOMMODATE UPDATED CIRCUITING. NEW BREAKERS IN DISTRIBUTION PANELS SHALL BE LABELLED USING LAMACOIDS.
- B. WHERE BRANCH CIRCUIT BREAKERS ARE REMOVED, PROVIDE FILLER PLATES FOR BREAKER SPACES.
- C. CIRCUIT BREAKERS SHALL MATCH EXISTING. CONFIRM SHORT CIRCUIT RATING AND TYPE ON SITE, PRIOR TO FINALIZING PRICING.
- D. UTILIZE SPARE/FREED UP CIRCUITS FROM DEMOLITION AS REQUIRED TO ACCOMMODATE THE ADDITIONAL CIRCUITING REQUIREMENTS IN THE RENOVATION.
- E. FOR ALL STRUCTURED WIRING OUTLETS, PROVIDE NUMER OF JACKS AS INDICATED AND THE CORRESPONDING NUMBER OF CABLES IN CONDUIT STUB INTO CEILING SPACE, THEN HOME RUN TO THE DATA RACK. TERMINATE CABLES IN PATCH PANELS AND IN JACKS AT OUTLET LOCATIONS.

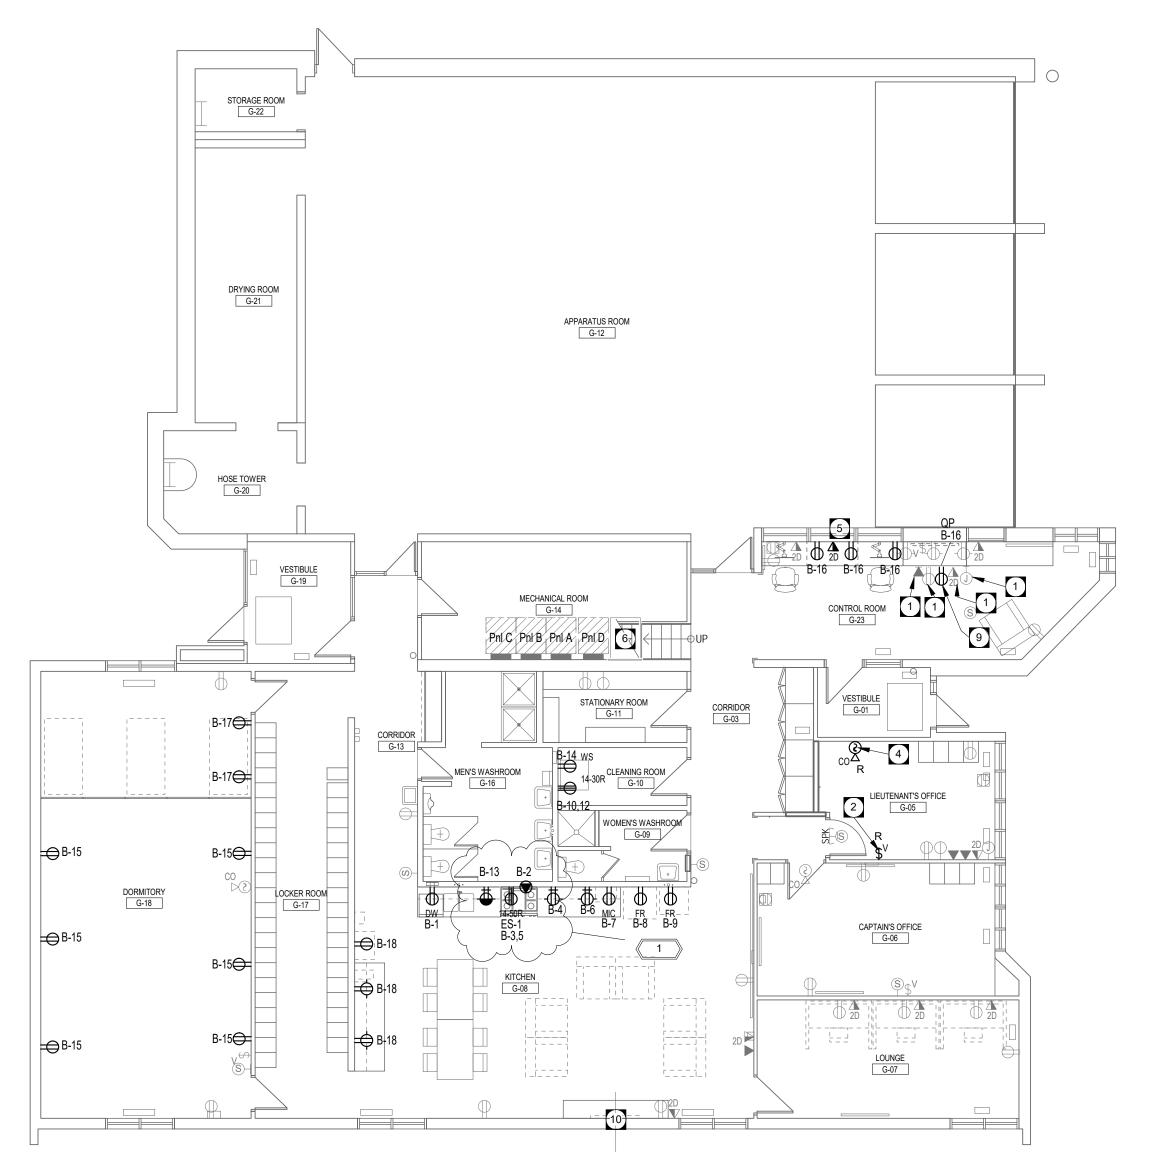

2 MAIN FLOOR PLAN - POWER & SYSTEMS EP2.1-R1SCALE: 1/8" = 1'-0"

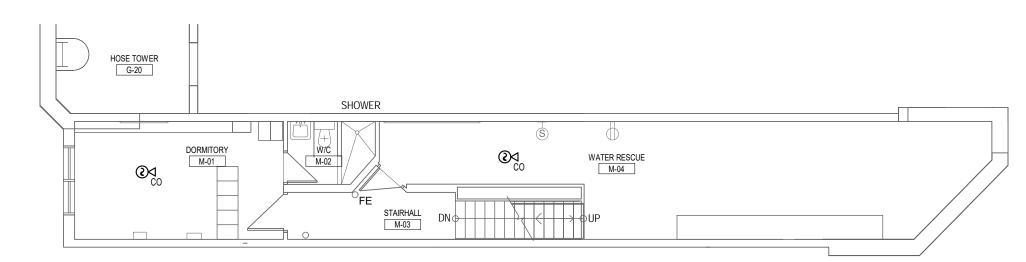



KEY NOTES

- EXISTING DEVICE LOCATED BELOW DESK.
- 2 RELOCATE EXISTING VOLUME CONTROL FROM DEMOLISHED WALL TO THIS POSITION.
 3 EXISTING RECEPTACLES AND JUNCTION BOXES AT 16" AFFL IN THIS SPACE TO BE DEMOLISHED.
- NEW RECEPTACLES TO BE PROVIDED AT 18" AFFL

 4 RELOCATE EXISTING CO ALARM FROM DEMOLISHED WALL TO THIS POSITION
- 4 RELOCATE EXISTING CO ALARM FROM DEMOLISHED WALL TO THIS POSITION.
 5 HOME RUN DATA CABLES TO EXISTING DATA RACK LOCATED IN MECHANICAL ROOM G-14.
- 6 EXISTING DATA CABINET.
 7 EXISTING WALL TELEPHONE TO BE DEMOLISHED.
- 8 REMOVE AND REINSTALL FLOOR OUTLETS AS REQUIRED TO ACCOMODATE RENOVATION WORKS.
- PROVIDE NEW QUAD RECEPTACLE LOCATED BELOW DESK.
- 10 PROVIDE WIREMOLD FOR HDMI CABLES FROM TV CABLE BOX TO WALL MOUNTED TV. COORDINATE LENGTH WITH ARCHITECTURAL ELEVATIONS.

Certificate of Authorization
Epp Siepman Engineering Inc.
No. 4035

1 20-07-28 Issued for Addendum 1
0 20-06-25 Issued for Construction

NO. DATE REVISION / ISSUANCE

Architect

x architecture inc.



400 - 136 Market Avenue Winnipeg, MB R3B 0P4 T 204 453 1080

WINNIPEG FPS FIRE STATION #13
INTERIOR RENOVATIONS
799 LILAC STREET

Sheet Title

MAIN FLOOR - POWER PLAN

19089A

EP2.1-R1

20-06-09