


(A) EXISTING GENERATOR EXHAUST THIMBLE
N.T.S.

NOTES:
1. REMOVE EXISTING ROOF CURB AND THIMBLE TO ACCOMMODATE ROOF WORK. TEMPORARILY SUPPORT GENSET VENT PIPING BELOW AND ABOVE ROOF TO ACCOMMODATE THIMBLE REMOVAL AND INSTALLATION.

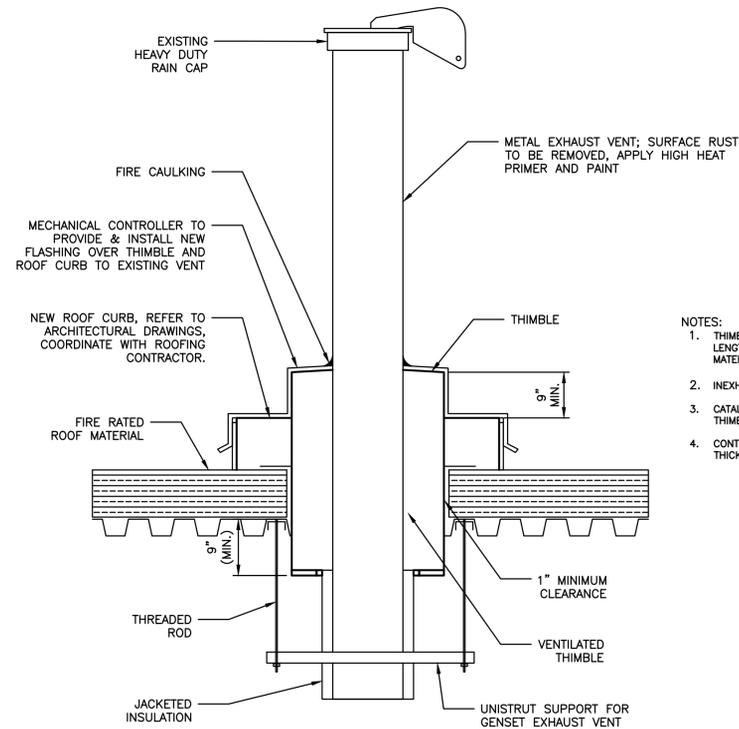


(B) NEW GENERATOR EXHAUST THIMBLE
N.T.S.

NOTES:
1. THIMBLE CUSTOMIZATIONS: FIT TO ROOF CURBS AND/OR ROOF PITCH. LENGTH SHALL BE CUSTOMIZED FOR ROOF THICKNESS. MATERIAL: STAINLESS STEEL.
2. INEXHAUST THIMBLES CONFORM TO NFPA 37 AND 211.
3. CATALOG STANDARD THIMBLES MODELED FOR 8\"/>



NOTE:
USE MIFAB C-PORT

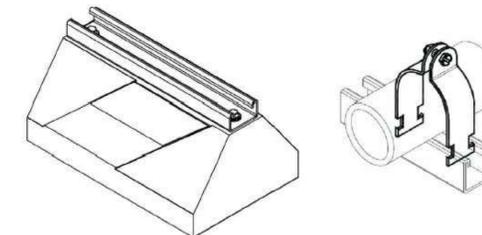

(C) REFRIGERANT PIPE SUPPORT DETAIL
N.T.S.



PROJECT:
City Hall Administration Building Roof Replacement
510 Main Street
CLIENT:
City of Winnipeg

APECM
Certificate of Authorization
Alliance Engineering Services Inc.
No.2906 Date: _____

APPROVED BY:
I. Urquhart

DATE:
July 2020

BID OPPORTUNITY:
430-2020

PROJECT NO.:
19-041

DWG NO.:

M2.2