
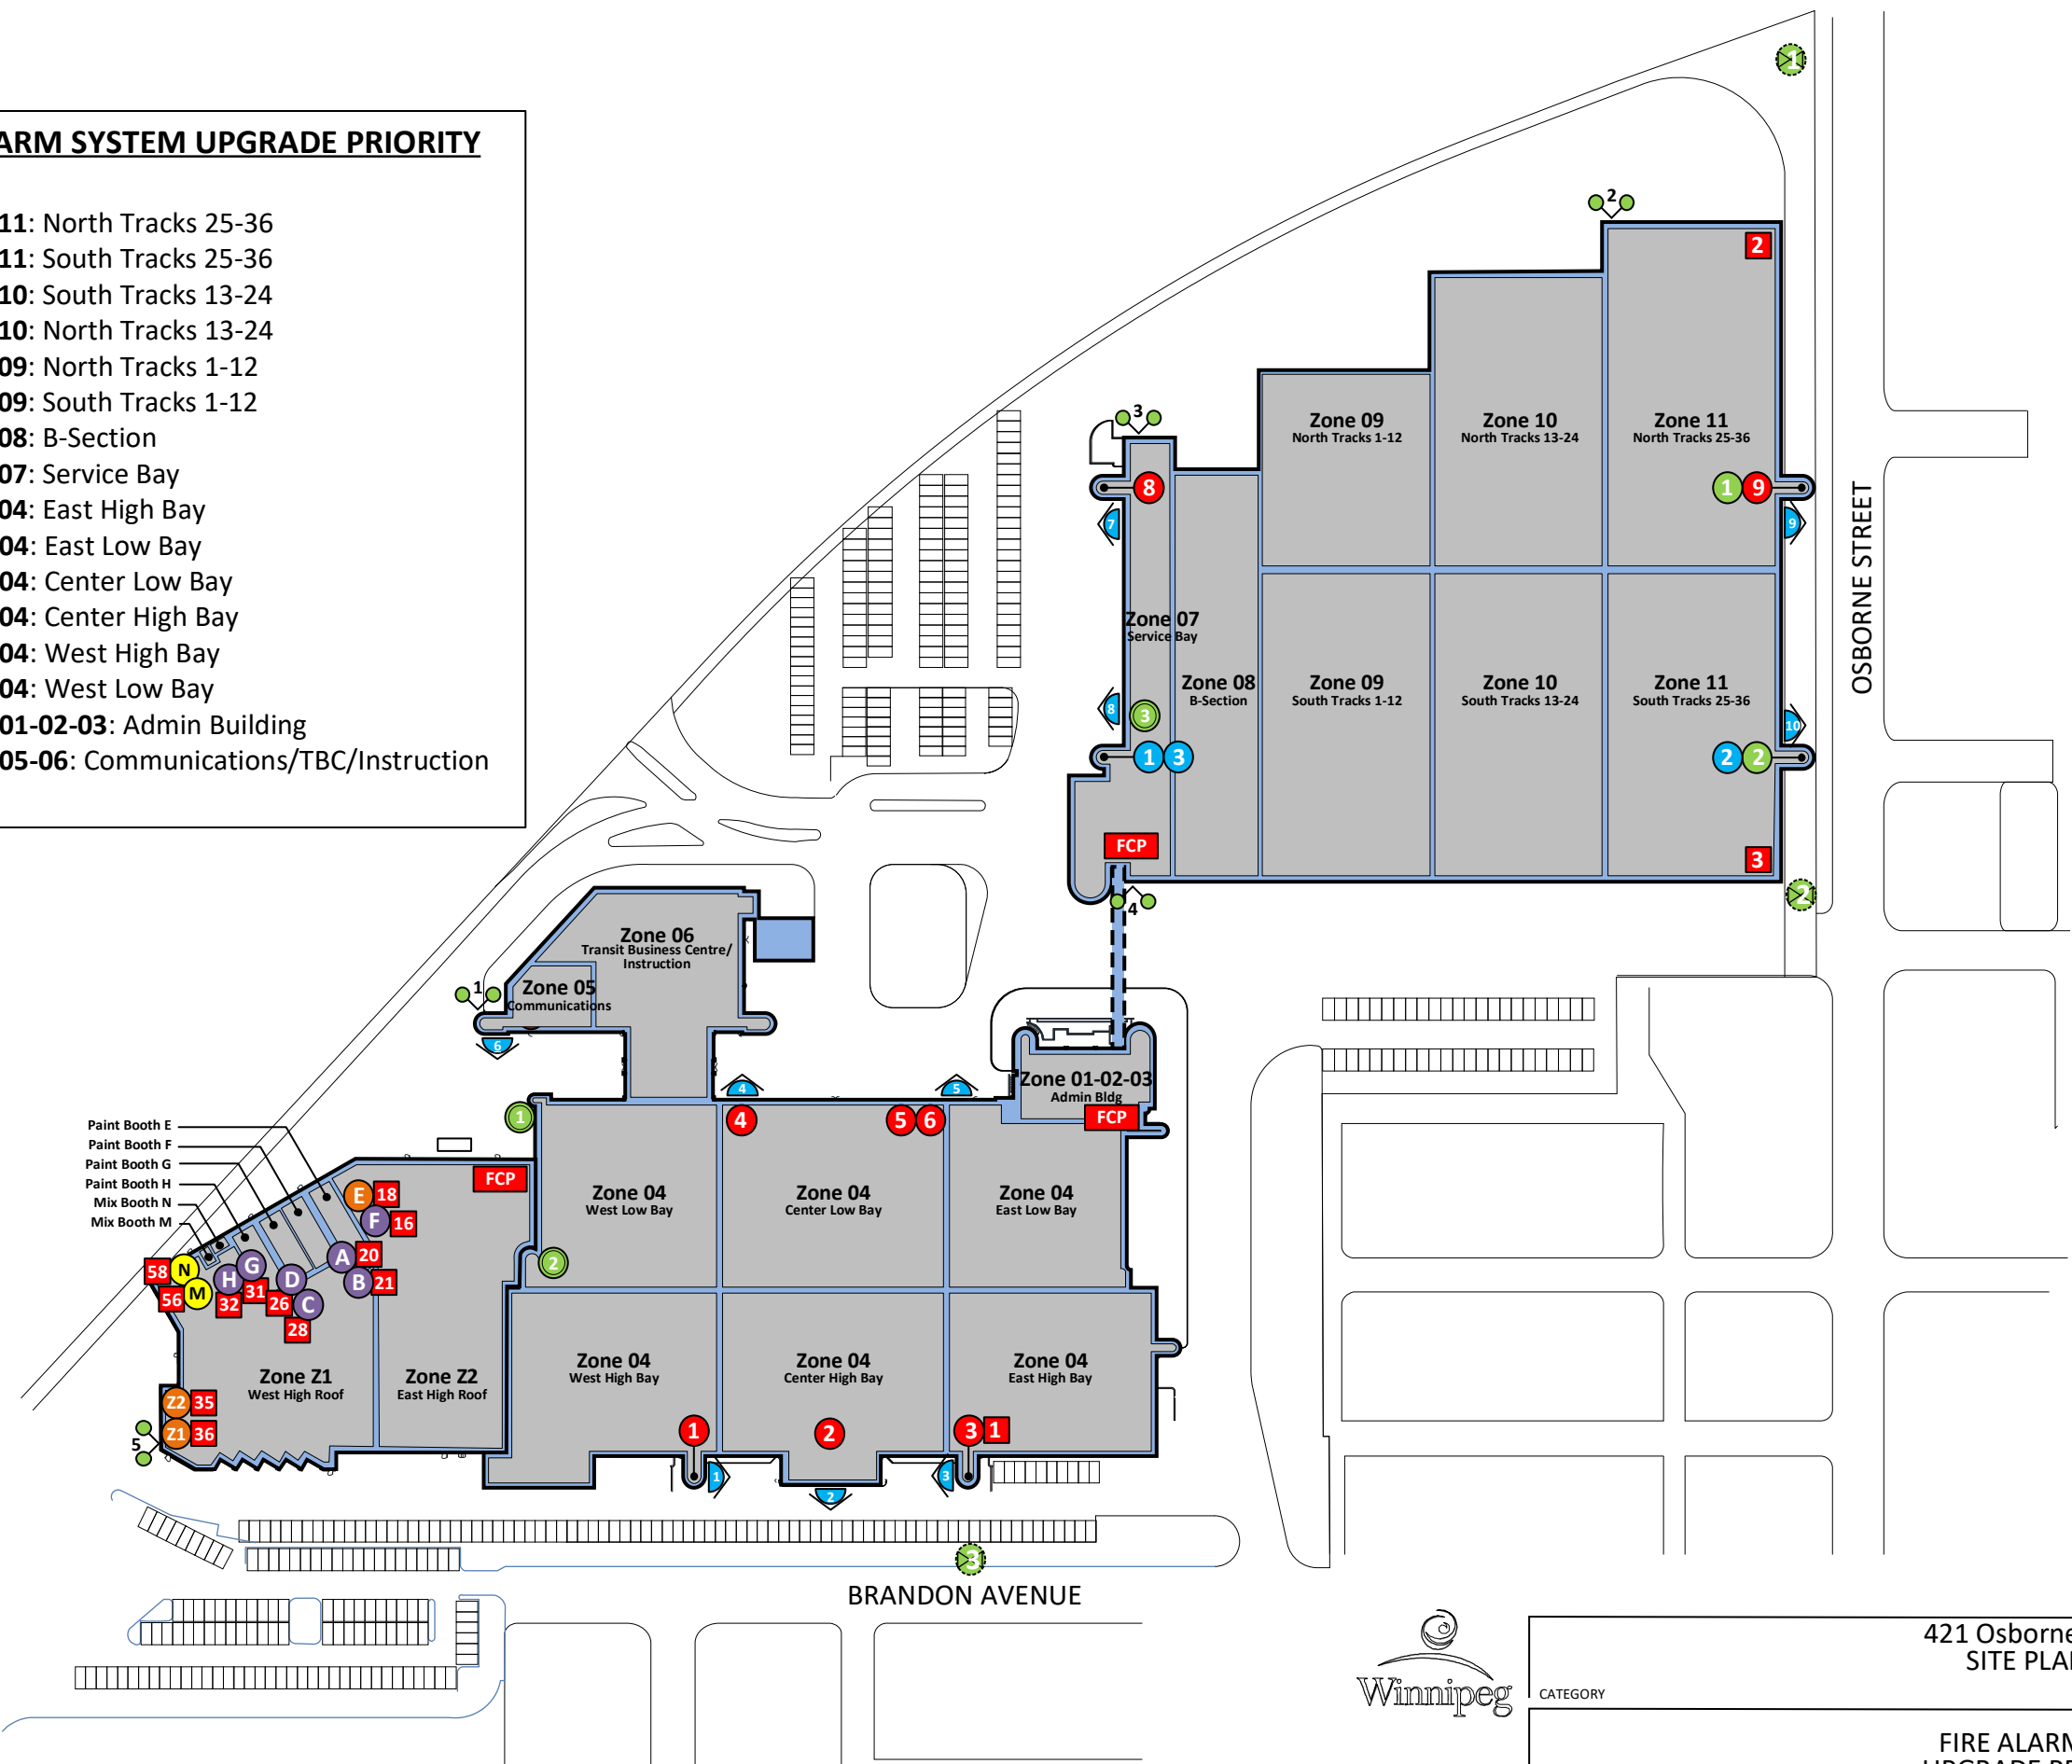


**FIRE ALARM SYSTEM UPGRADE PRIORITY**

1. **Zone 11:** North Tracks 25-36
2. **Zone 11:** South Tracks 25-36
3. **Zone 10:** South Tracks 13-24
4. **Zone 10:** North Tracks 13-24
5. **Zone 09:** North Tracks 1-12
6. **Zone 09:** South Tracks 1-12
7. **Zone 08:** B-Section
8. **Zone 07:** Service Bay
9. **Zone 04:** East High Bay
10. **Zone 04:** East Low Bay
11. **Zone 04:** Center Low Bay
12. **Zone 04:** Center High Bay
13. **Zone 04:** West High Bay
14. **Zone 04:** West Low Bay
15. **Zone 01-02-03:** Admin Building
16. **Zone 05-06:** Communications/TBC/Instruction



Paint Booth E  
 Paint Booth F  
 Paint Booth G  
 Paint Booth H  
 Mix Booth N  
 Mix Booth M

- FCP** FIRE ALARM CONTROL PANEL
- SPRINKLER RISER – Grinnell 6" Model A
- SPRINKLER RISER – Grinnell 8" Model A
- SPRINKLER RISER – Reliable 6" Model E
- SPRINKLER RISER – Tyco 6" Model RM-1
- SPRINKLER RISER – Tyco 4" Model RM-1
- SPRINKLER RISER – Tyco 2" Model RM-1
- FLOW SWITCH
- GLYCOL SPRINKLER SYSTEM
- WATER GONG
- WALL HYDRANT - McAVITY
- UNDERGROUND VALVE PIT



421 Osborne Street SITE PLAN VIEW		SCALE	N.T.S.
CATEGORY		DRAWN BY	TVD
DRAWING TITLE		DATE	2021.02.23
FIRE ALARM ZONE UPGRADE PRIORITY		DRAWING NO.	
		SHEET NO.	1 of 1