

NOTES:

- ◇ ILLUMINATED MONUMENT SIGN:
 - PROVIDE 2-#6 AWG BARE COPPER GROUND WIRES, ONE (1) FROM EACH SIDE OF THE SIGN AND TERMINATE AT 2x10' COPPER GROUND RODS.
 - PROVIDE TWO (2) 15A/1P BREAKERS IN EXISTING PANEL 400 IN ELECTRICAL ROOM CRAWLSPACE. WIRE & CONNECT TO NEW SIGNAGE UTILIZING 2-#4 RWU90 IN 1-1/4" C.
 - PROVIDE ONE (1) 1" C. COMPLETE WITH FIBRE. FIBRE TYPE TO BE CONFIRMED BY SUPPLIER. CONDUIT SHALL RUN TO ELECTRICAL ROOM. ALLOW 20 METERS OF EXTRA CABLE AND FIBRE TO RELOCATE SIGN TERMINATION AS PER SUPPLIER REQUIREMENTS.
 - PROVIDE DIRECT CONNECT AND A WEATHER PROOF BOX TO HOUSE ETHERNET EXTENDER-WIRE AND CIRCUIT. WIRE & CONNECT ETHERNET EXTENDER IN WEATHERPROOF BOX TO NEW 15A/1P CIRCUIT BREAKER IN PANEL 400 UTILIZING 2 #12 RWU90.
 - CONFIRM ALL OF THE ABOVE REQUIREMENTS WITH SUPPLIER.
- ◇ EXISTING OUTDOOR ELECTRICAL DISTRIBUTION.
- ◇ ELECTRICAL SUB-CONTRACTOR SHALL BE RESPONSIBLE TO HAVE EXISTING U/G CABLE LOCATION COMPLETED PRIOR TO CUTTING NEW TRENCH. FINAL TRENCH LINE TO BE CONFIRMED ON SITE WITH CONTRACT ADMINISTRATOR.
- ◇ PROVIDE A SEPARATE PRICE FOR WORK DENOTED IN NOTES 4 THROUGH 10.
- ◇ WIRE AND CONNECT ILLUMINATED ENTRANCE SIGN FROM PANEL NE AT WEST ENTRANCE. PROVIDE ONE (1) 15A/1P BREAKER C/W 2-#6 RW90 IN 1-1/2" C.
- ◇ RELOCATE LUMINAIRE TO WEST WALL. CONFIRM EXACT LOCATION WITH CONTRACT ADMINISTRATOR.
- ◇ TRANSITION TO SOFFIT SPACE FOR FINAL SIGN TERMINATION. CONFIRM QUANTITY OF JUNCTION BOXES AND BX CONNECTIONS WITH SUPPLIER.
- ◇ TRANSITION TO EXTERIOR ROOF.
- ◇ CONDUIT SHALL RUN IN EXISTING BULKHEAD AND T-BAR CEILING.
- ◇ PROVIDE SOFT-DIG (HYDROVAC) AT EXISTING CABLE CROSSING TO EXPOSE CONDUIT/CABLE RUNS PRIOR TO TRENCHING.
- ◇ WIRE AND CONNECT ILLUMINATED ENTRANCE SIGN FROM PANEL 400 AT EAST ENTRANCE. PROVIDE ONE (1) 15A/1P BREAKER C/W 2-#12 RW90 IN 3/4" CONDUIT.

LEGEND



210-1521 Wellington Avenue
Winnipeg, Manitoba, R3B 0G4
Phone: (204) 774-7000
FAX: (204) 774-7001
www.mcw.com

MCW
12902
MCW Consultants Ltd.

ISSUED FOR TENDER	06 APRIL 2021
ISSUED FOR 99% REVIEW	19 JULY 2019
ISSUE NOTES	DATE

THIS DRAWING MUST NOT BE SCALED.

THE GENERAL CONTRACTOR SHALL VERIFY ALL DIMENSIONS, DATUMS AND LEVELS PRIOR TO COMMENCEMENT OF WORK. ALL ERRORS AND OMISSIONS TO BE REPORTED IMMEDIATELY TO THE LANDSCAPE ARCHITECT.

VARIATIONS & MODIFICATIONS TO WORK SHOWN ON THESE DRAWINGS SHALL NOT BE CARRIED OUT WITHOUT WRITTEN PERMISSION FROM THE LANDSCAPE ARCHITECT.

THIS DRAWING IS THE EXCLUSIVE PROPERTY OF THE LANDSCAPE ARCHITECTS AND CAN BE REPRODUCED ONLY WITH THE PERMISSION OF THE LANDSCAPE ARCHITECTS, IN WHICH CASE THE REPRODUCTION MUST BEAR THEIR NAME AS LANDSCAPE ARCHITECTS.

PROFESSIONAL SEALS




500-115 Bannatyne Avenue East Winnipeg, MB R3B 0R3
PHONE 204 944 9907 WEB htfc.ca

PROJECT TITLE
ST. JAMES - ASSINIBOIA CENTENNIAL POOL WAYFINDING PHASE I
644 PARKDALE ST., WINNIPEG, MANITOBA

SHEET TITLE
SITE PLAN - ELECTRICAL RENOVATION LAYOUT

DRAWN KG	REVIEWED AJ	DRAWING NO. E2.0
SCALE AS NOTED	PROJECT No. 18-069	REV REV
DATE PRINTED 7/8/2019 3:46 PM		

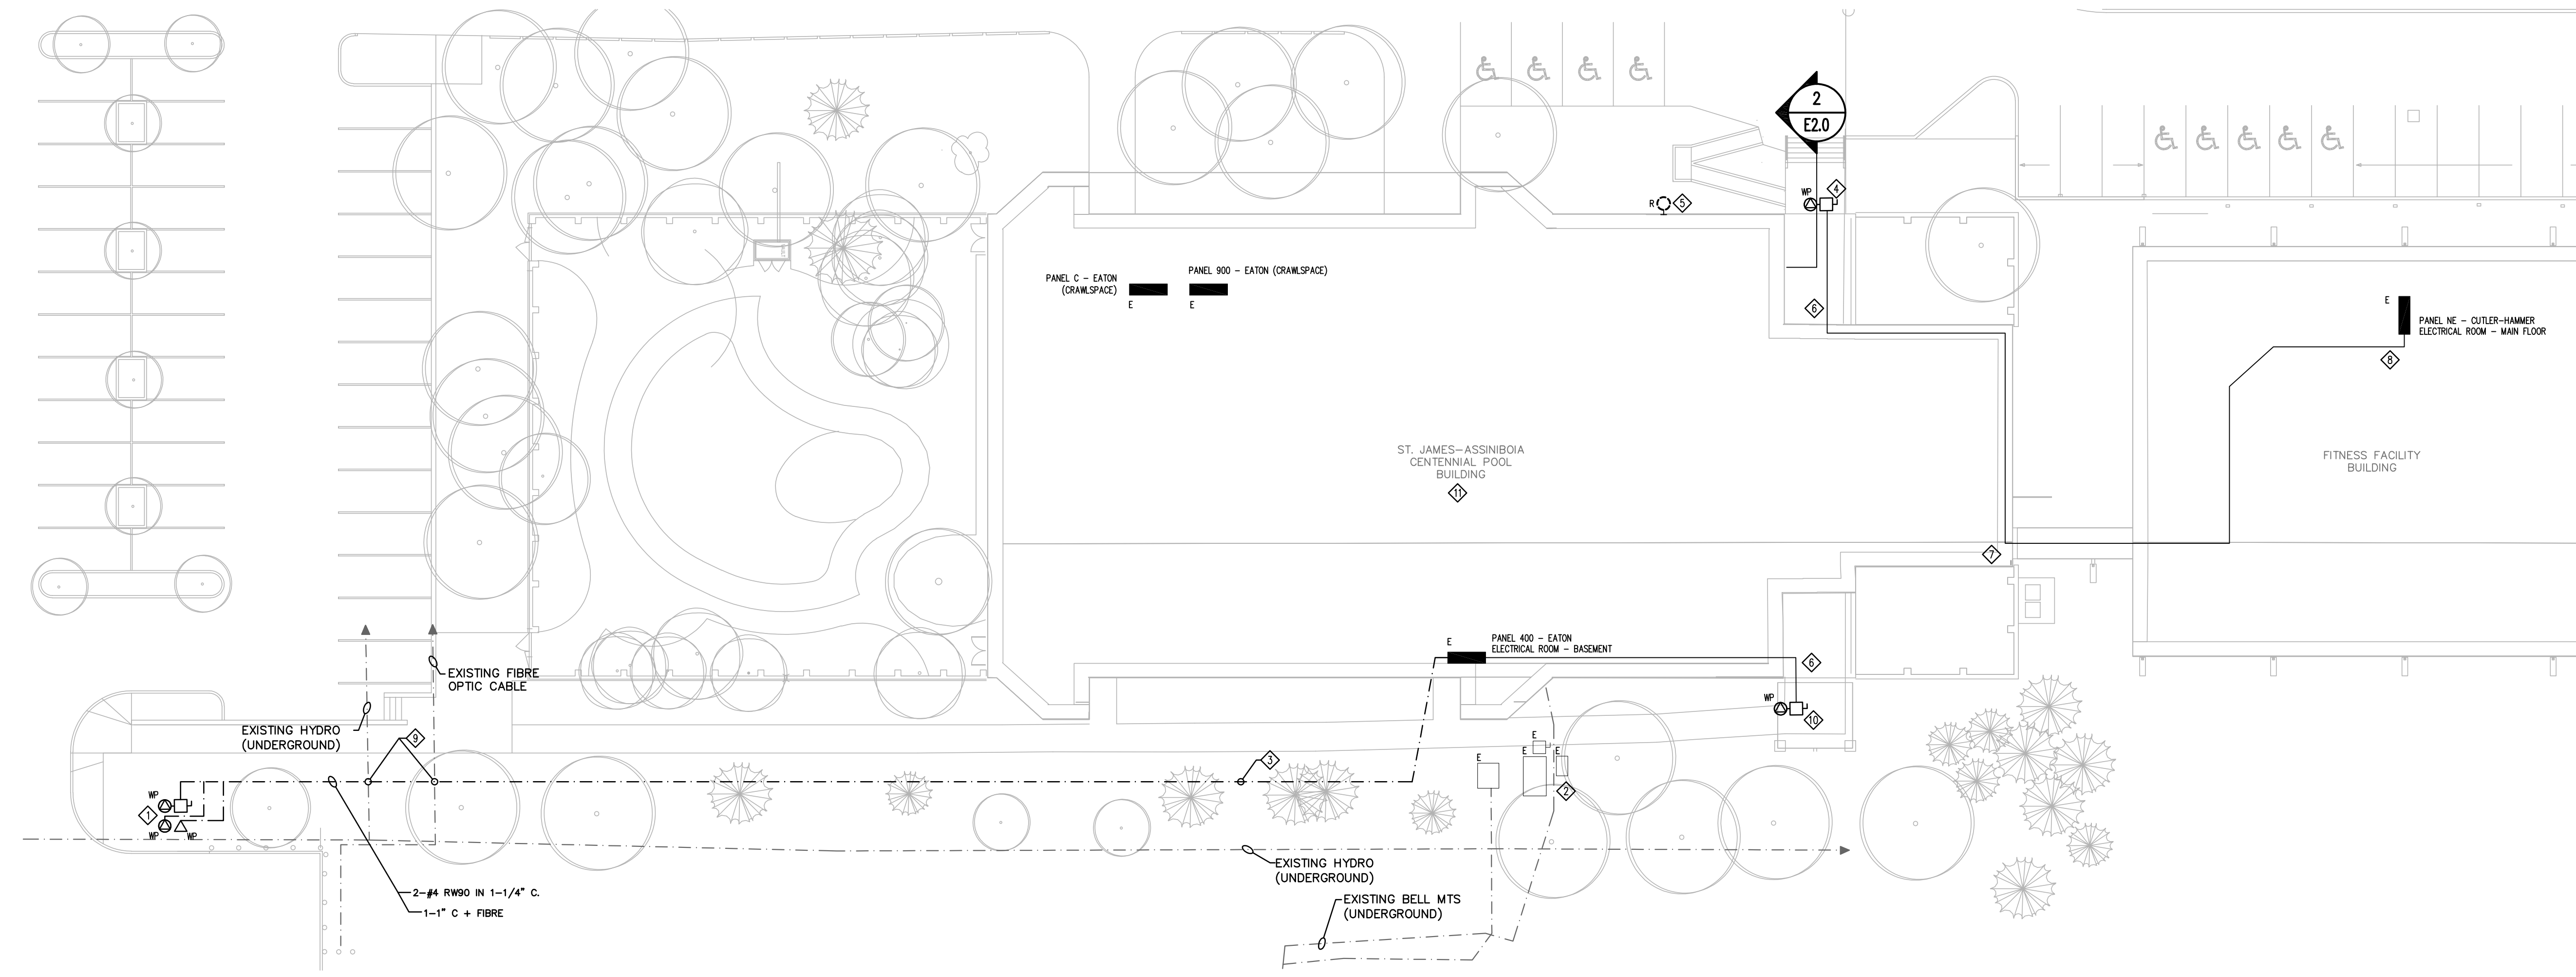

1 SITE PLAN - ELECTRICAL RENOVATION LAYOUT
E2.0 SCALE: 1:250

PRELIMINARY - NOT FOR CONSTRUCTION