


PARTIAL ROOF PLAN
SCALE: 1/8" = 1'

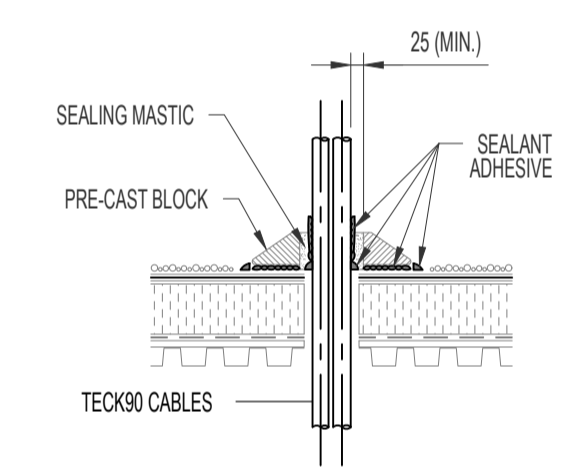

DETAIL A
SCALE: NTS

GENERAL NOTES:

1. THE ELECTRICAL SUBCONTRACTOR SHALL COORDINATE EXACT LOCATIONS OF MECHANICAL EQUIPMENT WITH THE MECHANICAL DRAWINGS PRIOR TO BID.
2. RE-USE EXISTING HOLE OPENING IN THE ROOF BUT PROVIDE NEW SEAL AS PER PITCH POCKET DETAIL AND AS PER MANUFACTURER'S INSTRUCTIONS.
3. CLEAN AND SCRAPE EXISTING ROOF SURFACE DOWN TO BARE FELTS.
4. SEALANT AND ADHESIVE MUST EXCEED 25mm OVER PRE-CAST BLOCK.
5. THE DISTANCE BETWEEN THE BLOCK INNER WALL AND PENETRATIONS MUST BE 25mm MINIMUM.

PITCH POCKET DETAIL NOTES:

1. PITCH POCKET DETAIL IS APPLICABLE FOR ALL TYPE OF CABLE AND CABLE RUNS PENETRATIONS.
2. RE-USE EXISTING HOLE OPENING IN THE ROOF BUT PROVIDE NEW SEAL AS PER PITCH POCKET DETAIL AND AS PER MANUFACTURER'S INSTRUCTIONS.
3. CLEAN AND SCRAPE EXISTING ROOF SURFACE DOWN TO BARE FELTS.
4. SEALANT AND ADHESIVE MUST EXCEED 25mm OVER PRE-CAST BLOCK.
5. THE DISTANCE BETWEEN THE BLOCK INNER WALL AND PENETRATIONS MUST BE 25mm MINIMUM.

NOTES:

THESE DRAWINGS SHALL NOT BE SCALED.

THE CONTRACTOR SHALL VISIT THE SITE AND SATISFY HIMSELF ALL DIMENSIONS, DATUM, AND DETAILED INFORMATION SHOWN ARE CORRECT.

THE CONTRACTOR IS TO REVIEW AND COORDINATE ALL ARCHITECTURAL, MECHANICAL, ELECTRICAL AND STRUCTURAL DRAWINGS FOR ADDITIONAL OPENINGS THROUGH FLOORS, WALLS, AND CEILINGS FOR DUCT, PIPE & ELECTRICAL RISERS AND ALL OPENINGS NOT SHOWN ON DRAWINGS.

ALL OPENINGS THROUGH THE FIRE SEPARATIONS AS A RESULT OF THE WORK OF THIS CONTRACT ARE TO BE FIRE STOPPED AND SEALED WITH ULC APPROVED FIRE STOPPING TO MAINTAIN THE INTEGRITY OF THE FIRE SEPARATION, AND PROVIDE AND SMOKE-TIGHT BARRIER.

ALL PRODUCTS AND MATERIALS TO BE USED AND INSTALLED SHALL CONFORM WITH MANUFACTURER'S SPECIFICATIONS & APPLICABLE CODES.

THE CONTRACTOR SHALL BE RESPONSIBLE TO PATCH AND MAKE GOOD ALL EXISTING CONSTRUCTION AFFECTED BY THE REMOVAL OF ALL ITEMS FORMING THE PART OF THE RENOVATION WORK.

WHERE NEW FLOORING AND BASE IS TO BE INSTALLED IN EXISTING AREAS (REFER TO FLOOR PLAN AND ROOM SCHEDULE) THE EXISTING FLOORING SURFACE AND BASE MUST BE REMOVED, UNLESS OTHERWISE NOTED. ALL FLOOR SURFACES SHALL BE PREPARED IN ACCORDANCE TO MANUFACTURER'S RECOMMENDATIONS FOR INSTALLATION OF NEW FLOOR.

WHERE PAINTING OF EXISTING WALLS IS INDICATED ON THE ROOM SCHEDULE, THESE WALLS MUST BE CLEANED OF ANY EXISTING WALL COVERING, PATCHED & PREPARED TO ACCEPT NEW MATERIAL, UNLESS OTHERWISE NOTED.

KEYNOTES:

1. WIRE AND CONNECT POWER WIRING TO THE NEW ROOF TOP AIR HANDLING UNIT (RTU-2).
2. WIRE AND CONNECT POWER WIRING TO THE NEW ROOF TOP CONDENSER UNIT (CU-2).
3. PROPOSED LOCATION ONLY. ELECTRICAL SUBCONTRACTOR TO FINALIZE THE LOCATION OF THE PITCH POCKET.
4. ELECTRICAL SUBCONTRACTOR TO COORDINATE LOCATION OF THE DISCONNECT SWITCHES ON SITE.

LEGEND	
	LOCAL DISCONNECT SWITCH
	EQUIPMENT LOAD
	GROUND FAULT CIRCUIT INTERRUPTER RECEPTACLE

No.	REVISION/DESCRIPTION	BY	DATE
0	ISSUED FOR CONSTRUCTION	JMS	21/06/16

DRAWN	CHECKED	DESIGNED	APPROVED
DATE: 21.06.16	USER	APPROVAL	

THE CITY OF WINNIPEG
PLANNING, PROPERTY AND
DEVELOPMENT DEPARTMENT
MUNICIPAL ACCOMMODATIONS DIVISION
3-65 GARRY STREET, R3C 4K4

PROJECT
REPLACEMENT OF AIR HANDLING UNIT RTU-2
GLENWOOD COMMUNITY CENTRE

27 OVERTON STREET

SHEET TITLE
ELECTRICAL
PARTIAL ROOF PLAN AND DETAILS



SCALE AS SHOWN	PROJECT No: 21-0107-008	SHEET No: E04
-------------------	----------------------------	------------------