


**GENERAL NOTES**

- A. ALL EQUIPMENT, DEVICES, FIXTURES REMOVED UNDER DEMOLITION SCOPE WILL BE FIRST OFFERED TO THE CITY FOR REFUSAL FOLLOWED BY CONTRACTOR AND FINALLY TO BE LEGALLY DISPOSED OF.
- B. FOR ALL EXISTING ELECTRICAL DEVICES, EQUIPMENT, ETC. THAT ARE REMOVED, REMOVE EXISTING CONDUIT, WIRING, ETC. BACK TO SOURCE UNLESS OTHERWISE NOTED.
- C. CONTRACTOR SHALL BE RESPONSIBLE FOR COORDINATING EXACT LAYOUT, ROUTING, ETC. VERIFY EXISTING SERVICES ON SITE.
- D. VERIFY ALL EXISTING EQUIPMENT BEING RE-USED IS WORKING PRIOR TO INSTALLATION. SUPPLY NEW EQUIPMENT AS NECESSARY.
- E. CONTRACTOR TO DETERMINE EXACT CABLE ROUTES ON SITE WHERE POSSIBLE FOLLOW EXISTING CABLE ROUTES THROUGH BUILDING. RE-USE EXISTING OPENINGS AND PENETRATIONS TO ROUTE CABLES. PROVIDE NEW PENETRATIONS WHERE EXISTING CANNOT BE RE-USED. SEAL ALL PENETRATIONS.
- F. SEAL ALL PENETRATIONS THROUGH FIRE RATED WALLS WITH FIRE STOP MATERIAL AS REQUIRED TO MAINTAIN ASSEMBLY RATING.
- G. COORDINATE FULLY WITH MECHANICAL FOR THE SEQUENCE OF DEMOLITION AND CONSTRUCTION.
- H. COORDINATE WITH THE CITY PRIOR TO SHUT DOWN OF EQUIPMENT.
- I. CONTRACTOR SHALL ENSURE COORDINATION BETWEEN ALL SUBCONTRACTORS AND CONTRACT ADMINISTRATOR, ON AND OFF SITE, AS REQUIRED FOR INSTALLATION OF ELECTRICAL EQUIPMENT.
- J. CONTRACTOR TO VISIT SITE DURING BID AND VERIFY ALL EXISTING SERVICES ON SITE PRIOR TO SUBMITTING BID. REPORT ANY DISCREPANCIES TO CONTRACT ADMINISTRATOR DURING BID PERIOD.
- K. ARRANGE AND PAY CERTIFIED ROOFING CONTRACTOR TO PROVIDE NEW ROOF PITCH BOXES, SEAL ROOF OPENINGS EXPOSED FROM REMOVAL OF EXISTING FEEDERS. REFER TO SPECIFICATION FOR ADDITIONAL DETAILS.

**DEMOLITION KEY NOTES** ##

- 1. DISCONNECT AND REMOVE WIRE, CONDUIT, ETC. ASSOCIATED WITH EXHAUST FAN BACK TO EXISTING MCC-TT. COORDINATE REMOVAL WITH MECHANICAL CONTRACTOR.
- 2. EXISTING CONDENSING UNIT TO BE RELOCATED. REFER TO DRAWING E2.2 FOR FURTHER INFORMATION. COORDINATE RELOCATION WITH MECHANICAL CONTRACTOR.
- 3. SEAL ALL EXISTING OPENINGS THROUGH THE ROOF AND WALL EXPOSED FROM REMOVAL OF EXISTING WIRE, CONDUIT, ETC. MAKE WEATHER TIGHT.
- 4. EXISTING CONDENSING UNIT TO REMAIN.
- 5. EXISTING EXHAUST FAN TO REMAIN.
- 6. DISCONNECT AND REMOVE EXISTING RECEPTACLE.
- 7. EXISTING RECEPTACLE TO REMAIN.

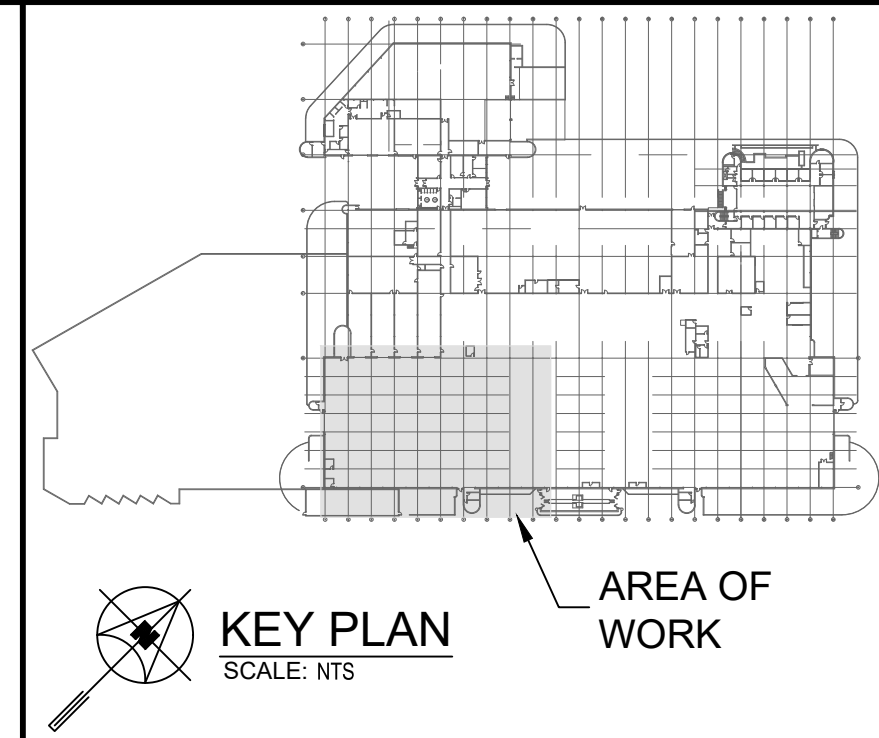

4			
3			
2			
1			
0	ISSUED FOR CONSTRUCTION	AS	07/06/22
NO.	Description	BY	DDMMYY

**ENGINEERS  
GEOSCIENTISTS**  
MANITOBA  
Certificate of Authorization  
**SMS Engineering Ltd.**  
No. 166



**SMS Engineering**  
770 Bradford Street Winnipeg, Canada (204) 775-0291  
20-349-01




**Winnipeg Transit**

Project Title  
**TRANSIT MAINTENANCE AND REPAIR BUILDING MECHANICAL UPGRADE - WEST HIGH BAY**  
WINNIPEG MANITOBA

Drawing Title  
**PARTIAL ROOF PLAN - ELECTRICAL - DEMOLITION**

Drawn By WPD	Checked By CRM	Approved By AS
Scale 1/16"=1'-0"	Date JUNE 2022	Project No. 20-349-01
Revision Number 0	Drawing Number E1.2	Sheet Order 2 OF 6

FILE NAME AND PATH: C:\PROJECTS\2022\20-349 Transit Maintenance Building\01 CAD\Revit\4 E1\Phase 1\02049\_E1.2\_GA\_V\_R\_1.dwg  
LAYOUT: E1.2  
LAST SAVED BY: jgibson  
DATE PLOTTED: Thursday, April 20, 2024 10:02:21 AM

 **1 PARTIAL ROOF PLAN - ELECTRICAL - DEMOLITION**  
E1.2 SCALE: 1/16" = 1'-0"