

POWER AND SYSTEMS DEMOLITION NOTES: "X"


- ALSO SEE NOTES & SPECIFICATIONS.  
 REFER TO RENOVATION DRAWINGS FOR RELOCATED COMPONENTS.  
 AS REQUIRED BY LATEST CANADIAN ELECTRICAL CODE, ALL ABANDONED CABLES/WIRES TO BE REMOVED. DO NOT DISTURB OR DISCONNECT ANY WIRING & CABLING IN AREA OF WORK REQUIRED FOR OTHER AREAS.  
 RE-SUPPORT ALL CONDUITS & CABLING TO STRUCTURE AS REQUIRED BY CODE. NON-PLENUM RATED CABLING IN PLENUM SPACES SHALL BE INVENTORIED & REPORTED TO CONTRACT ADMINISTRATOR. EXISTING NON-PLENUM RATED CABLING/WIRING MAYBE REQUIRED TO BE REPLACED WITH PLENUM-RATED TYPE & TESTED TO ENSURE FUNCTION AS PER ITS SYSTEM.
1. REMOVE ALL COMPONENTS WITH DESIGNATION "D" BACK TO ELECTRICAL PANEL, UNLESS OTHERWISE NOTED. UNUSED ELECTRICAL BOXES & CONDUITS SHALL BE REMOVED. UNUSED TV COAXIAL CABLE STILL CONNECTED TO SOURCE SHALL BE LABELLED, RECOILED & STORED IN A NEAT FASHION IN THE CEILING SPACE & MAYBE REDEPLOYED.
  2. ELECTRICAL PANELS "C1", "C2" & "C3, ALL ASSOCIATED CIRCUITS, BOXES & CONDUITS TO BE RE-CIRCUITED AS PER ELECTRICAL DRAWINGS PANEL SCHEDULES & SLD.
  3. DATA RUNS TO REMAIN. TAG CABLES WITH PORT DESIGNATION, PROTECT, COIL-UP & SUPPORT DURING DEMOLITION. IF DAMAGED & CABLE TEST FAILED, REINSTALL OR RELOCATE WITH NEW AS PER ELECTRICAL RENOVATION DRAWING(S) & SPECIFICATIONS.
  4. CONTACT WFPS IT BEFORE WORK, IF POSSIBLE. EXISTING WIRING CLOSET COMPONENTS TO BE RELOCATED TO NEW NETWORK ROOM WITHOUT SEVERING CABLES TO ALLOW FOR UNDISRUPTED NETWORK CONNECTIVITY. RELOCATE FIBRE OPTIC CABLE(S), PA/CONG SYSTEM, STATION ALERTING STATION (LOCUTION PANEL), UPS(S), MTS BIX TO NEW NETWORK ROOM. REWORK WITH NEW HOME RUN CABLING IF REQUIRED.
  5. TEMPORARY RELOCATE WORKING DOOR CHIME HIGHER DURING CONSTRUCTION. BEFORE OCCUPANCY, DOOR CHIME SYSTEM IS REPLACED WITH NEW VIDEOINTERCOM SYSTEM.
  6. RELOCATE SOUTH ON SAME WALL TO NEW LOCATION, SEE RENOVATION DRAWING.

GENERAL NOTES:

- REFER TO DRAWING E1.
1. ITEMS RELATING TO PROJECT 2019-150, ELECTRICAL SERVICE UPGRADE AND NEW EMERGENCY GENERATOR HAVE BEEN REMOVED.
  2. EXISTING RECEPTACLES/COMPONENTS WITH CIRCUITS TO PANELS "NP-A", "EP-A" & "EP-B" ARE IN SCOPE OF THIS TENDER.
  3. EQUIPMENT/COMPONENTS ID WITH "N" ARE IN SCOPE OF THIS TENDER.

MAIN FLOOR PLAN - DEMOLITION  
SCALE: 1/8"=1'-0"

1	ISSUED FOR ADDENDUM 3	DTA	2021-12-03
0	ISSUED FOR CONSTRUCTION	DTA	2021-10-26
000	ISSUED FOR CLASS 3 ESTIMATE	DTA	2021-06-02
No.	REVISION/DESCRIPTION	BY	DATE

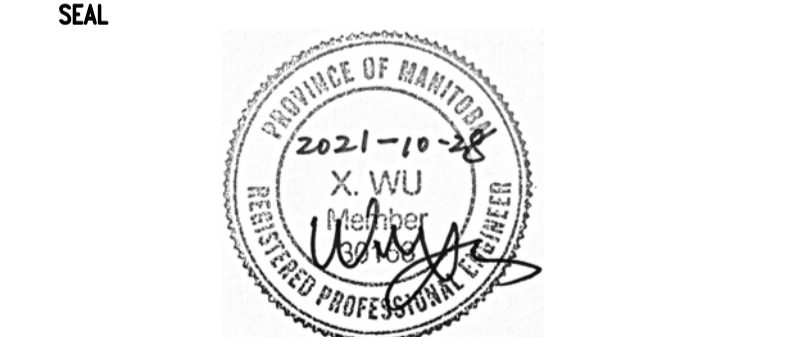

DRAWN	DTA	CHECKED	DTA	DESIGNED	DTA	APPROVED
DATE	2021.06.31	USER		APPROVAL		

THE CITY OF WINNIPEG  
 PLANNING, PROPERTY AND  
 DEVELOPMENT DEPARTMENT  
 MUNICIPAL ACCOMMODATIONS DIVISION  
 3-65 GARRY STREET, R3C 4K4

PROJECT  
 WINNIPEG FIRE PARAMEDIC SERVICES  
 FIRE STATION #1  
 INTERIOR RENOVATIONS  
 65 ELLEN STREET BID OPP: 535-2021

SHEET TITLE  
 MAIN FLOOR PLAN  
 ELECTRICAL - DEMOLITION  
 POWER AND SYSTEMS

SCALE	PROJECT No:	SHEET No:
AS SHOWN	2019-075	E2-R1