


LAST SAVE: 2022/12/14 2:24 PM
 PATH: C:\Users\miller\AppData\Local\Autodesk\AutoCAD Plant 3D\Collaboration\Subtree\620_SRPD_NEW\WCC 2021\RPD DVI\01_Primary Clarifier Upgrade\1_P3-X605.rvt

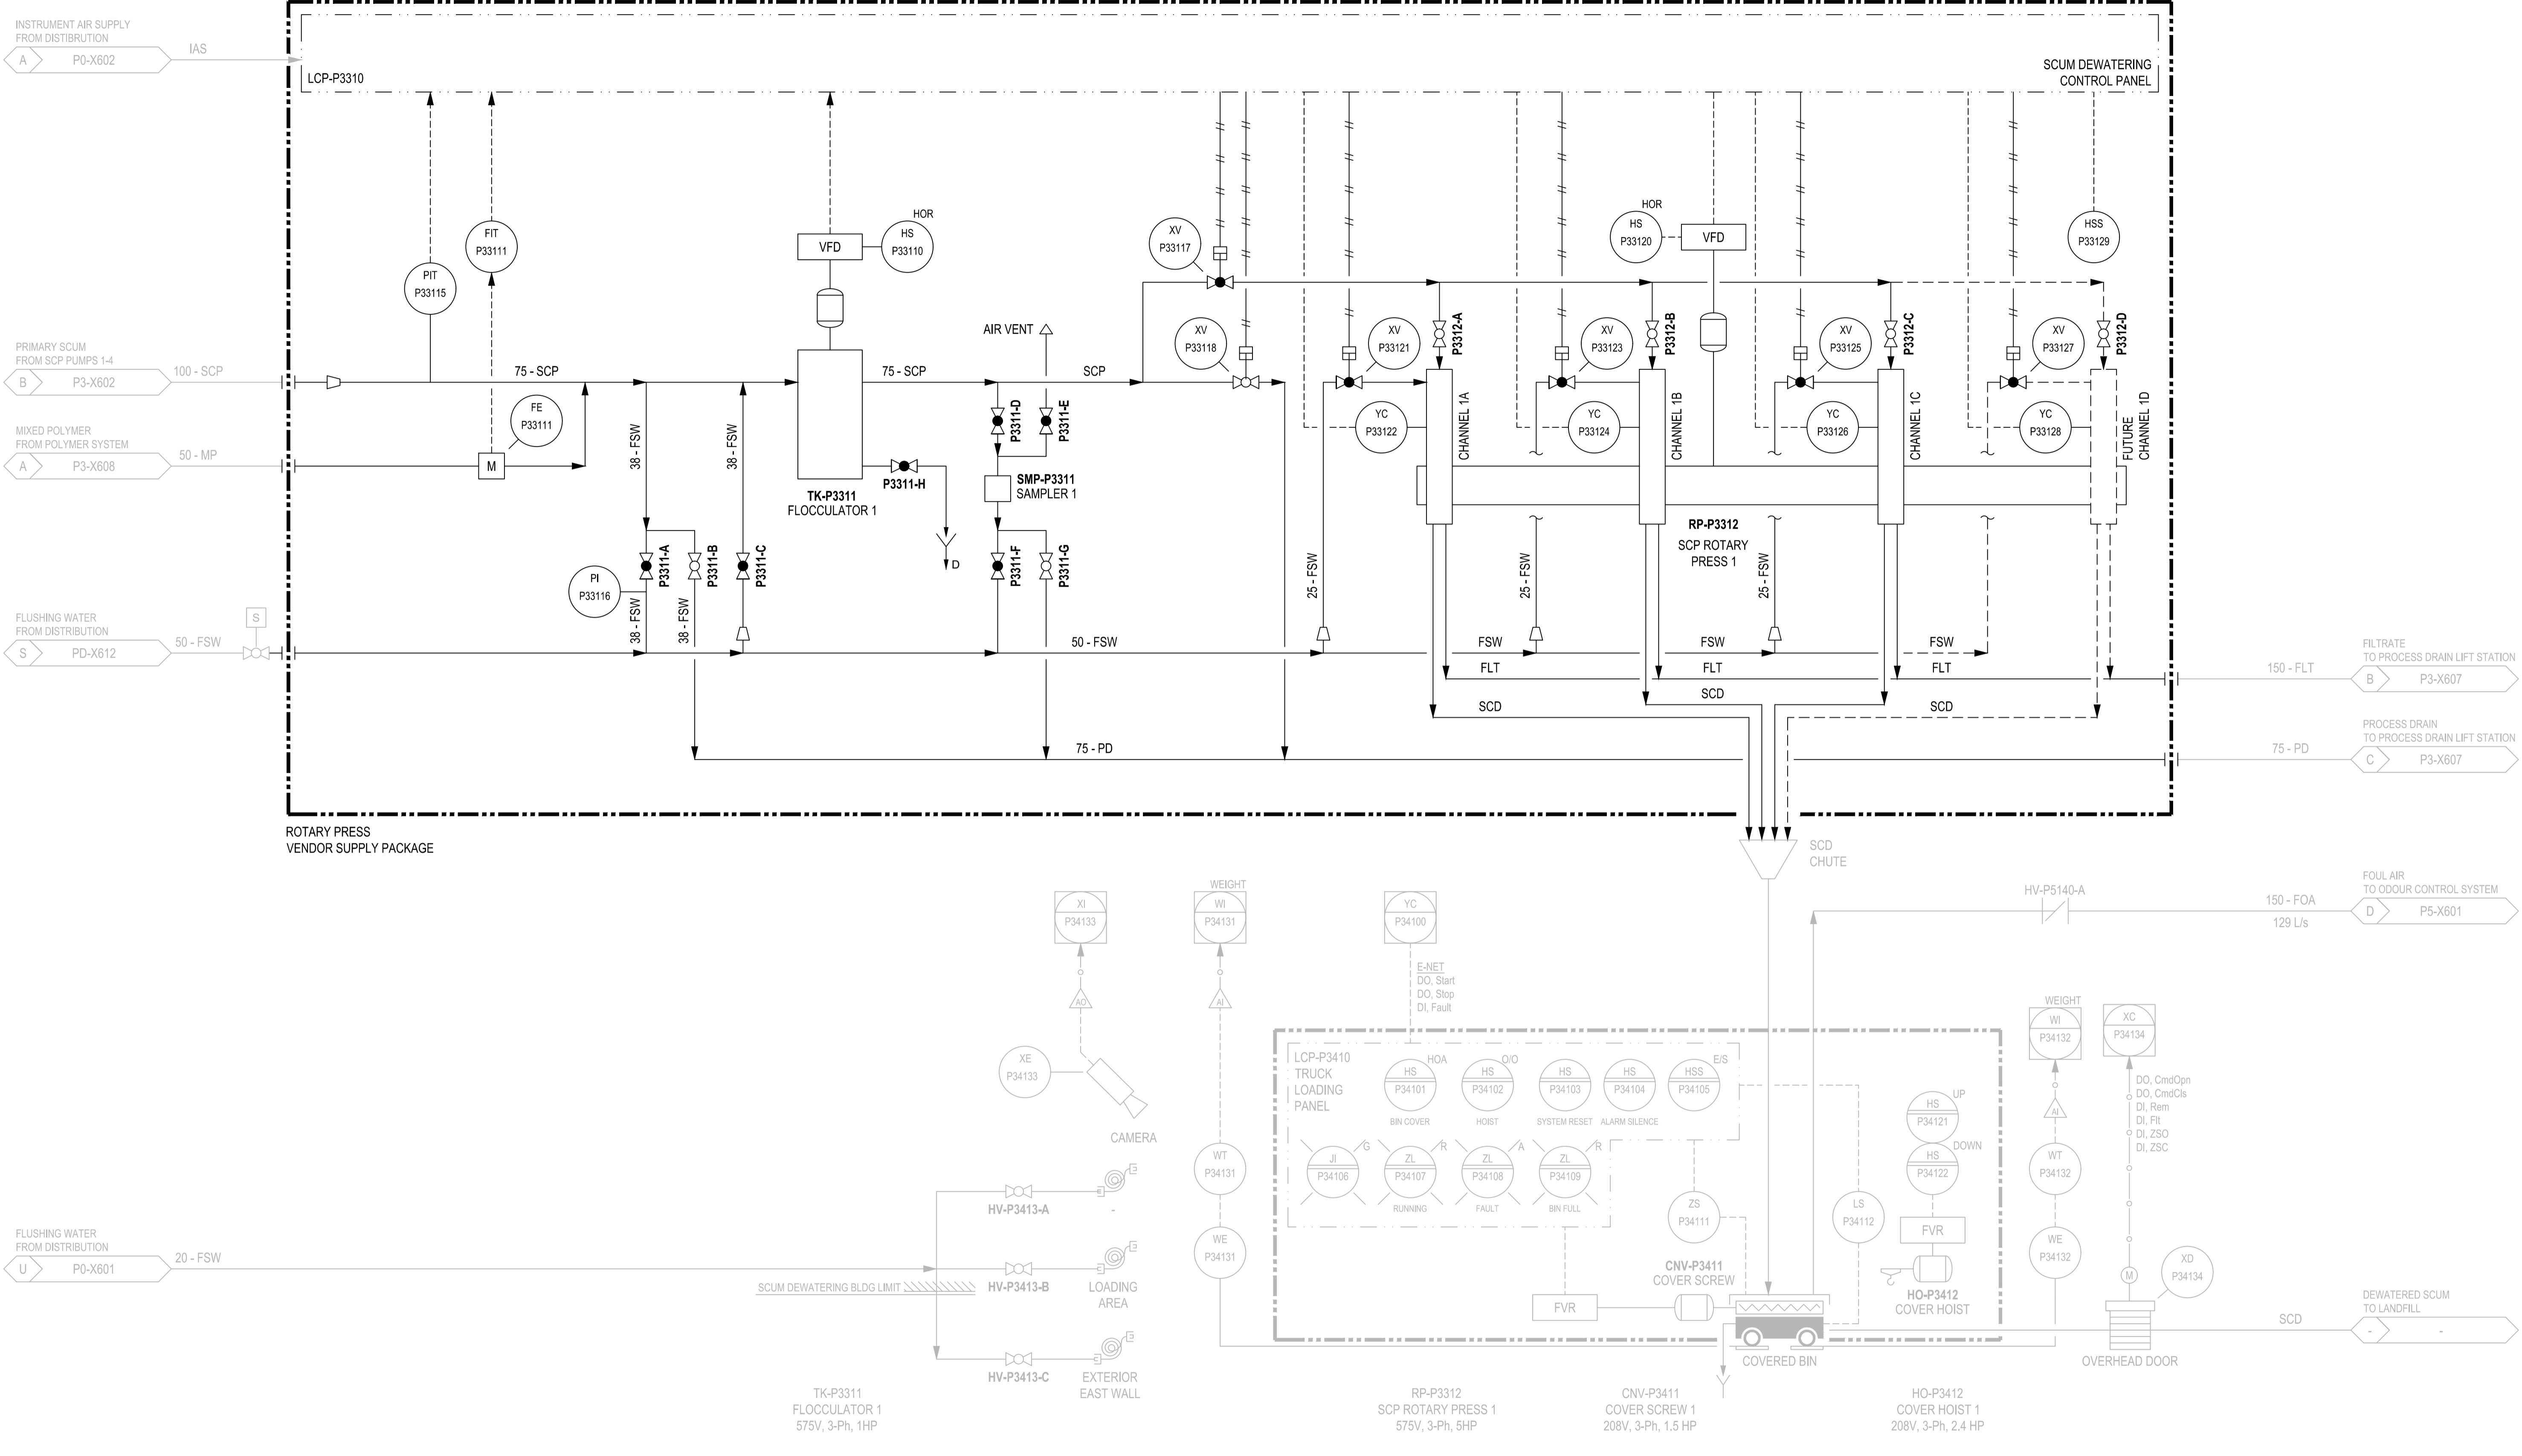

FOR REFERENCE ONLY

DRAFT

<p>DESIGNED BY: MK CHECKED BY: PB DRAWN BY: ES APPROVED BY: NW SCALE: NONE RELEASED FOR CONSTRUCTION BY: DATE: DATE: CONSULTANT NO.: P3-X605</p>		<p>ENGINEER'S SEAL</p> <p>PRELIMINARY</p> <p>NOT TO BE USED FOR CONSTRUCTION</p>		<p>TENDER NO.</p> <p>THE CITY OF WINNIPEG WATER AND WASTE DEPARTMENT</p> <p>NORTH END SEWAGE TREATMENT PLANT REQUEST FOR PROPOSALS FOR SUPPLY OF ROTARY PRESS & APPURTENANCES PROCESS & INSTRUMENTATION DIAGRAM PRIMARY SCUM DEWATERING SYSTEM 1 TK-P3311 & RP-P3312</p>	
0	ISSUED FOR TENDER OF ROTARY PRESS SUPPLY	2022-12-15	MK	PB	
NO.	REVISIONS	DATE	DESIGN	CHECK	
		CITY DRAWING NUMBER		SHEET	REV.
		1-0101P-A#####		001	0
				SIZE	A1