

NOTES:

1. SOPRAMASTIC SP2 MUST EXCEED 25 MM (1 INCH) OVER SOPRAMASTIC BLOCK.
2. THE DISTANCE BETWEEN THE BLOCK INNER WALL AND THE PENETRATIONS MUST HAVE AT LEAST 25 MM (1 INCH).

1 Pitch Block Detail

A1.4 Scale: NTS

REMOVE EXISTING ROOF DRAIN
REPLACE WITH NEW

CAP SHEET TO BE CLAMPED IN
DRAIN ASSEMBLY

SEAL EDGE WITH MASTIC

MOD BIT REINFORCEMENT STRIP

MOD BIT CAP SHEET

MOD BIT BASE SHEET

CONTINUOUS SBS AIR/ VAPOUR
BARRIER ADHERED TO DECK

DECK SHEATHING

EXISTING ROOF DECK

PIPE HANGER TO BE LOCATED
WITHIN 24" OF DRAIN BASIN


PIPE HANGER TO BE LOCATED
WITHIN 24" OF DRAIN BASIN

NOTE:

NEW DRAIN ASSEMBLY TO FLOAT - DO NOT CLAMP TO STRUCTURE

3 Roof Drain Detail

A1.4 Scale: 1" = 1'-0"

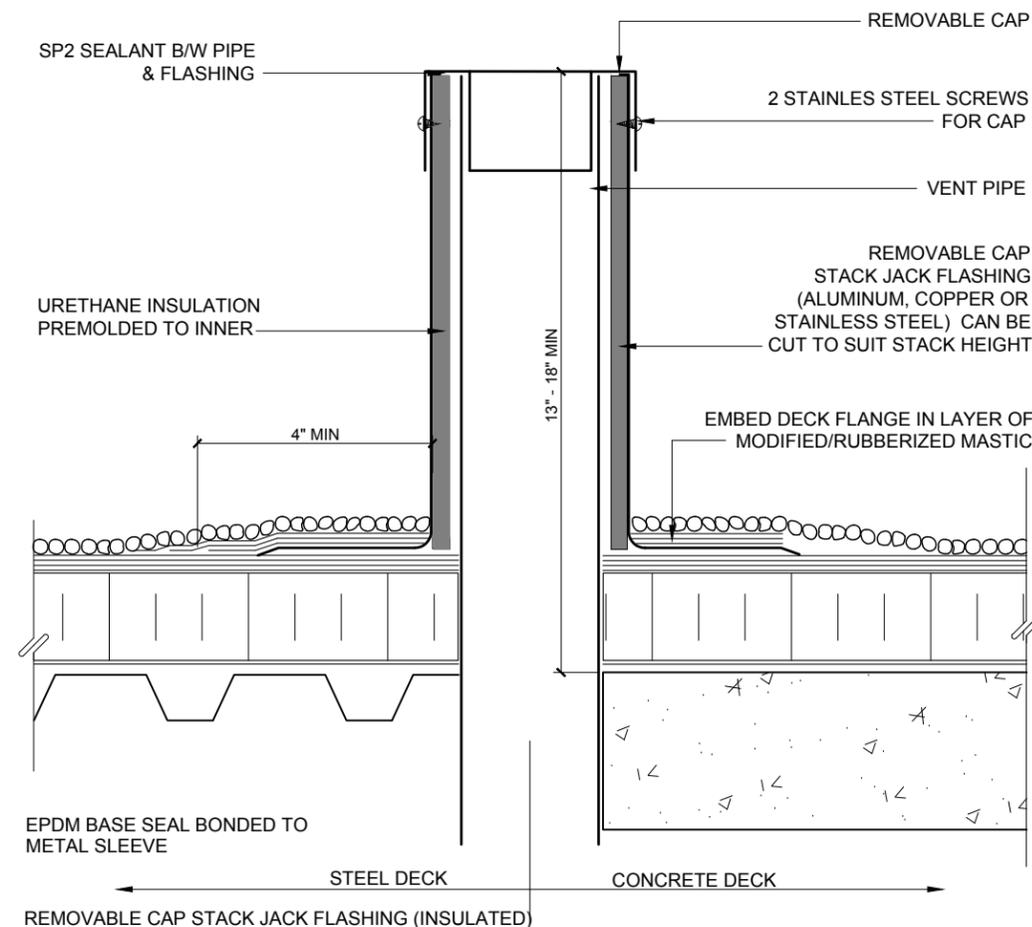

2 Stack Insulation Detail


A1.4 Scale: NTS

APPLY ccSPF AROUND
ENTIRE DRAIN BASIN

NEW DRAIN PIPE
EXTENSION

NEW EXPANSION JOINT

NEW 1" PIPS INSULATION
AS SPECIFIED INSULATE TO
UNDERSIDE OF BOWL AND
MIN. 8 FT. ALONG PIPE

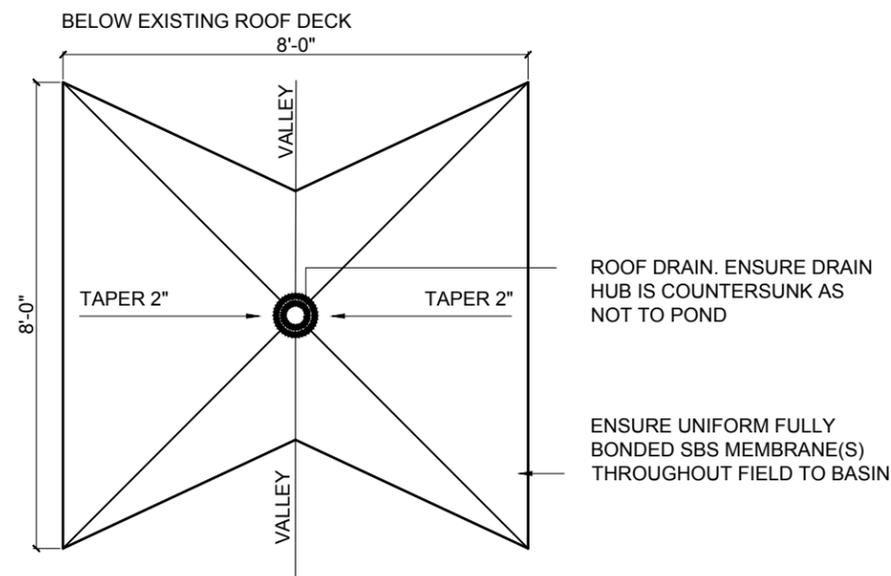

4 Typical Drain Sump

A1.4 Scale: NTS

Partial Roof Replacement

Project Address 752 McGee Street
Winnipeg, Manitoba
BID # 168-2022

Client JDB Building Envelope
Specialists
Winnipeg, Manitoba
www.buildingenvelope.biz
204.371.0996

Drawing

DETAILS