

NOTE: 1



NOTE: 4, 5




NOTE: 1, 4, 8



∕1∖



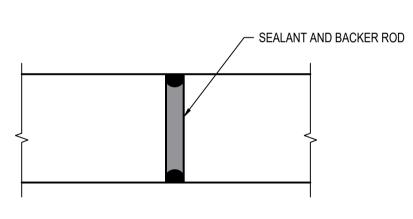


3 PARAPET COPING STONE JOINT REPAIR B0002 B0002 NOT TO SCALE



DOOR 9

					A = 4	
					AE	
						CHECKE
					K. SIDDALL	
					DRAWN BY: G.PROFETA	APPRO
					SCALE:	RELEAS
						BY:
1	ISSUED FOR ADDENDUM 4	2022-11-14	KS	MH	DATE: 2022-11-14	DATE:
0	ISSUED FOR CONSTRUCTION	2022-10-11	KS	MH	CONSULTANT NO.:	
NO.	REVISIONS	DATE	DESIGN	CHECK	60661011	-

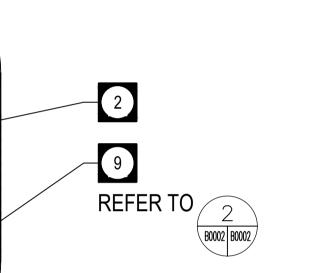

3 6 7 10



NOTE: 3

TACHE SURGE TOWER REPAIR LEGEND

KEYNOTE REMEDIATION ACTION

	RETIONER REMEDIATION ACTION
1	DEMOLISH AND REMOVE EXISTING ROOFING SYSTEM. REFER TO DETAILED DRAWINGS AND STRUCTURAL DRAWINGS.
2	EXISTING ROOF ACCESS LADDER TO REMAIN. SUPPLY AND INSTALL SIGN "DO NOT USE".
3	RE-POINT ALL DETERIORATED MORTAR JOINTS ON EXTERIOR FACE OF TOWER.
4	RE-POINT ALL PARAPET AND COPING STONE JOINTS. REMOVE AS MUCH BLACK TAR FROM STONE SURFACES AT PARAPET AND CORNICE STONES AS POSSIBLE, VIA NON-DESTRUCTIVE OR CHEMICAL MEANS.
5	REPAIR ALL HOLES ON THE CORNICE AND PARAPET STONE.
6	REPLACE ALL BROKEN LIMESTONE OR CLAY BRICK UNITS TO MATCH EXISTING AS CLOSE AS POSSIBLE. SAMPLES TO BE SUBMITTED FOR REVIEW AND APPROVAL PRIOR TO INSTALLATION.
7	REPAIR CHIP AND CRACKS IN STONE AND BRICK UNITS WITH REPAIR PASTE TO MATCH EXISTING AS CLOSE AS POSSIBLE. SAMPLES TO BE SUBMITTED FOR REVIEW AND APPROVAL PRIOR TO INSTALLATION.
8	REPAIR BRICK VENEER AND SALVAGE BRICK VENEER WHERE POSSIBLE AT THE PARTAPET INSIDE FACE . REPLACE VENEER WHEN BRICK VENEER IS POOR. REPAIR MORTAR JOINTS BY REPOINTING.
9	INSTALL NEW FIBERGLASS DOOR AND FRAME. COLOUR TO MATCH EXISTING C/W NEW HARDWARE.
10	BRUSH WASH THE ENTIRE EXTERIOR OF THE TOWER AFTER REPAIRS HAVE BEEN COMPLETED

