


LAST SAVE: 2022/07/13 - 12:21pm
 PATH: \\192.168.0.226\1-0107-015\Projects\2021\21-0107-015\Dwg\Elec\ADDENDUM\1-0101-AILD-F253-001.DWG
 B SIZE - 279mm x 432mm

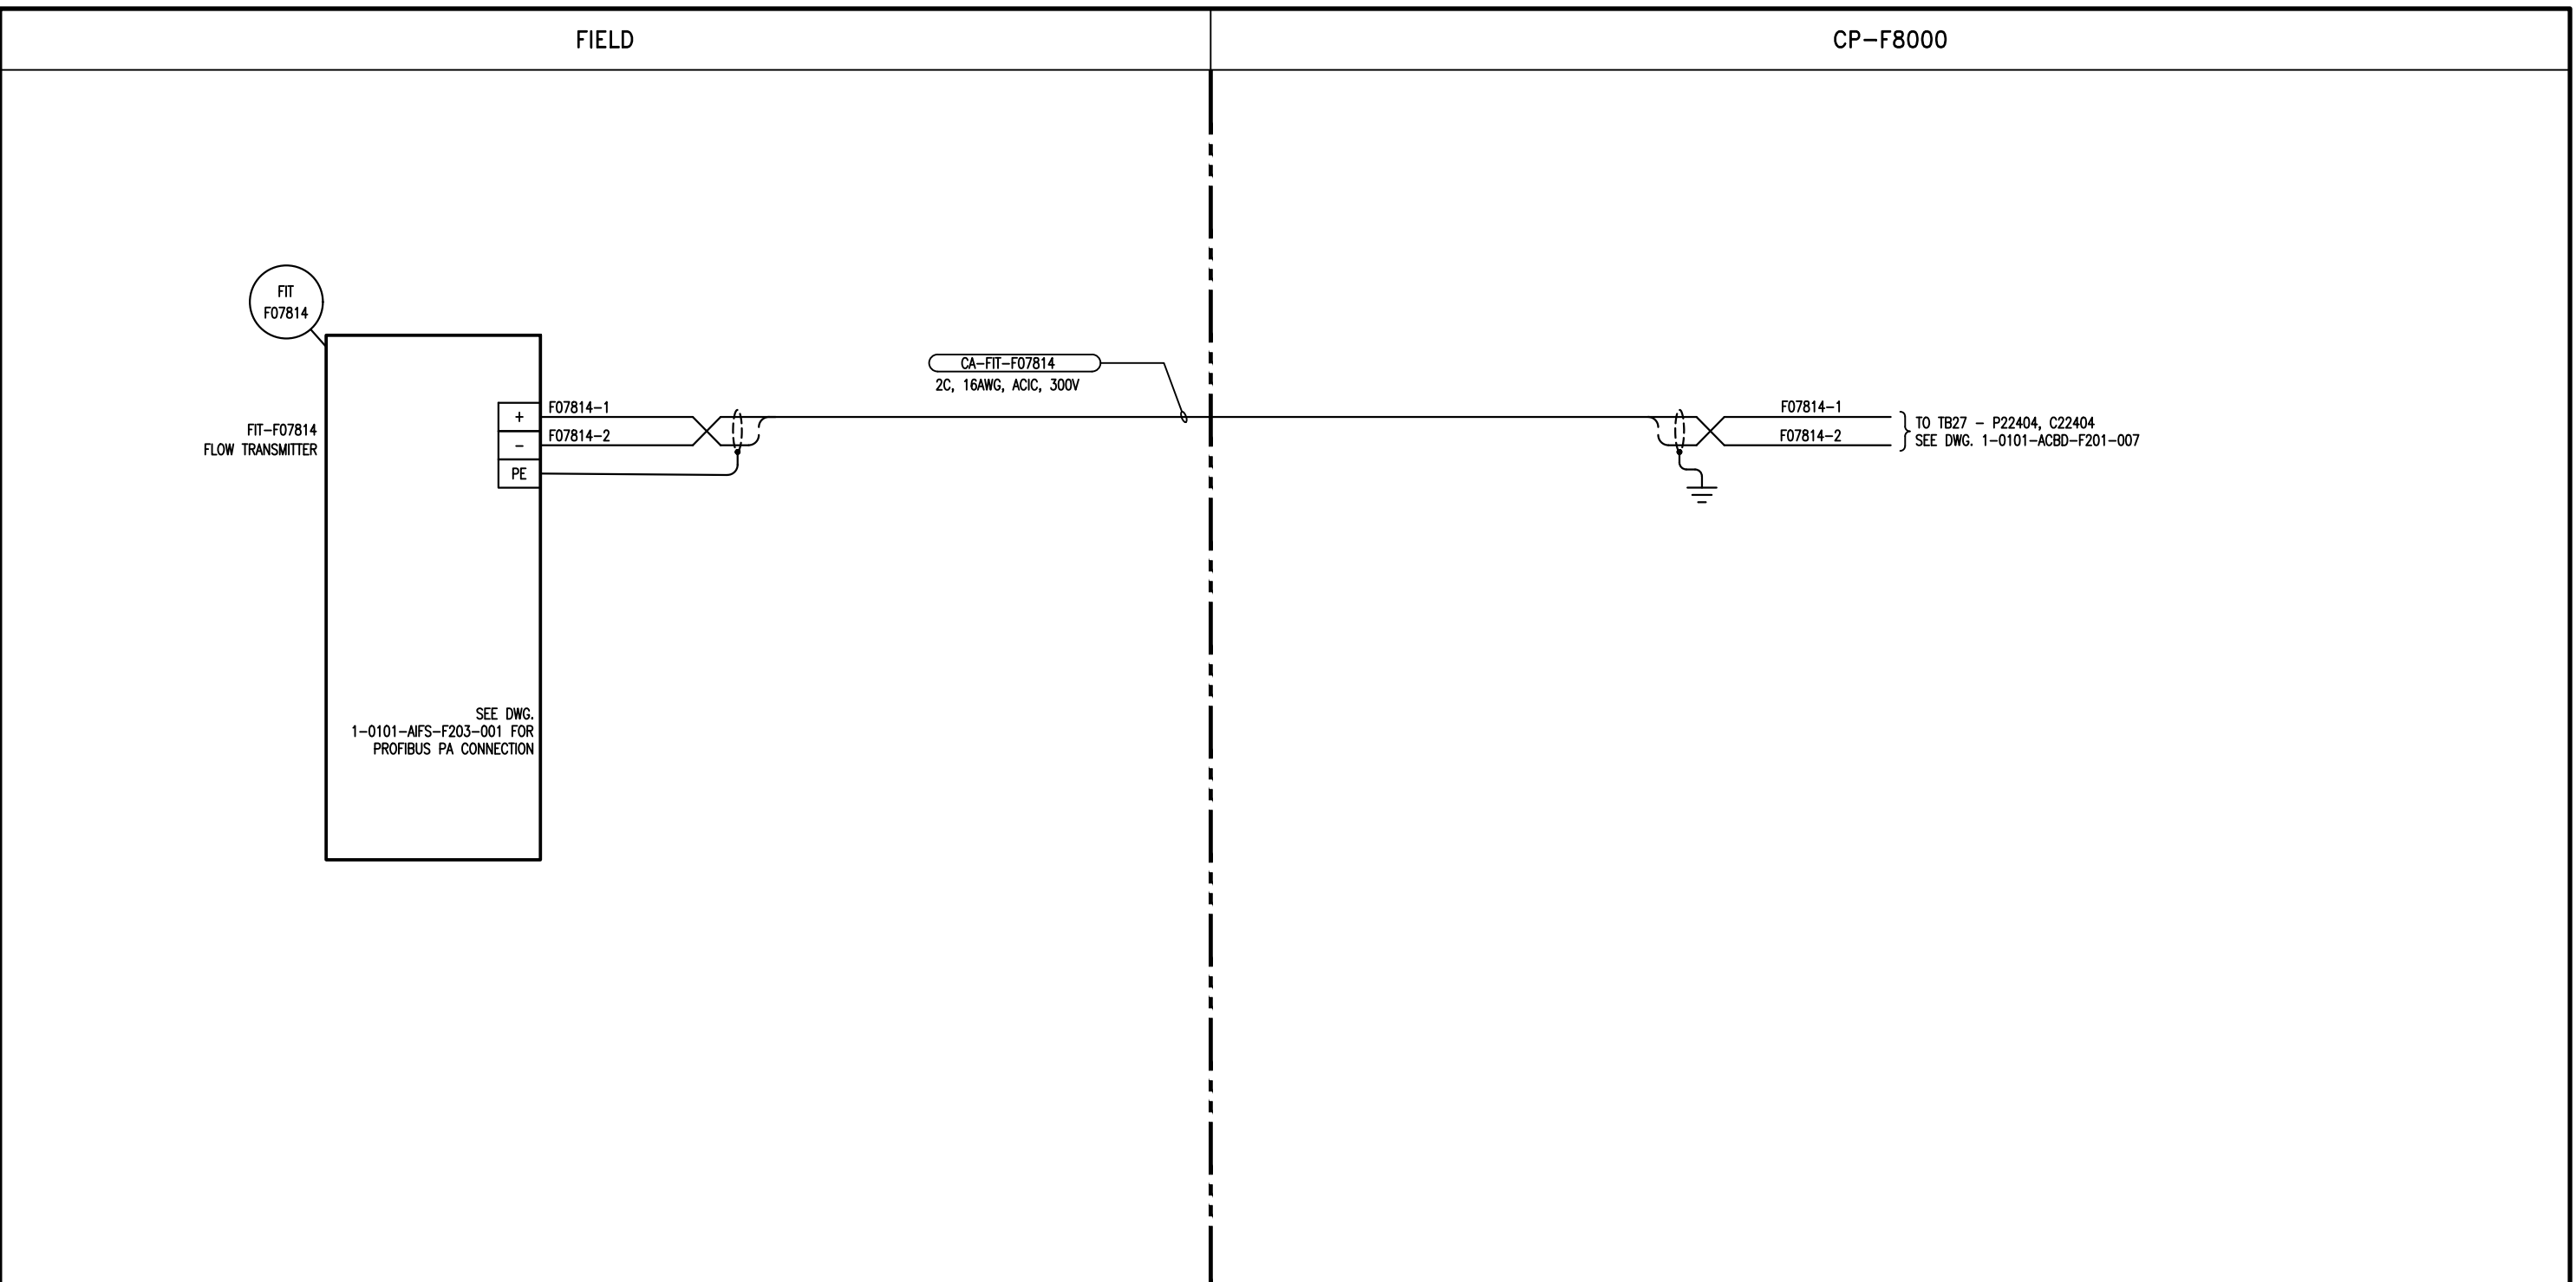

SEE DWG.
1-0101-AFS-F203-001 FOR
PROFIBUS PA CONNECTION

TO TB27 - P22404, C22404
SEE DWG. 1-0101-ACBD-F201-007

NOTES
1. ISOLATE AND TAPE BACK SHIELD AT THIS END ONLY.

**ENGINEERS
GEOSCIENTISTS
MANITOBA**

Certificate of Authorization

KGS Group

No. 245

NO.	REVISIONS	DATE	DESIGN	CHECK
0	ISSUED FOR CONSTRUCTION	2022 07 05	DRS	<i>JRS</i>

KGS GROUP

DESIGNED BY: DRS	CHECKED BY: <i>JRS</i>
DRAWN BY: RG	APPROVED BY: <i>JRS</i>
SCALE: NTS	DATE:
ISSUED FOR CONSTRUCTION	
BY:	DATE:
CONSULTANT NO.: 21-0107-015_A6.232	

ENGINEER'S SEAL

THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT
ENGINEERING DIVISION

NORTH END SEWAGE TREATMENT PLANT (NEWPCC)
INTERIM PHOSPHOROUS REMOVAL
BUILDING 101
AUTOMATION - LOOP DRAWING
FIT-F07814 FERRIC CHLORIDE UNLOADING FLOW METER

CITY DRAWING NUMBER	SHEET	REV.	SIZE
1-0101-AILD-F253-001	001	0	B