



LAST SAVE: 2022/07/13 - 12:23pm
 PATH: \\192.168.0.226\1-data\Projects\2021\21-0107-015\Dwg\Elec\ADDENDUM\1-0101-AILD-F266-001.DWG
 B SIZE - 279mm x 432mm

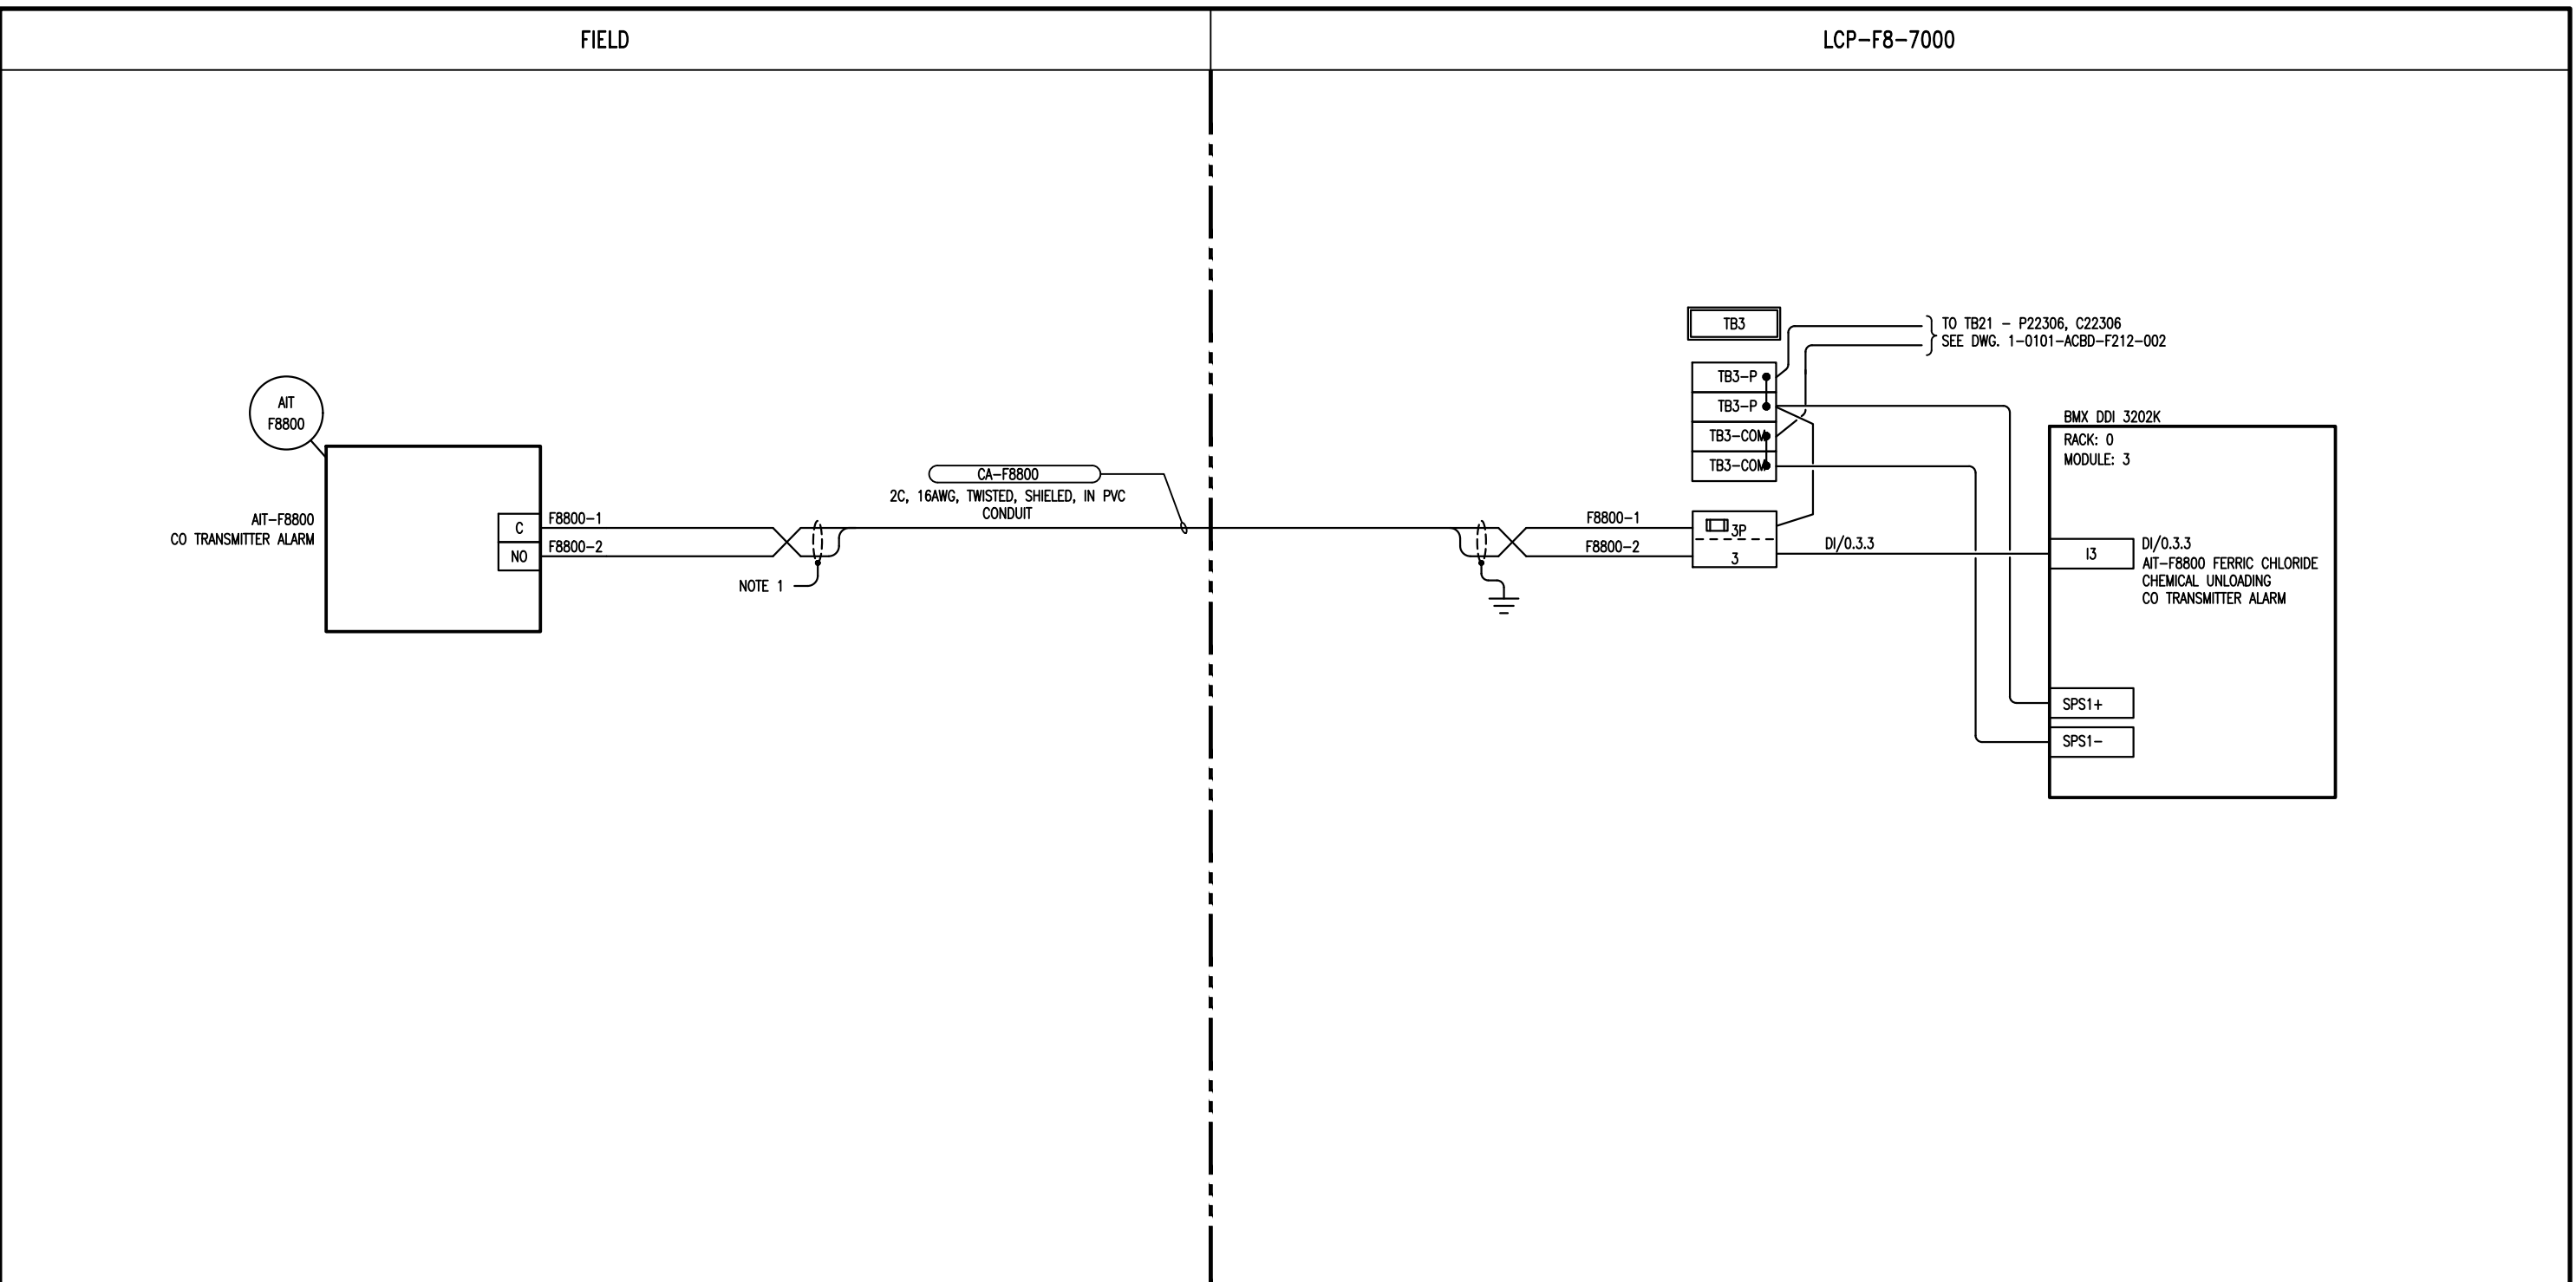

NOTES
 1. ISOLATE AND TAPE BACK SHIELD AT THIS END ONLY.

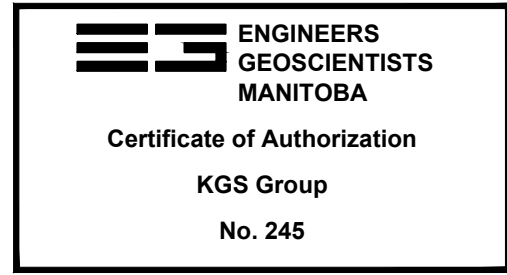

NO.	REVISIONS	DATE	DESIGN	CHECK
0	ISSUED FOR CONSTRUCTION	2022 07 05	DRS	<i>JRS</i>

KGS GROUP

DESIGNED BY: DRS
 CHECKED BY: *JRS*
 DRAWN BY: RG
 APPROVED BY: *JRS*
 SCALE: NTS
 DATE:
 ISSUED FOR CONSTRUCTION
 BY: DATE:
 CONSULTANT NO.:
 21-0107-015_A6.221

ENGINEER'S SEAL

THE CITY OF WINNIPEG
 WATER AND WASTE DEPARTMENT
 ENGINEERING DIVISION

NORTH END SEWAGE TREATMENT PLANT (NEWPC)
 INTERIM PHOSPHOROUS REMOVAL
 AUTOMATION - LOOP DRAWING
 BUILDING 101 - AIT-F8800 ALARM INDICATING TRANSMITTER

CITY DRAWING NUMBER	SHEET	REV.	SIZE
1-0101-AILD-F266-001	001	A	B