


FILTER/OZONE/RESIDUAL
WEEPING TILE MANHOLE
(EXISTING MH - FOR)

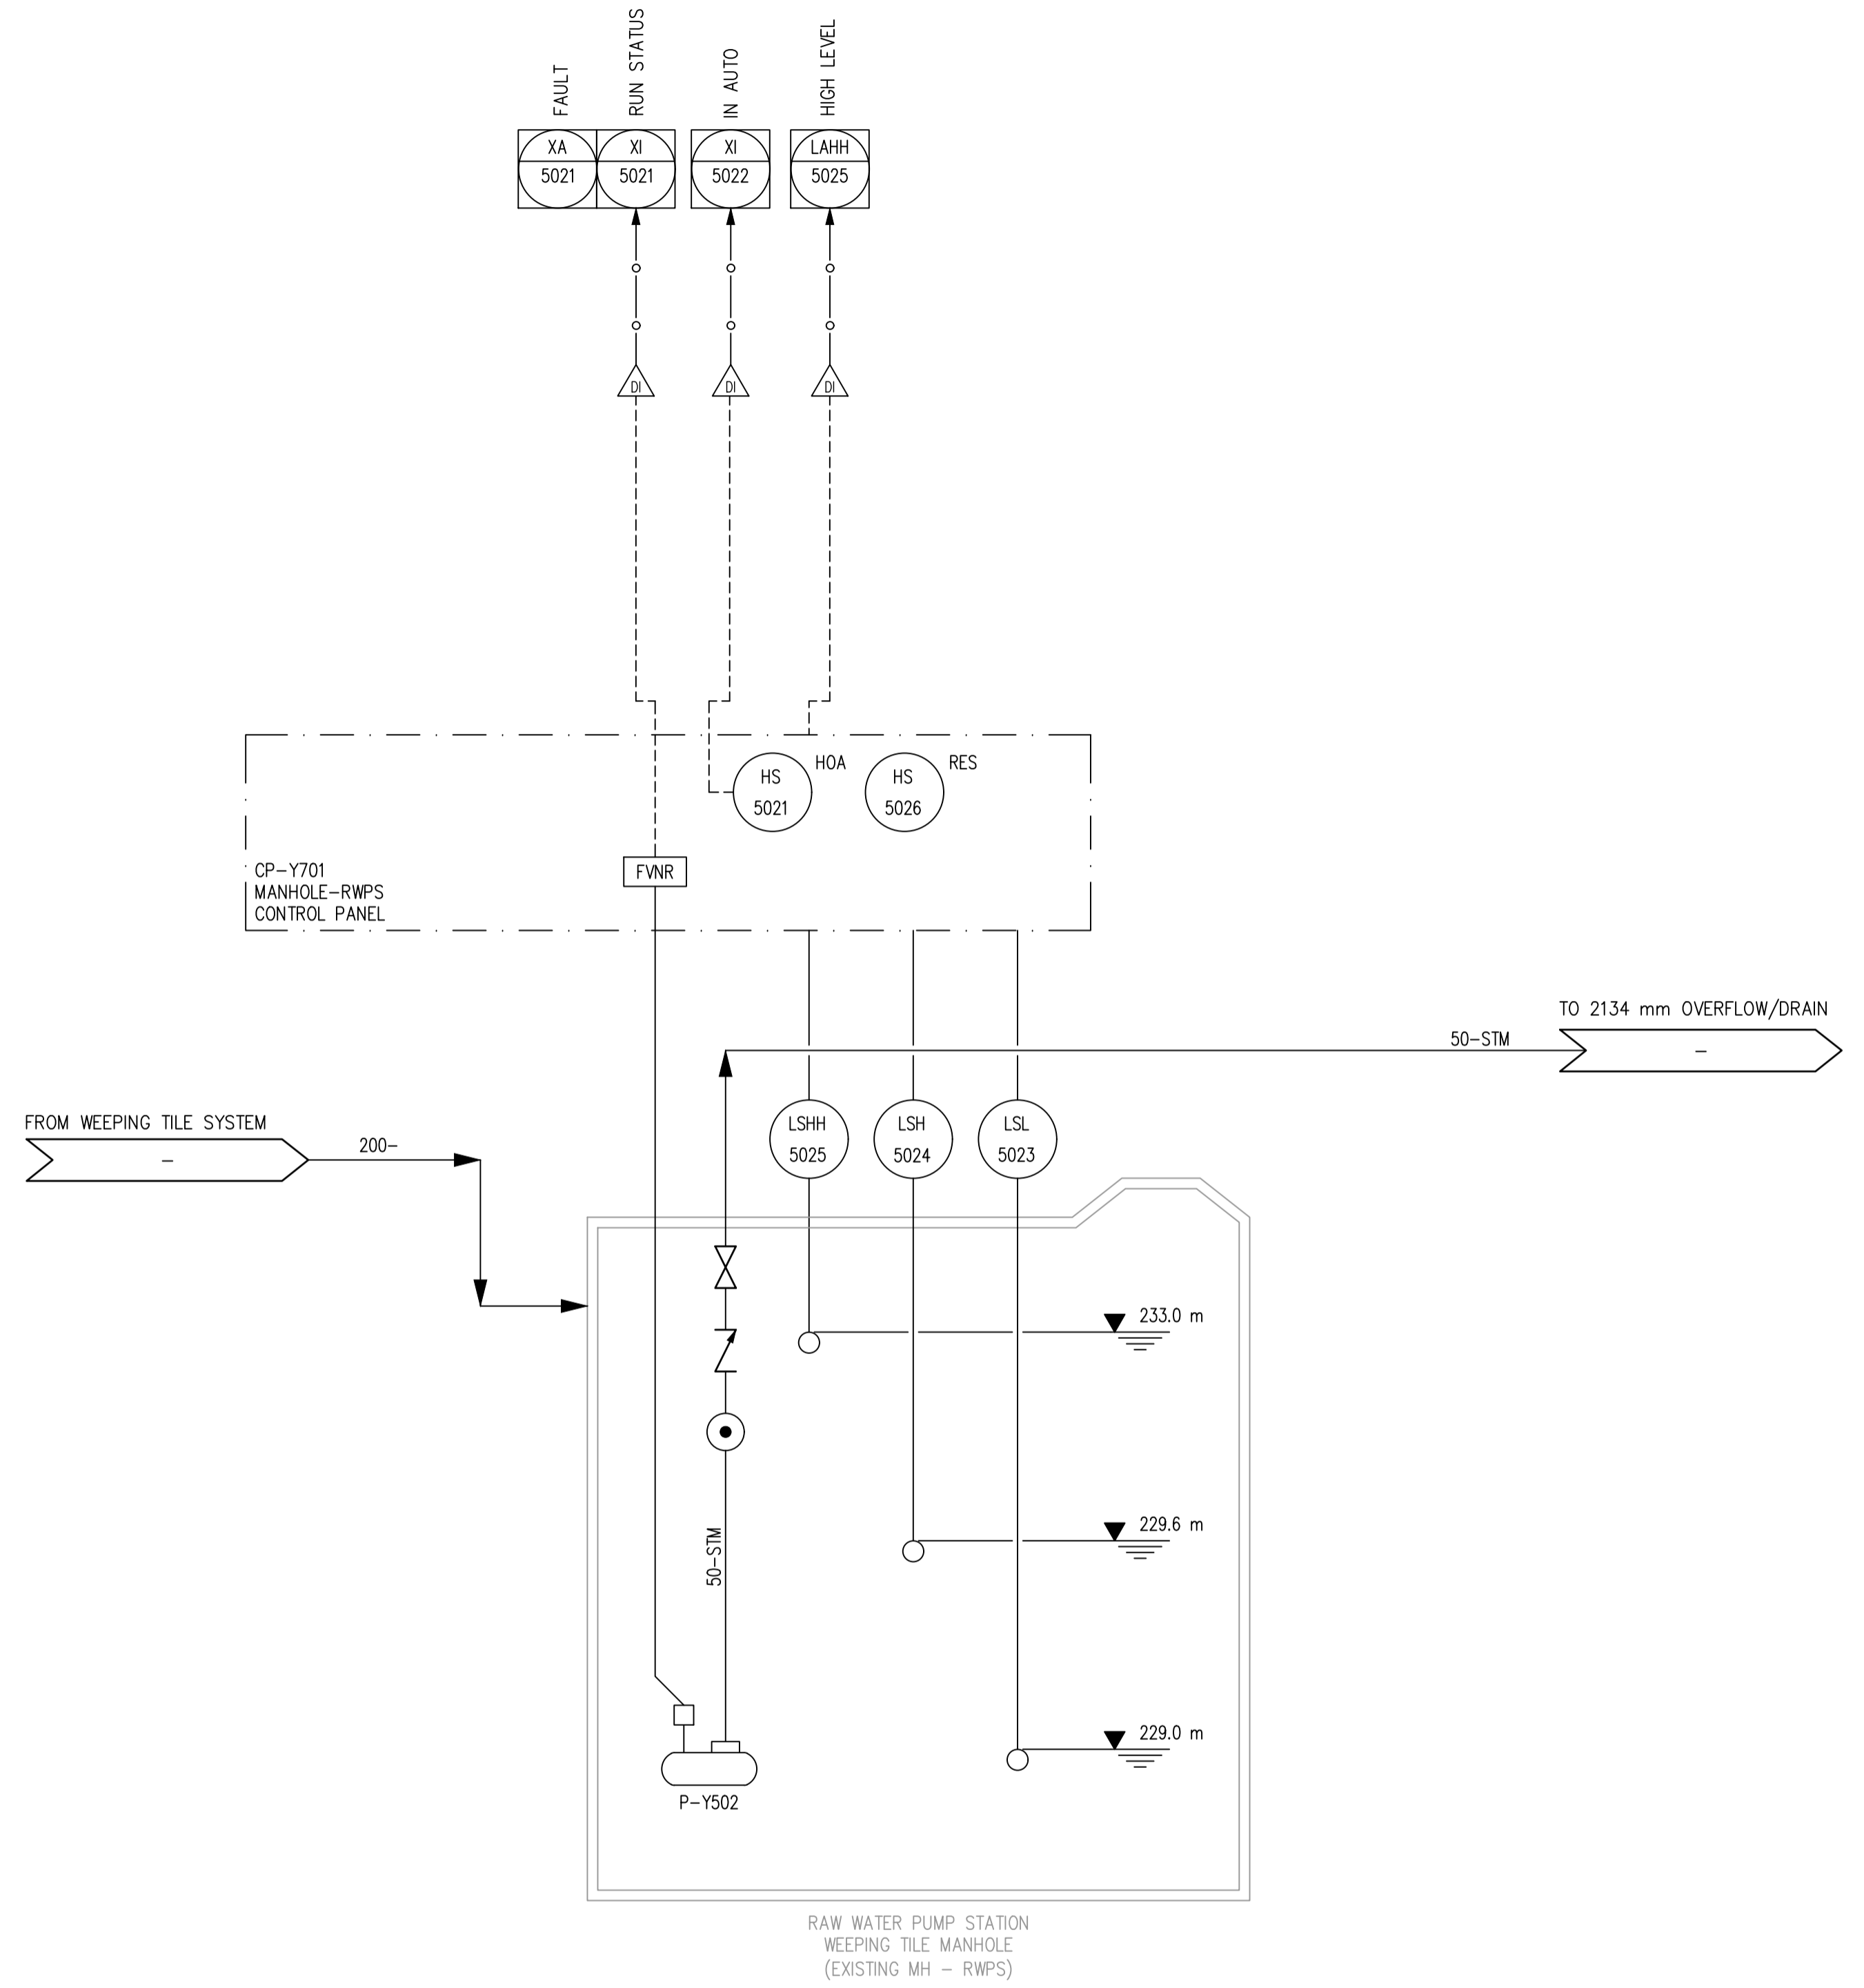

RAW WATER PUMP STATION
WEEPING TILE MANHOLE
(EXISTING MH - RWPS)

GENERAL NOTE:
1. GREY LINETYPE DENOTES EXISTING.

**ENGINEERS
GEOLOGISTS
MANITOBA**
Certificate of Authorization
AECOM Canada Ltd.
No. 4671 Date: 2022-09-07

METRIC
WHOLE NUMBERS INDICATE MILLIMETRES
DECIMALIZED NUMBERS INDICATE METRES

NO.	REVISIONS	DATE	DESIGN	CHECK
PD	ISSUED FOR CONSTRUCTION	22/09/07	CR	MM
PC	ISSUED FOR 90%	22/07/18	CR	MM
PB	ISSUED FOR 30%	22/04/14	MG	MM
PA	ISSUED FOR 30% REVIEW	22/02/25	CR	MM

AECOM

DESIGNED BY: CR CHECKED BY: MGM
 DRAWN BY: PA APPROVED BY: KWF

SCALE: AS SHOWN RELEASED FOR CONSTRUCTION
 DATE: 2022-09-07 BY: MATTHEW SKINNER
 DATE: 2022-09-08

CONSULTANT NO.: P-0002

ENGINEER'S SEAL
 ORIGINAL SIGNED
 BY M.P.A
 GAUDREAU
 SEPTEMBER 7,
 2022

THE CITY OF WINNIPEG
 WATER AND WASTE DEPARTMENT

WATER TREATMENT PLANT - FLOOD PROTECTION
 BOOSTER PUMP STATION
 PROCESS & INSTRUMENTATION
 DIAGRAM
 WTP UNDERDRAIN MANHOLES

CITY DRAWING NUMBER: 1-0601B-P0002-001 SHEET: 009 REV.: PD SIZE: A1