

FIELD DEVICE PANEL (A1)

PRIMARY EFFLUENT FLOW

REACTORS VENDOR CONTROL PANEL

GENERAL NOTES:

1. FINAL LOCATION OF CP-R8001. 2. COILDED FIBRE FOR NSW-R9110

INTEGRATOR NOTES:

- 1. SEE SPECIFICATION 40 90 00 FOR SCOPE.
- 2. INTEGRATOR SCOPE IS TO BUILD AND CONFIGURE THE PANEL. PROVIDE AND CONFIGURE NEW PCS OPERATOR WORKSTATION.
- 3. 4. DECOMMISSION AND SALVAGE DCS WORKSTATION ONCE ALL PLANT SYSTEMS ARE ON THE PCS.
- 5. PROVIDE NEW PERMANENT WORKSTATION DESK.


CONTRACTOR NOTES:

- 1. SEE SPECIFICATION 26 05 10 FOR SCOPE.
- 2. CONTRACTOR SCOPE IS TO INSTALL PANEL AND PANEL POWER FEEDS. 3. DISCONNECT AND REMOVE ALL WIRING BETWEEN EXISTING DCS AND FIELD
- DEVICE PANELS, REMOVE EXISTING CABLE SUPPORTS, CONDUITS, CABLE TRAY BETWEEN THE PANELS AS NEEDED TO PROVIDE NEW CABLE ROUTING FOR PLC PANEL. 4. DISCONNECT AND REMOVE POWER CABLES FROM DCS PANEL, MARK THE
- POWER SOURCE AS SPARE. 5. DEMOLISH AND REMOVE POWER CABLES FROM DCS PANEL, COORDINATE WITH THE CITY TO SALVAGE THE EXISTING DCS PANEL.
- 6. SEE APPENDIX A DCS MIGRATION PLAN FOR SEQUENCE.
- 7. APPROXIMATE DISTANCE TO POWER PANEL IS 8m. GIVEN DISTANCE IS APPROXIMATE, CONTRACTOR IS RESPONSIBLE FOR LOCATING POWER PANEL DURING SITE TOUR PRIOR TO BID AND ALLOWING FOR ENOUGH CABLING. 8. PROVIDE AND INSTALL TEMPORARY CABLING BETWEEN FIELD DEVICE AND NEW
- PLC PANELS DURING THE DEMOLITION OF DCS PANEL. 9. PROVIDE AND INSTALL NEW CABLING AND CONDUITS AS NEEDED FOR ALL SIGNAL CONNECTION BETWEEN FIELD DEVICE PANEL AND NEW PLC PANEL.

500 1000

)	50	0	10	000			
				mm			
1:20							

			KEY PLAN							ĊO
									DESIGNED BY:	CHECKE
									DRAWN BY: RC	APPROV
									SCALE: AS NOTED	RELEAS BY:
1	PANEL LAYOUT REACTORS CONTROL PANEL - CP-R8001	1-0101-ACBD-R101		1	ISSUED FOR GC TENDER	2024-01-08	KG	SDS	DATE: 2024-01-08	DATE:
REF. NO.	DRAWING TITLE	DRAWING NUMBER	N STATION	0	ISSUED FOR TENDER	2023-03-17	KG	SDS	CONSULTANT NO.:	
	REFERENCE DRAWING			NO.	REVISIONS	DATE		I CHECK		

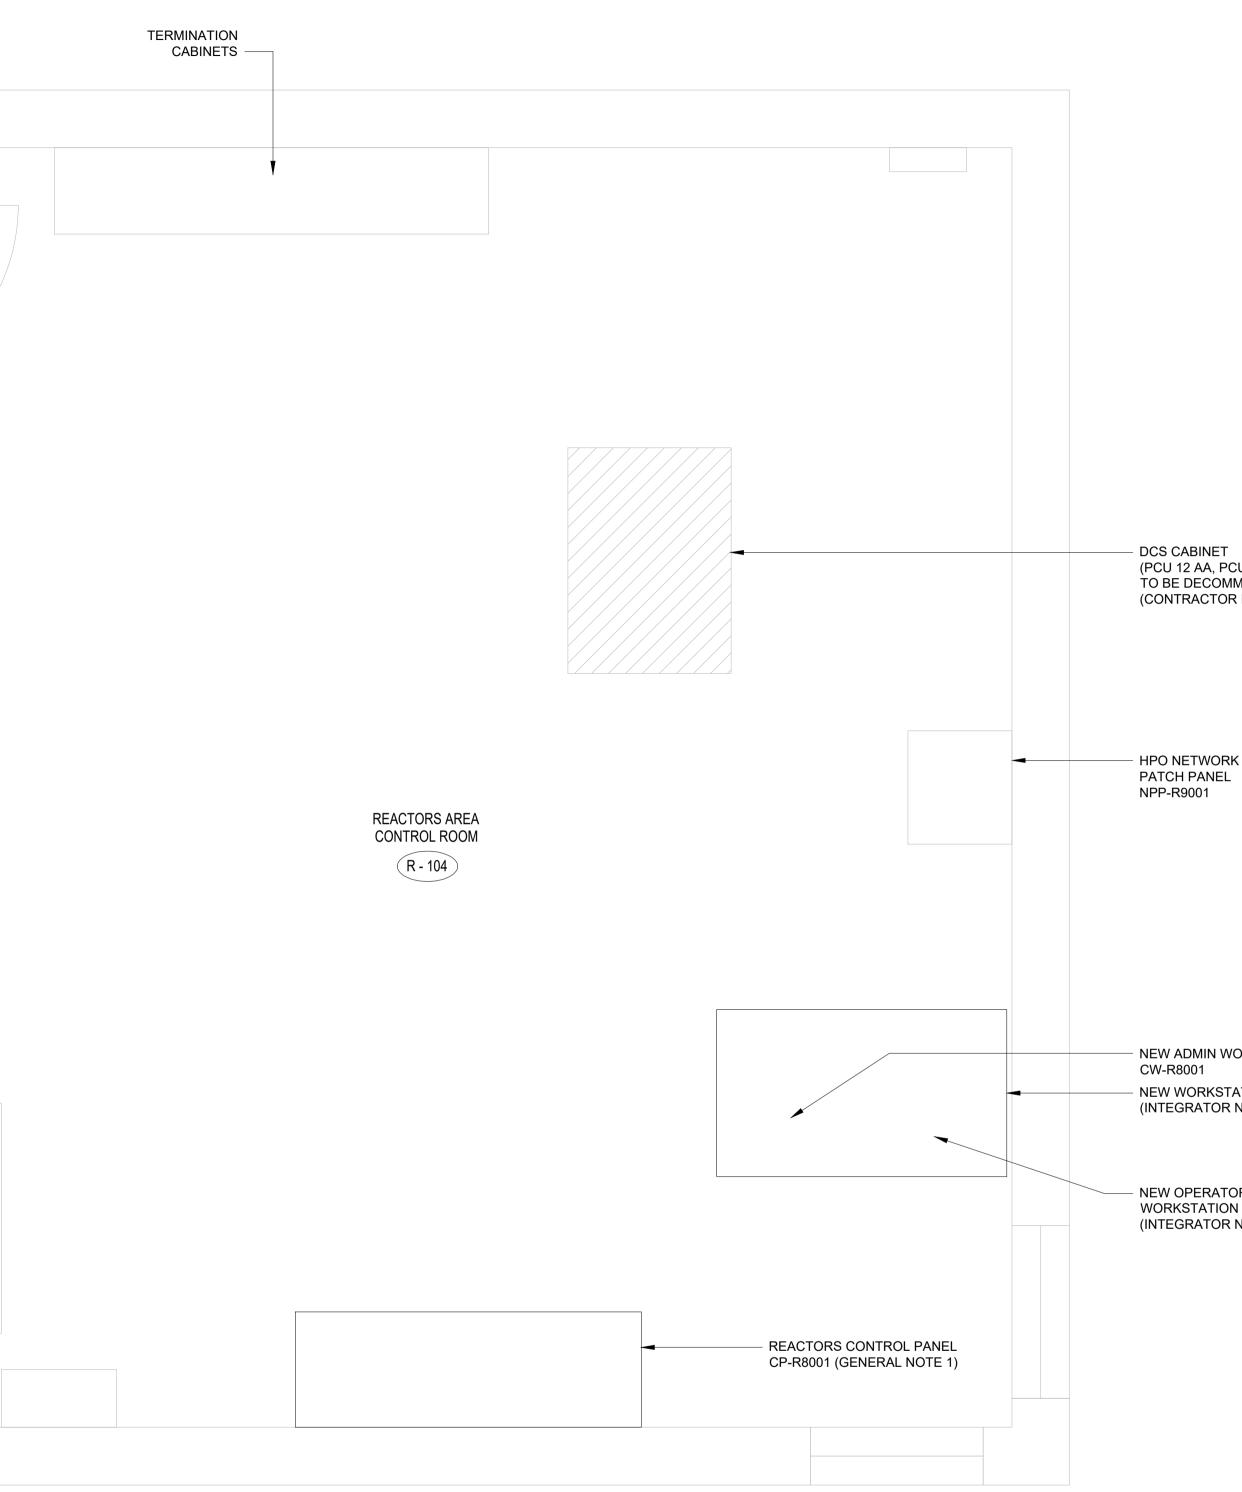

REACTORS AREA CONTROL ROOM



ENGINEERS GEOSCIENTISTS

MANITOBA

NEW OPERATOR WORKSTATION CWO-R8001 (INTEGRATOR NOTE 3)

NEW ADMIN WORKSTATION NEW WORKSTATION DESK (INTEGRATOR NOTE 5)

(PCU 12 AA, PCU 13 AB) TO BE DECOMMISIONED (CONTRACTOR NOTE 3)