



CP-C8001 (CONTRACTOR NOTE 1)

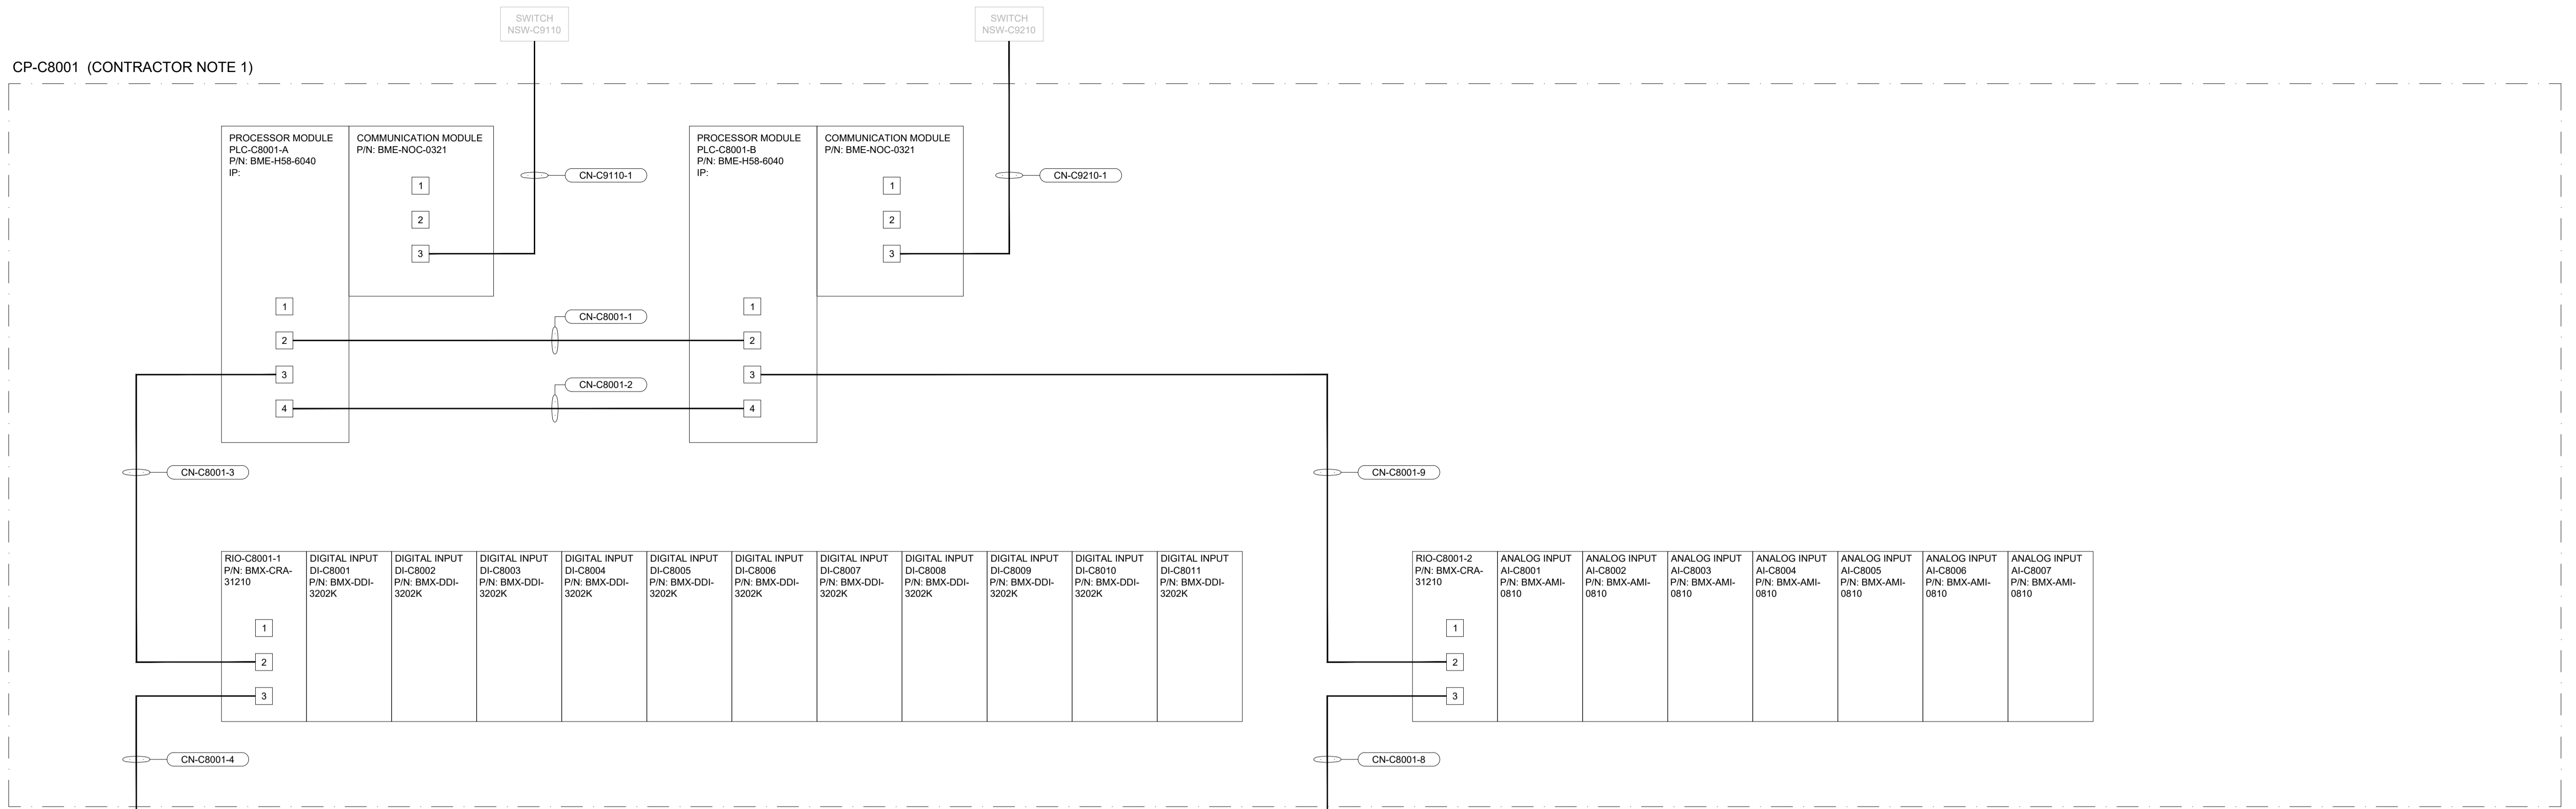


CP-C8002

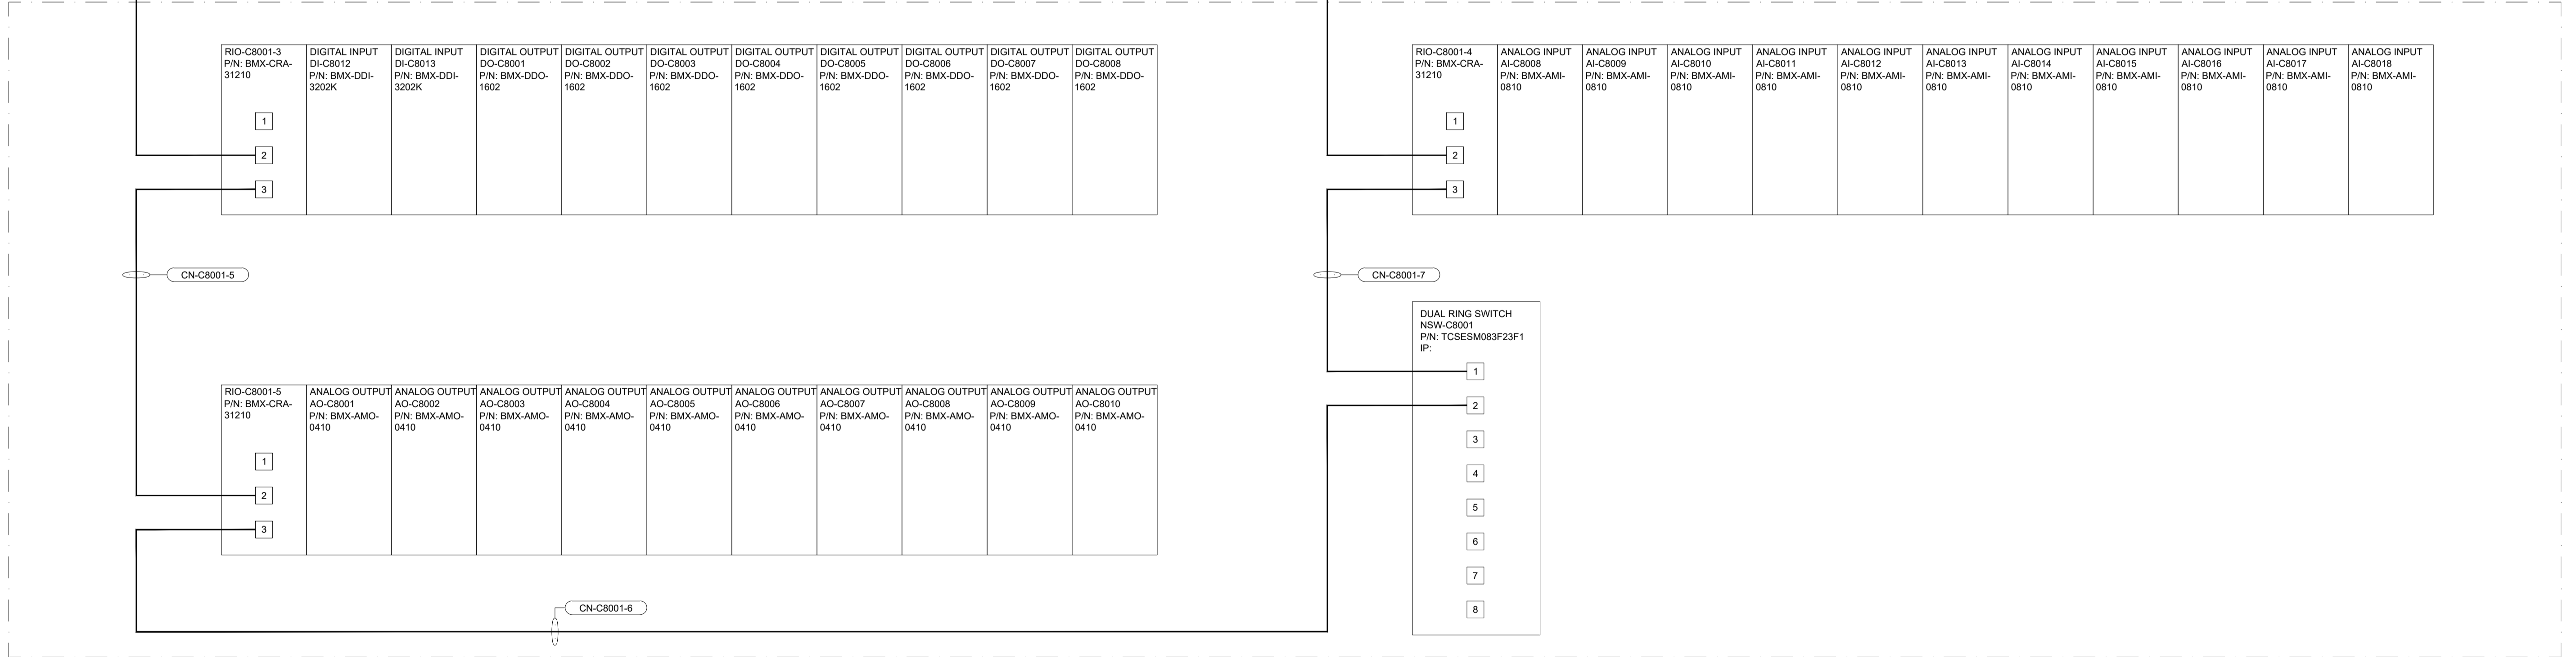

- NOTES:**
- ALL CABLES ARE CAT-6, SHIELDED ETHERNET CABLES UNLESS OTHERWISE NOTED.
 - GREYED OUT ITEMS INDICATE EXISTING EQUIPMENT OR DEVICES.
- CONTRACTOR NOTES:**
- CONTRACTOR SCOPE IS LIMITED TO THE FOLLOWING:
 - PROVIDE CAT-6 COMMUNICATION CABLES BETWEEN NETWORK SWITCHES AND PLC PANEL.
 - PROVIDE AND INSTALL CAT-6 COMMUNICATION CABLES IN SEPARATE CONDUITS TO PROVIDE REDUNDANCY PATH FOR EACH CABLE

REF. NO.	DRAWING TITLE	DRAWING NUMBER	NO.	REVISIONS	DATE	DESIGN	CHECK
4	POWER DISTRIBUTION SCHEMATIC CENTRATE CONTROL PANEL CP-C8002	1-0101-AWDG-C002-001 1-0101-AWDG-C002-002					
3	POWER DISTRIBUTION SCHEMATIC CENTRATE CONTROL PANEL CP-C8001	1-0101-AWDG-C001-001 1-0101-AWDG-C001-002					
2	CENTRATE PANEL LAYOUT DIAGRAM	1-0101-ACBD-C101-001					
1	CENTRATE AREA CONTROL ROOM	1-0101-AGAD-C001-001					
1	ISSUED FOR GC TENDER		2024-01-08	KG	SDS		
0	ISSUED FOR TENDER		2023-03-17	KG	SDS		

DESIGNED BY:	KG	CHECKED BY:	SDS
DRAWN BY:	RC	APPROVED BY:	SB
SCALE:	NTS	RELEASED FOR CONSTRUCTION BY:	
DATE:	2024-01-08	DATE:	
CONSULTANT NO.:			

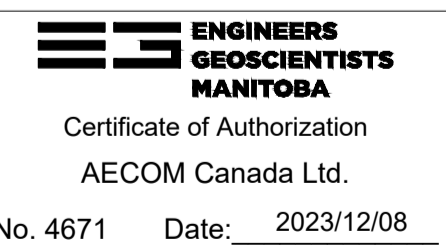

THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT

NORTH END SEWAGE TREATMENT PLANT
DCS MIGRATION
NETWORK DIAGRAM
CENTRATE PLC DEVICE NETWORK

CITY DRAWING NUMBER: 1-0101-ANET-C101
SHEET: 001
REV: 0A
SIZE: A1