



CP-S8001 (CONTRACTOR NOTE 1)

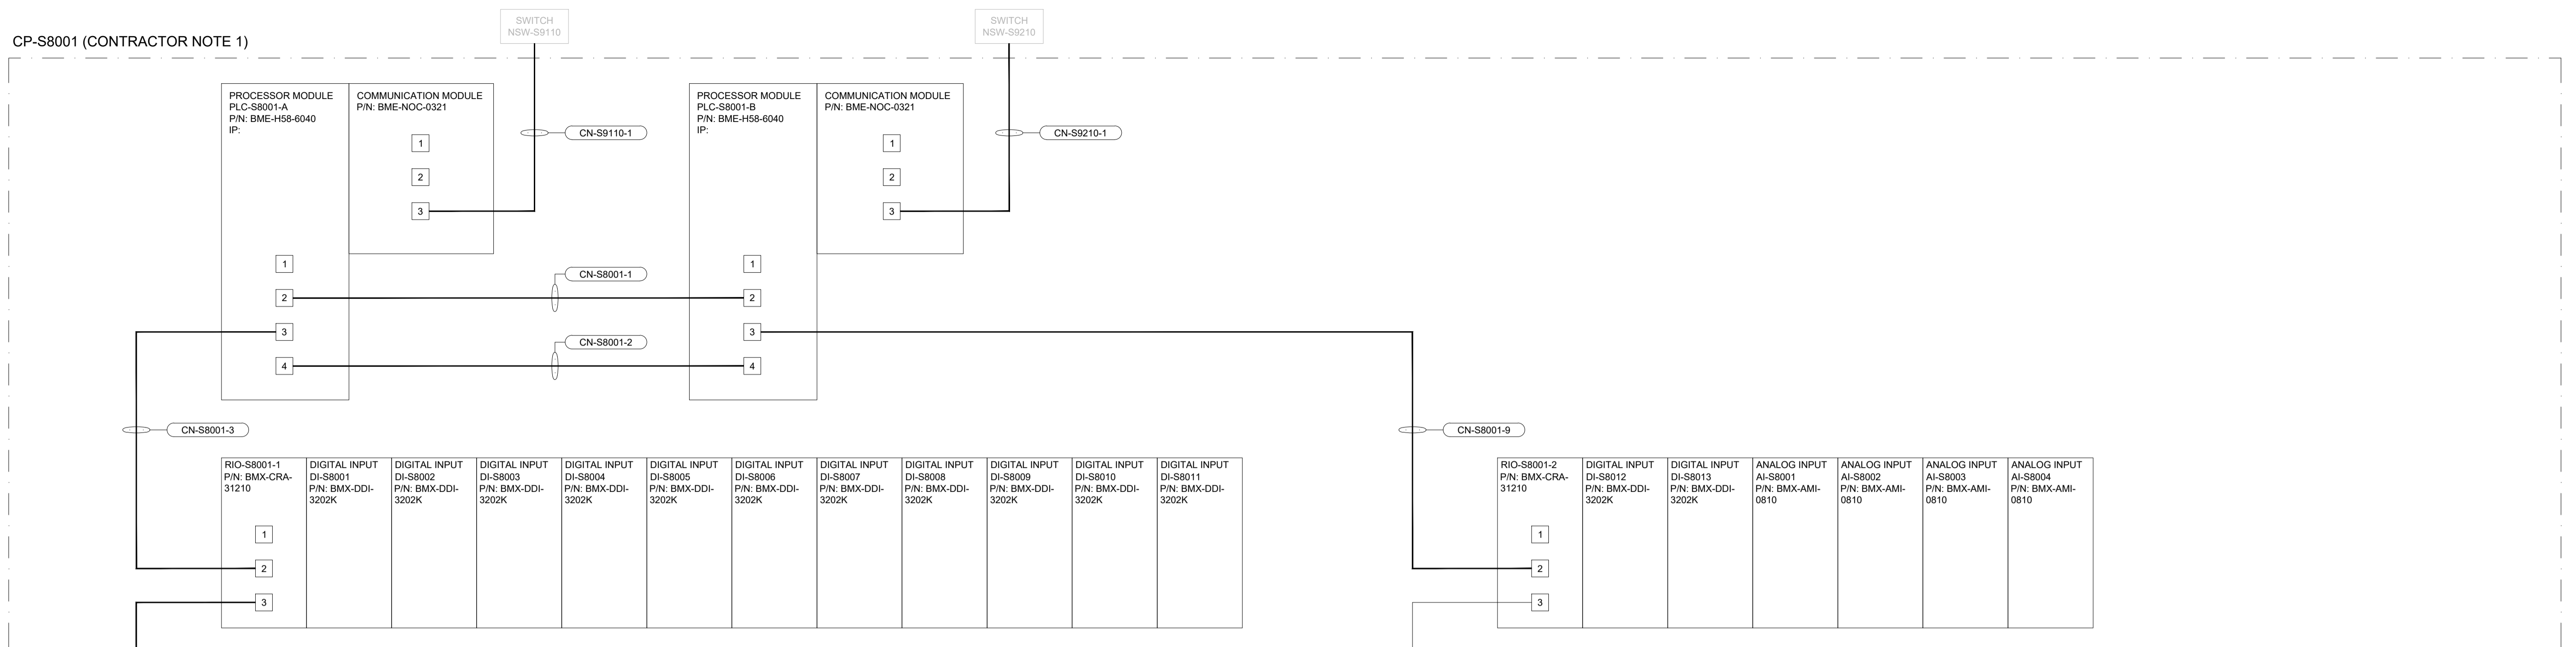

CP-S8002

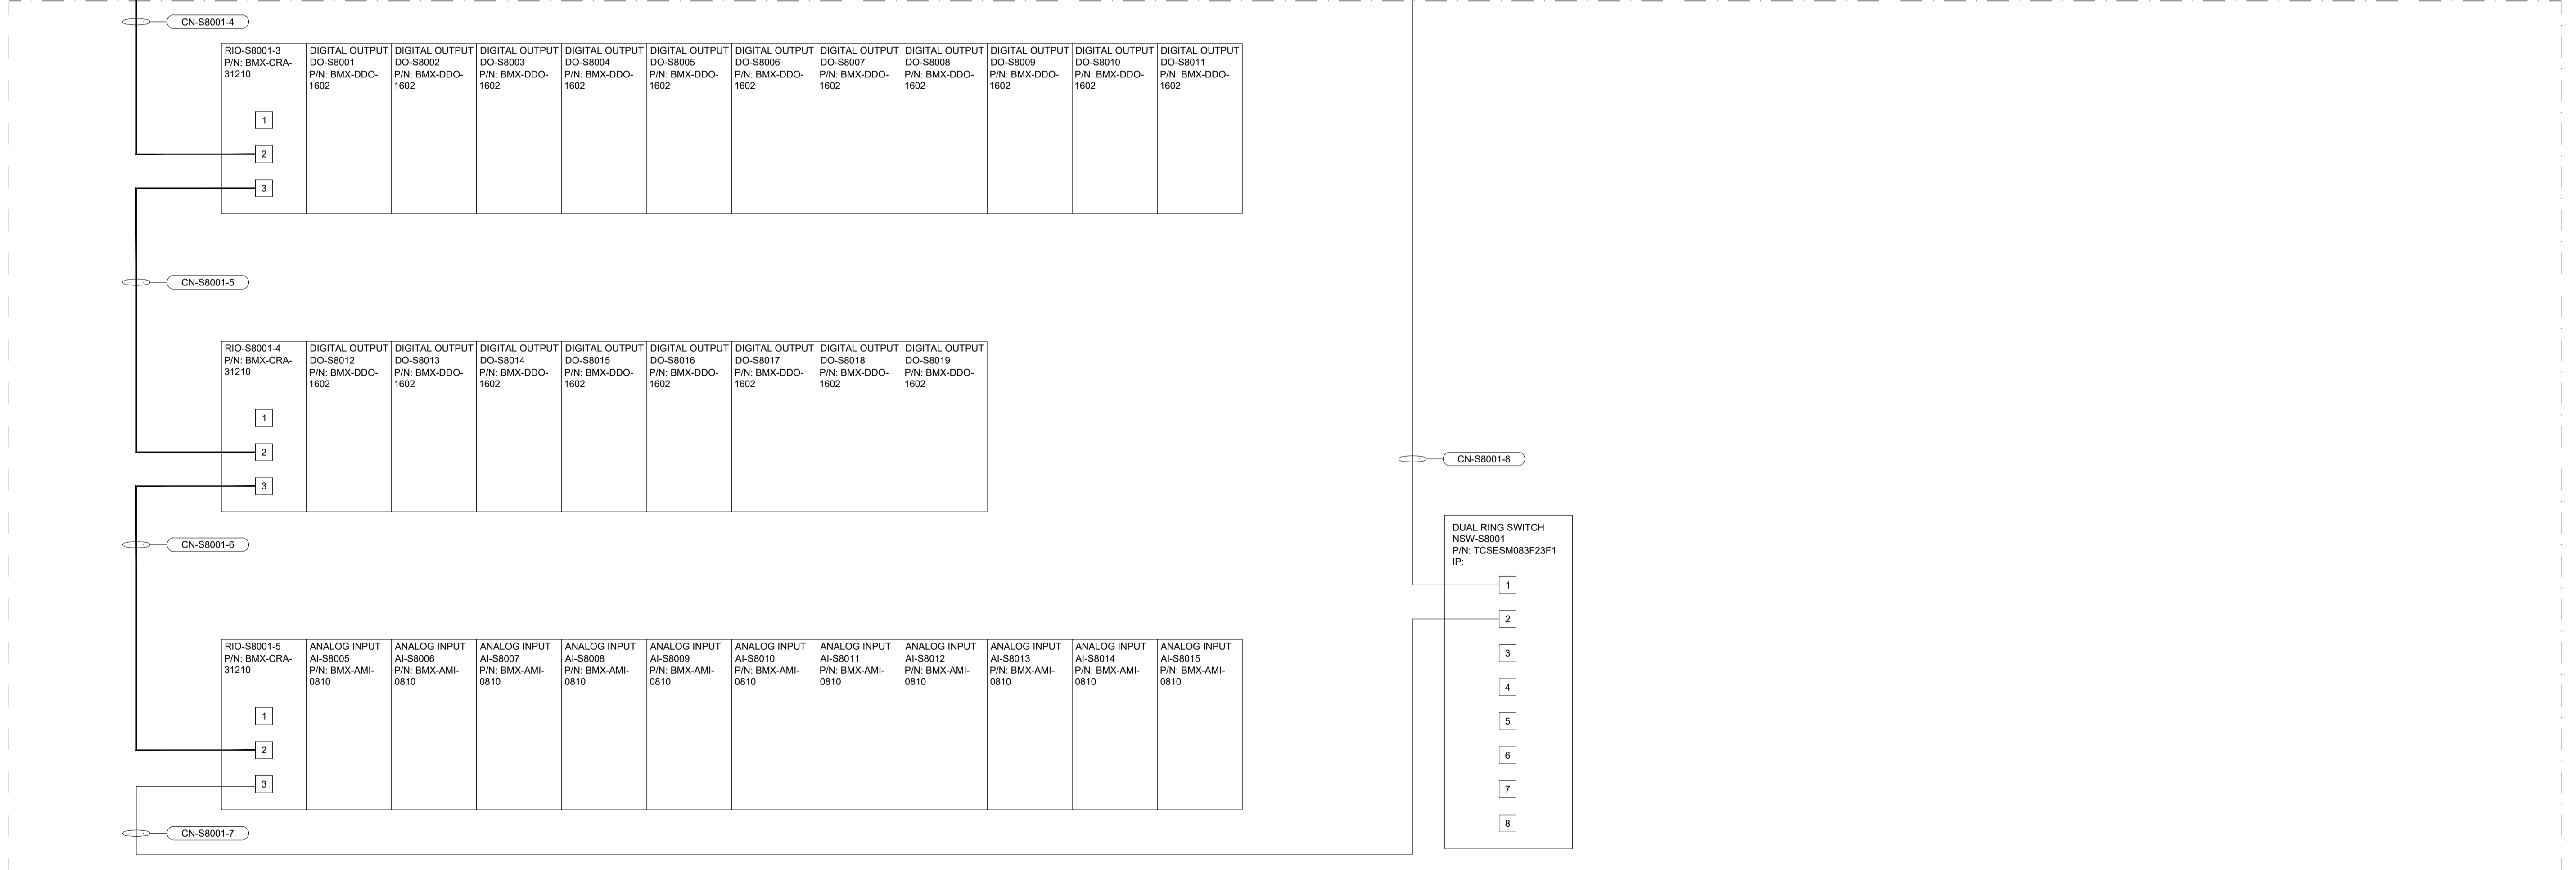

NOTES:

1. ALL CABLES ARE CAT-6, SHIELDED ETHERNET CABLES UNLESS OTHERWISE NOTED.
2. GREYED OUT ITEMS INDICATE EXISTING EQUIPMENT OR DEVICES.

CONTRACTOR NOTES:

1. CONTRACTOR SCOPE IS LIMITED TO THE FOLLOWING:
 - 1.1. PROVIDE CAT-6 COMMUNICATION CABLES BETWEEN NETWORK SWITCHES AND PLC PANEL.
 - 1.2. PROVIDE AND INSTALL CAT-6 COMMUNICATION CABLES IN SEPARATE CONDUITS TO PROVIDE REDUNDANCY PATH FOR EACH CABLE

REF. NO.	DRAWING TITLE	DRAWING NUMBER	NO.	REVISIONS	DATE	DESIGN	CHECK
5	POWER DISTRIBUTION SCHEMATIC SECONDARY CLARIFIER CONTROL PANEL CP-S8003	1-0101-AWDG-S003-001 1-0101-AWDG-S003-002					
4	POWER DISTRIBUTION SCHEMATIC SECONDARY CLARIFIER CONTROL PANEL CP-S8002	1-0101-AWDG-S002-001 1-0101-AWDG-S002-002					
3	POWER DISTRIBUTION SCHEMATIC SECONDARY CLARIFIER CONTROL PANEL CP-S8001	1-0101-AWDG-S001-001 1-0101-AWDG-S001-002					
2	SECONDARY CLARIFIER PANEL LAYOUT DIAGRAM	1-0101-ACBD-S101-001					
1	SECONDARY CLARIFIER AREA CONTROL ROOM	1-0101-AGAD-S001-001					
1	ISSUED FOR GC TENDER		2024-01-08	KG	SDS		
0	ISSUED FOR TENDER		2023-03-17	KG	SDS		

AECOM

DESIGNED BY: KG
CHECKED BY: SDS

DRAWN BY: RC
APPROVED BY: SB

SCALE: NTS
RELEASED FOR CONSTRUCTION BY:

DATE: 2024-01-08
DATE:

CONSULTANT NO.:



ENGINEERS GEOSCIENTISTS MANITOBA

Certificate of Authorization
AECOM Canada Ltd.
No. 4671 Date: 2023/12/08

THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT

NORTH END SEWAGE TREATMENT PLANT
DCS MIGRATION
NETWORK DIAGRAM
SECONDARY CLARIFIERS PLC DEVICE NETWORK

CITY DRAWING NUMBER: 1-0101-ANET-S101
SHEET: 001
REV: 0A
SIZE: A1