

NOTES :

CONSTRUCTION STANDARDS

TO BE CONSTRUCTED IN ACCORDANCE WITH MANITOBA HYDRO DISTRIBUTION AND SUBTRANSMISSION STANDARDS, LATEST REVISION.
NO MAJOR CHANGE SHALL BE MADE WITHOUT APPROVAL OF THE DESIGN ENGINEER OR DELEGATE.

INSTALL NEW STREET LIGHTS AND CABLE ON ALIGNMENT AS SHOWN.



INSTALL NEW GROUND RODS AS PER CD 50-5

ALL STREET LIGHT CABLE TO BE INSTALLED IN 2" CONDUIT

UPON DISCONNECTION BY MB HYDRO THE CONTRACTOR SHALL INSTALL TEMPORARY #6 OVERHEAD FEED IN ORDER TO MAINTAIN LIGHTING DURING CONSTRUCTION. AT THE END OF CONSTRUCTION TEMPORARY OVERHEAD SHALL BE DISCONNECTED BY THE CONTRACTOR.

U/G SL CABLE TO BE MINIMUM 1.0m AWAY FROM ALL OTHER UTILITIES UNLESS OTHERWISE NOTED

MB HYDRO SHALL CUT, CAP AND ABANDON ORIGINAL FEED TO THE STREET LIGHTS PRIOR TO REMOVAL. ALL FINAL CONNECTIONS WILL BE COMPLETED BY MB HYDRO.

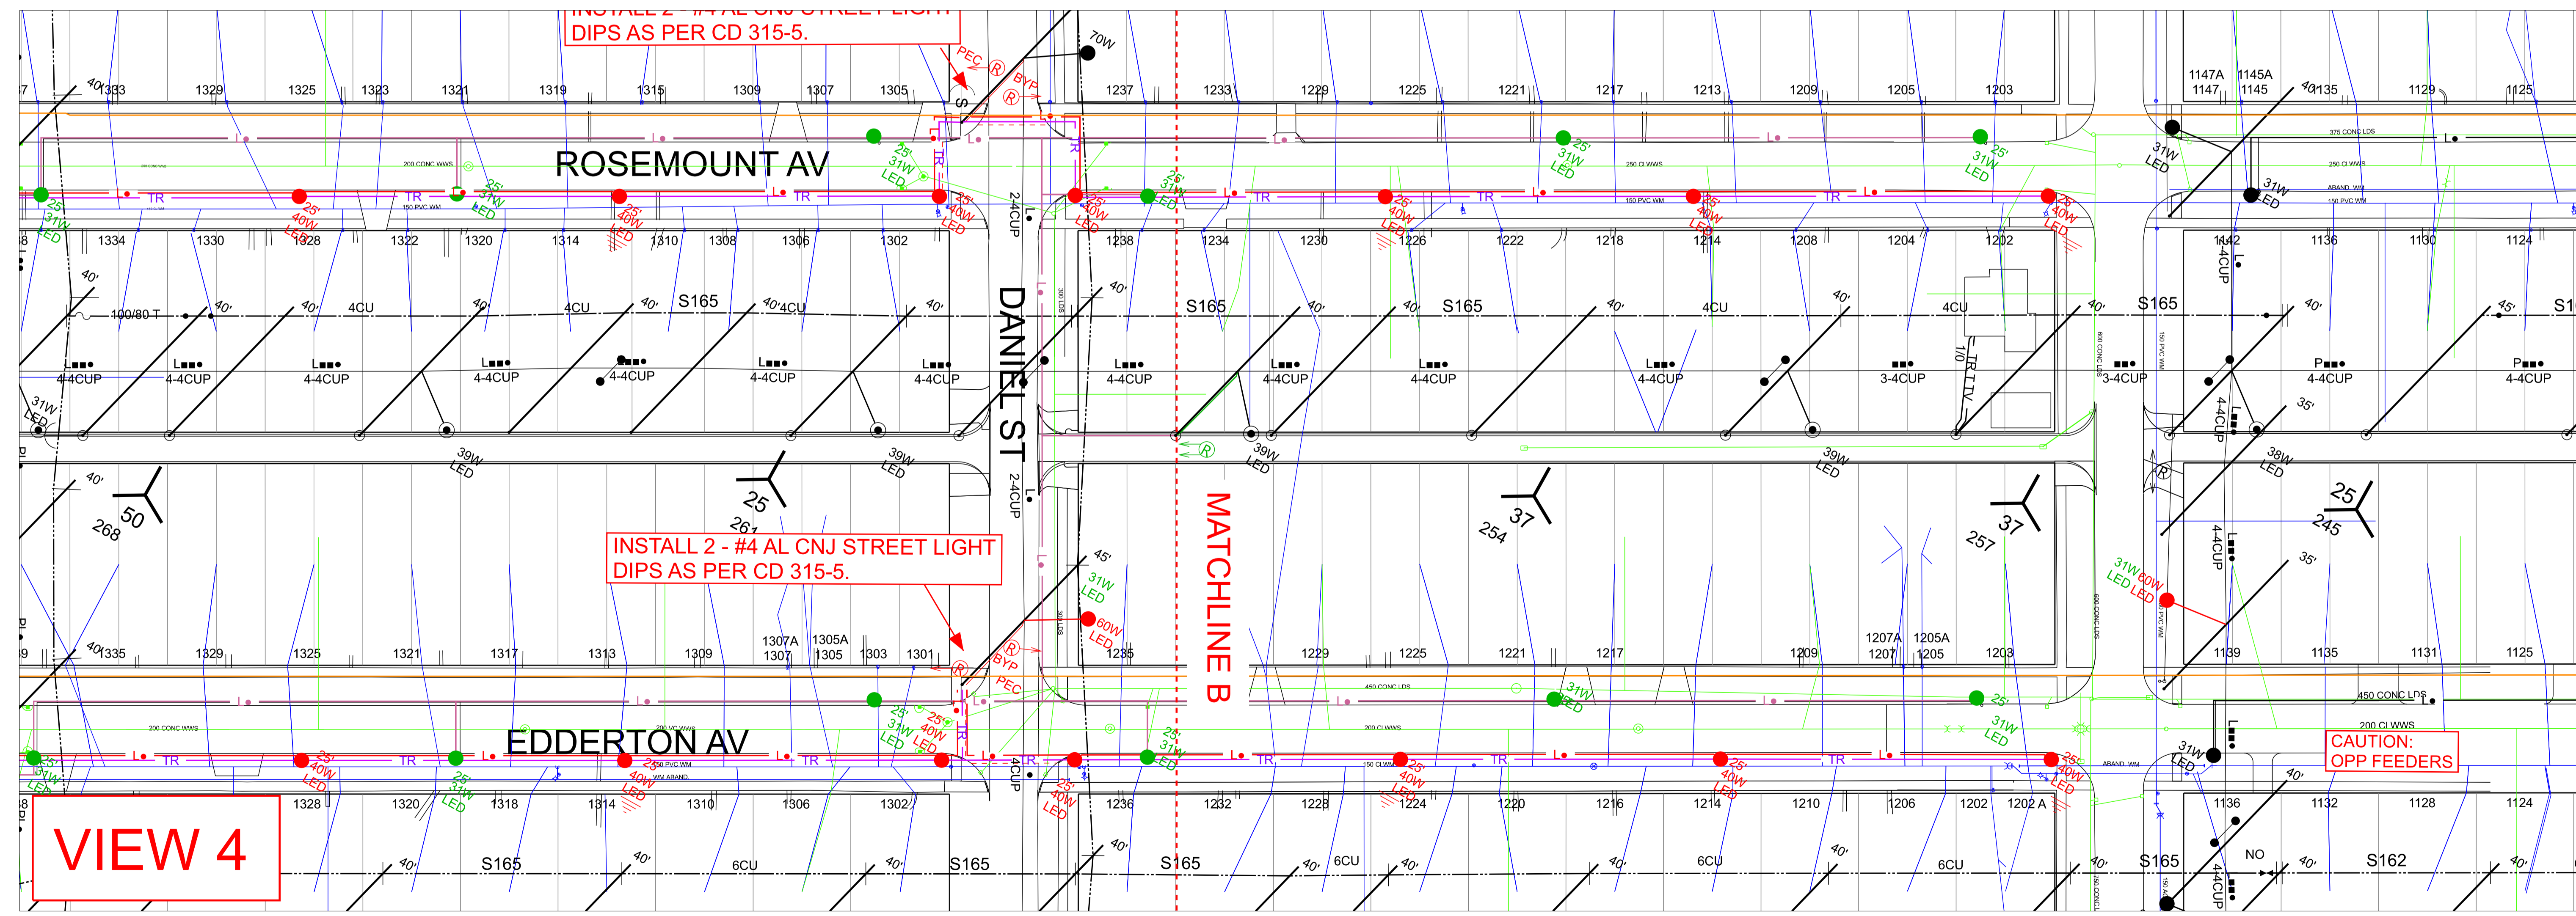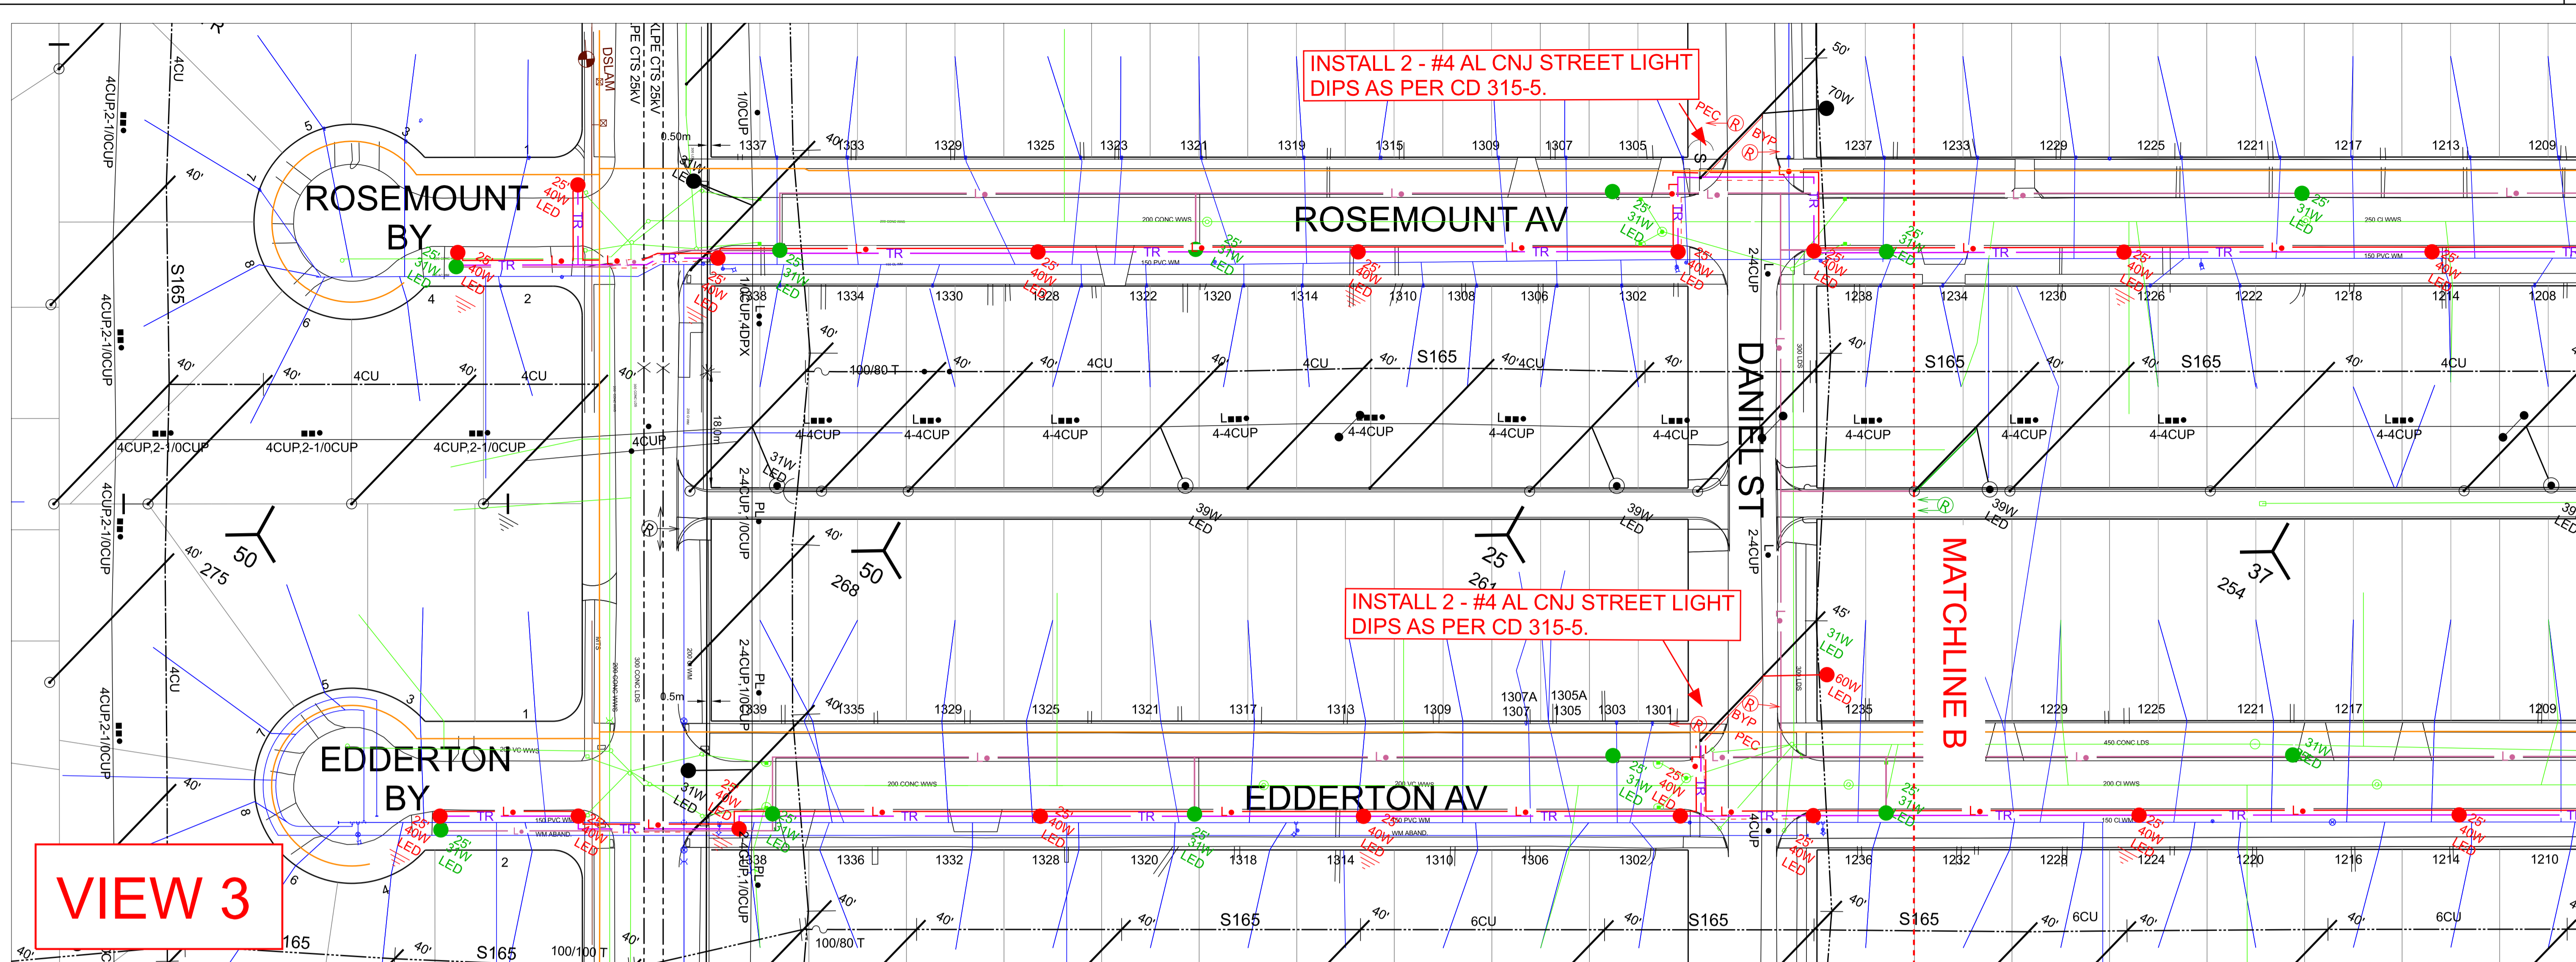

CONTACT "CLICK BEFORE YOU DIG MANITOBA" AT
ClickBeforeYouDigMB.com
THREE FULL WORKING DAYS
PRIOR TO CONSTRUCTION FOR LOCATION OF
WATER, WASTEWATER, LAND DRAINAGE UTILITIES AND
MANITOBA HYDRO UTILITIES

PRELIMINARY NOT TO
BY USED FOR
CONSTRUCTION

NO.	DATE	REVISIONS	BY	CHKD.	APP.

AREA	4901, 5202	MANITOBA HYDRO DISTRIBUTION ENGINEERING
STATION NUMBER	N/A	WO# P-39676 NETWORK # 4308371
FEEDER NUMBER	N/A	CSC: CITY CENTRE FORT GARRY
DRAWING NUMBER	D.R.	COW - BROCK, ROSEMOUNT & EDDERTON CUSTOMER SERVICE PROJECT
CHECK		SALVAGE 20-25' STREET LIGHTS AND INSTALL 28-25' STREET LIGHTS
SCALE	1:500	SYSTEM VOLTAGE 120 V
DATE	2024 02 29	

1-04707-DE-50000-0646	SHT.	REV.
	03/03	00