B1 SIZE - 1000 x 707

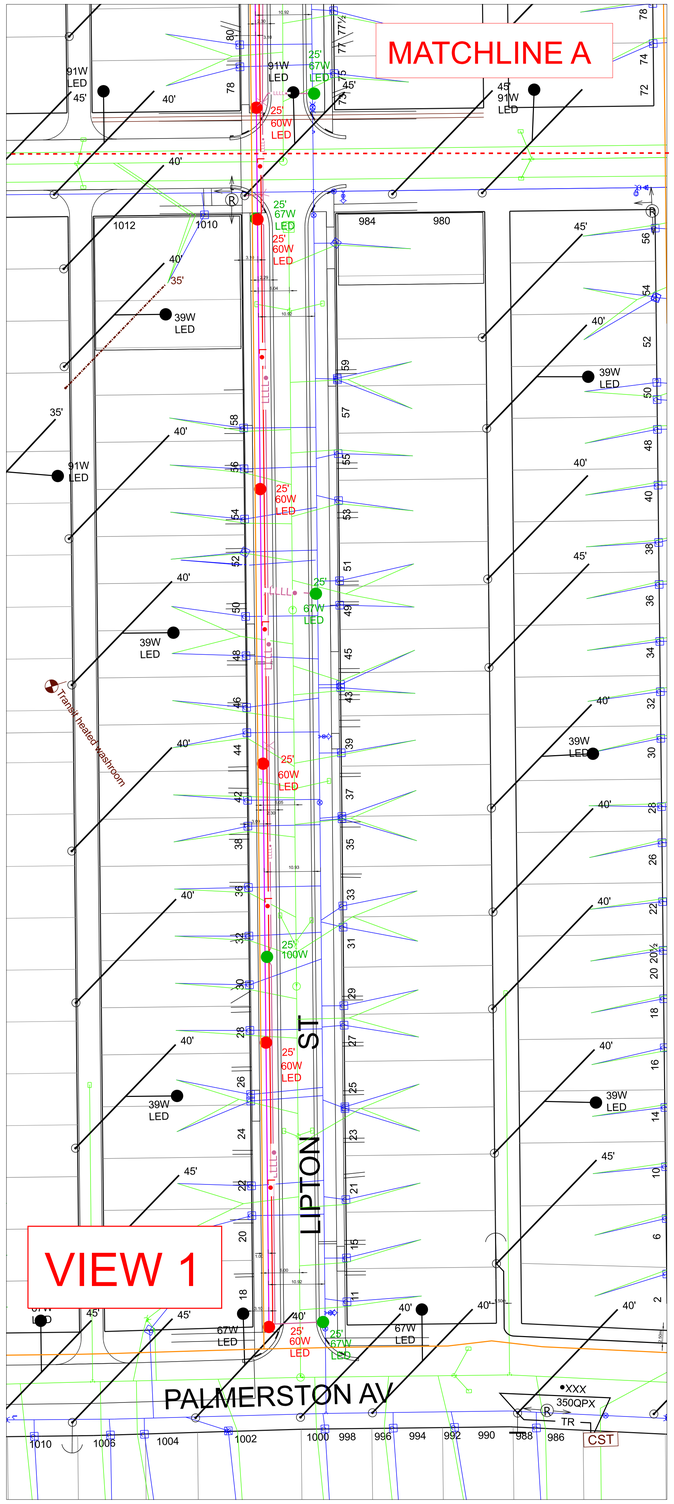

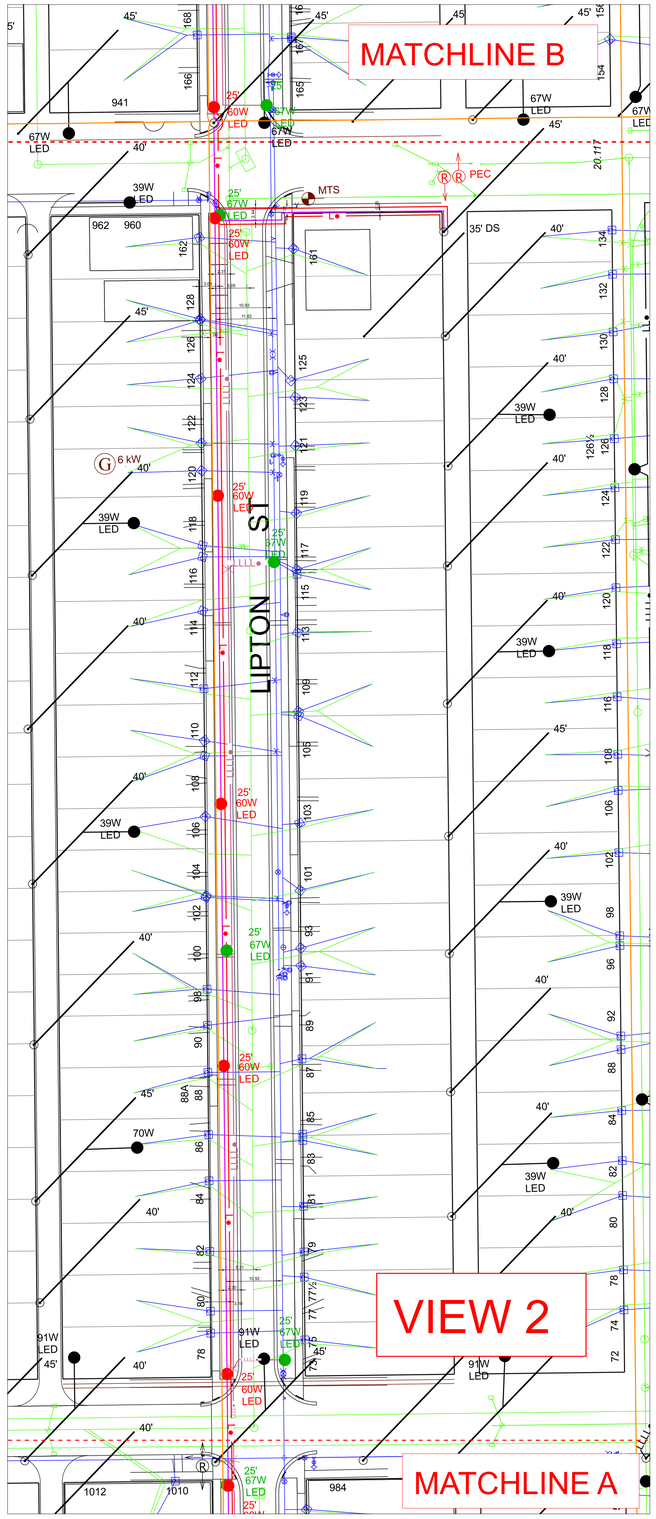

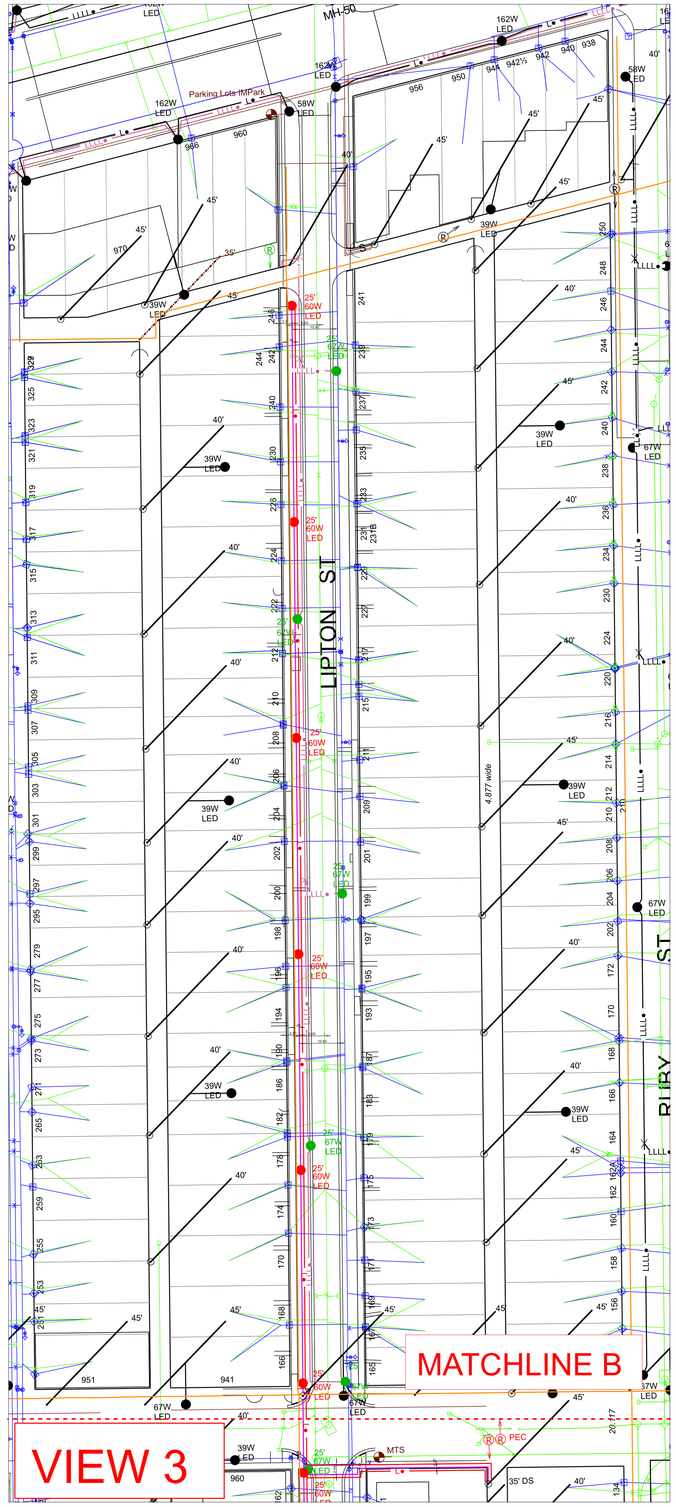

NOTES :

CONSTRUCTION STANDARDS

TO BE CONSTRUCTED IN ACCORDANCE WITH MANITOBA HYDRO DISTRIBUTION AND SUBTRANSMISSION STANDARDS, LATEST REVISION.
NO MAJOR CHANGE SHALL BE MADE WITHOUT APPROVAL OF THE DESIGN ENGINEER OR DELEGATE.

INSTALL NEW STREET LIGHTS AND CABLE ON ALIGHNMENT AS SHOWN.

INSTALL NEW GROUND RODS AS PER CD 50-5

ALL STREET LIGHT CABLE TO BE INSTALLED IN 2" CONDUIT

UPON DISCONNECTION BY MB HYDRO THE CONTRACTOR SHALL INSTALL TEMPORARY #6 OVERHEAD FEED IN ORDER TO MAINTAIN LIGHTING DURING CONSTRUCTION. AT THE END OF CONSTRUCTION TEMPORARY OVERHEAD SHALL BE DISONNECTED BY THE CONTRACTOR.

U/G SL CABLE TO BE MINIMUM 1.0m AWAY FROM ALL OTHER UTILITIES UNLESS OTHERWISE NOTED

MB HYDRO SHALL CUT, CAP AND ABANDON ORIGINAL FEED TO THE STREET LIGHTS PRIOR TO REMOVAL, ALL FINAL CONNECTIONS WILL BE COMPLETED BY MB HYDRO.

CONTACT "CLICK BEFORE YOU DIG MANITOBA" AT
ClickBeforeYouDigMB.com
THREE FULL WORKING DAYS
PRIOR TO CONSTRUCTION FOR LOCATION OF WATER, WASTEWATER, LAND DRAINAGE UTILITIES AND MANITOBA HYDRO UTILITIES

PRELIMINARY NOT TO BY USED FOR CONSTRUCTION

FOR MICROFILM USE ONLY

NO.	DATE	REVISIONS	BY	CKD.	APP.

NORTH

DRAWING NUMBER	REFERENCE DRAWINGS

DRAW D.R.
CHECK
SCALE 1:500
DATE 2024 0X XX

AREA 5202, 5201
STATION NUMBER N/A
FEEDER NUMBER N/A
SYSTEM VOLTAGE 120 V

MANITOBA HYDRO
DISTRIBUTION ENGINEERING
WO# P:39892 NETWORK # 4308425

CSC: CITY CENTRE
COW - LIPTON (PALMERSTON TO PORTAGE AVE)
CUSTOMER SERVICE PROJECT
SALVAGE 13-25' STREET LIGHTS AND INSTALL 16-25' STREET LIGHTS

1-04707-DE-50000-0651 | SHT. 02/02 | REV. 00