

GENERAL NOTES:


1. STORMWATER RETENTION BASIN MONITORING EQUIPMENT SHALL BE IN ELECTRICAL ENCLOSURE AND FLOOR MOUNTED ON A CONCRETE PAD. PROPOSED PAD LOCATION SHOWN IS APPROXIMATE AND TO BE CONFIRMED.
2. REFER TO STRUCTURAL DRAWING FOR PAD FOUNDATION DESIGN AND DETAILS.
3. WATER AND SEWER PIPE NETWORK PLAN (CAD FILE) AS PER CITY OF WINNIPEG DATED 2022/10/21.
4. ALL DIMENSIONS IN METERS UNLESS NOTED.
5. THE CABLE MUST BE NEW AND WITHOUT ANY SPLICE FROM MANITOBA HYDRO TRANSFORMER TO THE SRB PANEL.
6. THE LOCATION OF THE GROUNDING GRID IS TO BE DETERMINED ON THE FIELD.
7. PART OF THE UNDERGROUND CABLE TO BE INSTALLED UNDER THE ROAD SHOULD BE INSTALLED USING DIRECTION BORE INSTEAD OF OPEN TRENCH. THE CABLE SHALL BE INSTALLED 915mm BELOW GRADE AND INSTALLED IN 25.4mm RIGID PVC CONDUIT.
8. CONTRACTOR IS TO REPAIR THE PATHWAYS TO THE CONDITION FOUND WHEN THE WORK IS COMPLETE IF THE CONTRACTOR DISTURBS THE PATHWAY.
9. THE CONTRACTOR IS TO EXCAVATE THE AREA WHERE THE POWER CABLE FOR THE PANEL IS TO BE INSTALLED USING OPEN TRENCH AND INSTALL THE POWER CABLE AS INDICATED IN THE CABLE TRENCH DETAIL. AFTER THE POWER CABLE HAS BEEN INSTALLED, THE CONTRACTOR IS TO BACK FILL THE TRENCH AND REPAIR THE AREA OF EXCAVATION TO THE CONDITION FOUND.
10. THE CONTRACTOR IS TO EXCAVATE AND INSTALL THE RIGID PVC CONDUIT FOR THE WATER LEVEL SENSOR USING OPEN TRENCH AND DIRECTION BORE (FOR PORTION ACROSS THE ROAD). AFTER THE CONDUIT HAS BEEN INSTALLED, THE CONTRACTOR IS TO BACK FILL THE OPEN TRENCH AND REPAIR THE AREA OF EXCAVATION TO THE CONDITION FOUND.
11. THE CONTRACTOR IS TO INSTALL THE SRB PANEL AND ITS PAD FOUNDATION.
12. MANITOBA HYDRO IS TO CONNECT THE POWER CABLE FOR THE PANEL TO MH DISTRIBUTION TRANSFORMER.

LEGEND:


- GAS — GAS LINE
- WATER — WATER SERVICE PIPE
- SEWER — SEWER SERVICE PIPE
- BURIED POWER CABLE
- BURIED SENSOR CABLE
- MH TRANSFORMER
- CP-B81 SRB
- GROUND ROD

SITE PLAN – SITE 5

SCALE: 1: 250m

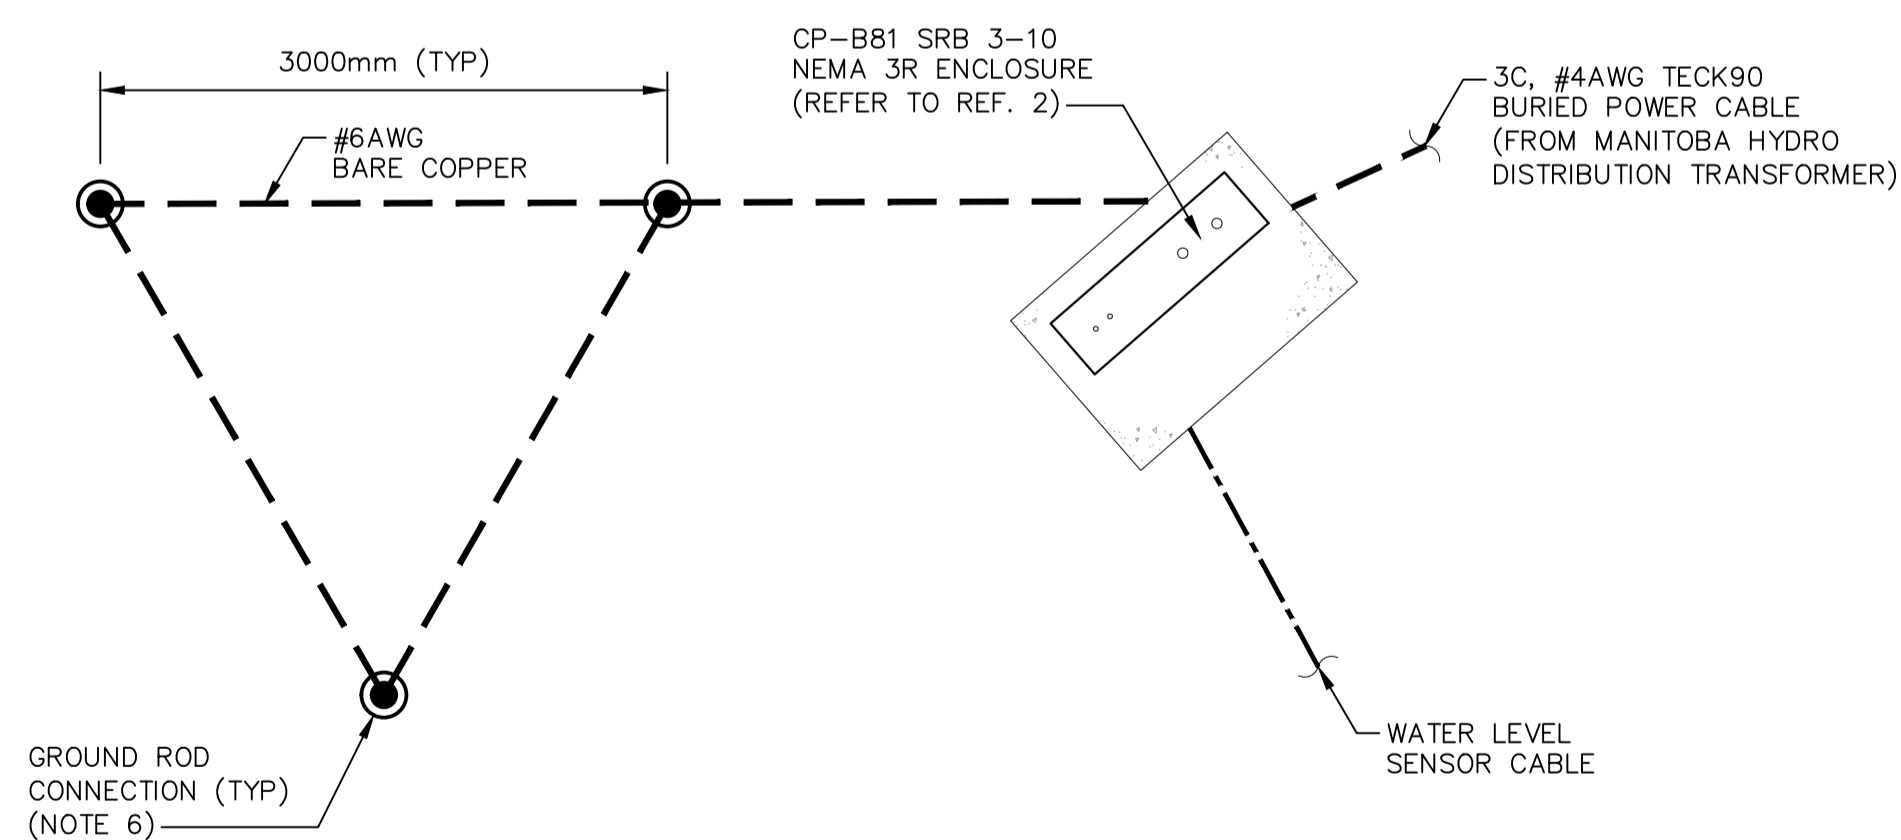


1 GROUNDING DETAIL
SCALE: 1: 40m

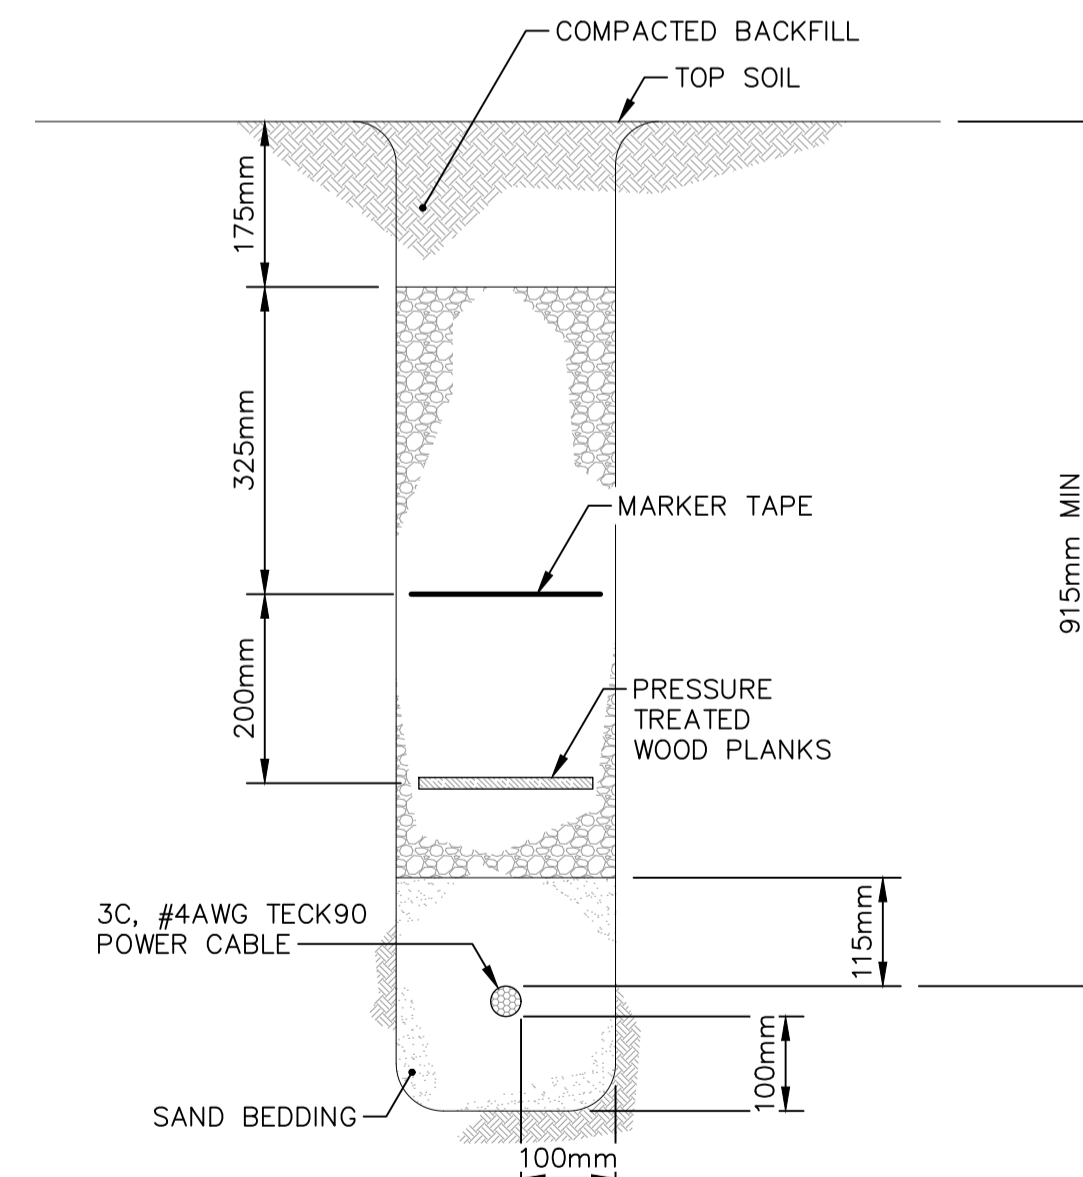

A CABLE TRENCH SECTION
SCALE: 1: 8m

10	---	---
9	---	---
8	---	---
7	---	---
6	---	---
5	---	---
4	---	---
3	---	---
2	1-0434B-E0002-001	ELECTRICAL – EQUIPMENT ARRANGEMENT AND DISTRIBUTION – OUTDOOR MONITORING ENCLOSURE – SITE 5
1	1-0434B-S0001-001	FOUNDATION PLAN AND DETAILS
NO.	DRAWING NUMBER	REFERENCE DRAWING TITLE
REFERENCE DRAWINGS		

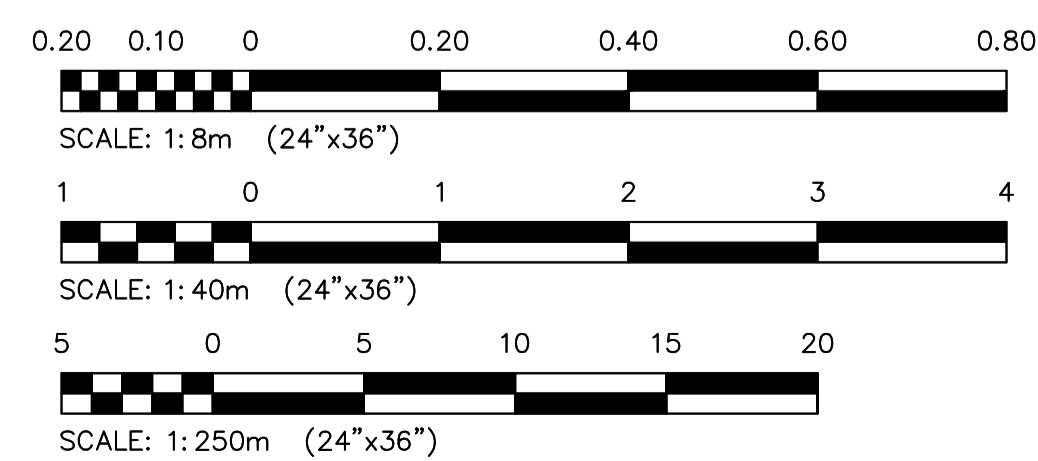

B.M. ELEV.			
0	ISSUED FOR CONSTRUCTION	2023/12/08	RS
NO.	REVISIONS	DATE	BY

KGS GROUP

DESIGNED BY	C. RABU	CHECKED BY	D. SUSANTO
DRAWN BY	R. GASPAR	APPROVED BY	D. SUSANTO
SCALE: HORIZONTAL	NTS	RELEASED FOR CONSTRUCTION	
SCALE: VERTICAL	NTS	DATE	2022/08/18

PROVINCE OF MANITOBA
2023-12-11
D.R.
SUSANTO
223738
REGISTERED PROFESSIONAL ENGINEER

CONSULTANT DRAWING NUMBER
22-0107-022-E06.01

THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT
ENGINEERING DIVISION

STORM RETENTION BASIN 3-10 (AMBER TRAILS)
SRB 2023 WATER LEVEL MONITORING UPGRADES
ELECTRICAL

SITE PLAN AND DETAILS
OUTDOOR MONITORING ENCLOSURE

CITY DRAWING NUMBER
1-0434B-E0001-001

SHEET 1 OF 1

ENGINEERS GEOSCIENTISTS MANITOBA
Certificate of Authorization
KGS Group
No. 245