



## Appendix M – Tylehurst Lower Level Photos

Photos are from November 18, 2024 Site Visit

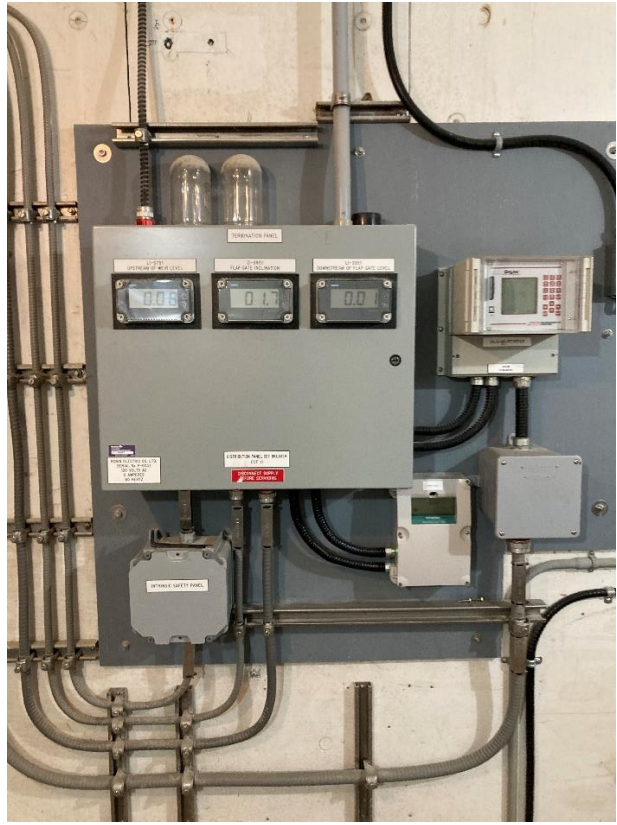

Lower Level – stairs from main floor, stairs to Comminutor Chamber and CSO Panel.

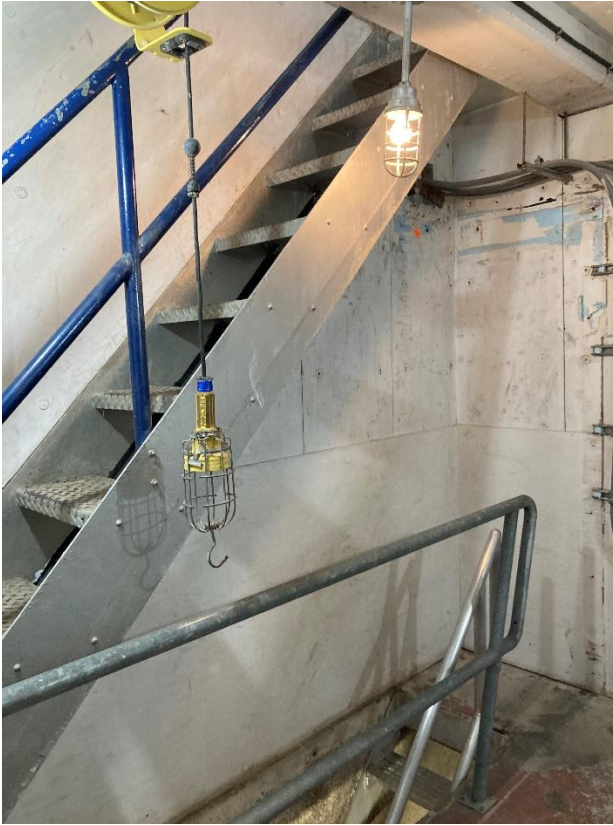

Lower Level – stairs from Main Floor (right), entrance to Motor Room (left)





Lower Level – ceiling hatches on Main Floor



Lower Level – Valve Operator for Comminutor Chamber Gate Valve (right of CSO Panel)






Stairs to Comminutor Chamber




Comminutor Chamber - piping going to station wet well



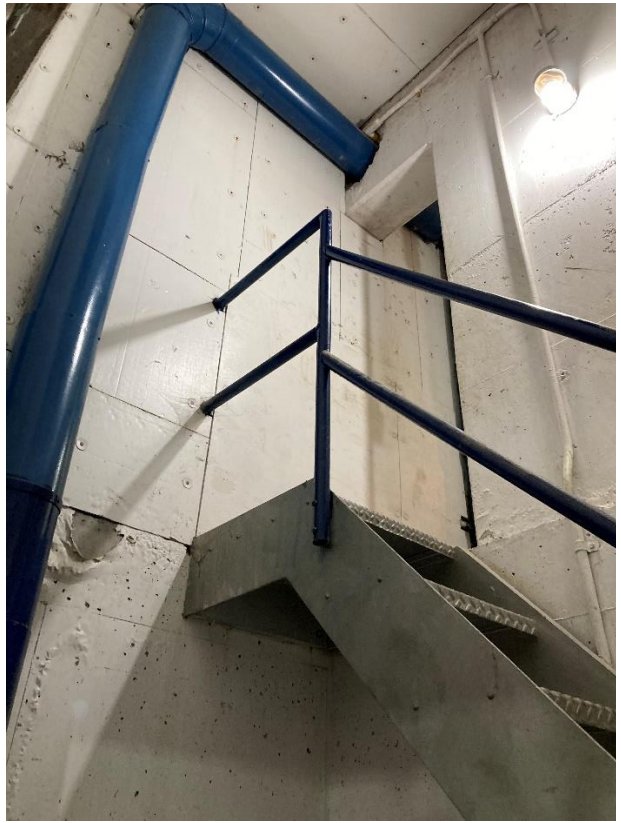

Motor Room - stairs going up to Lower Level

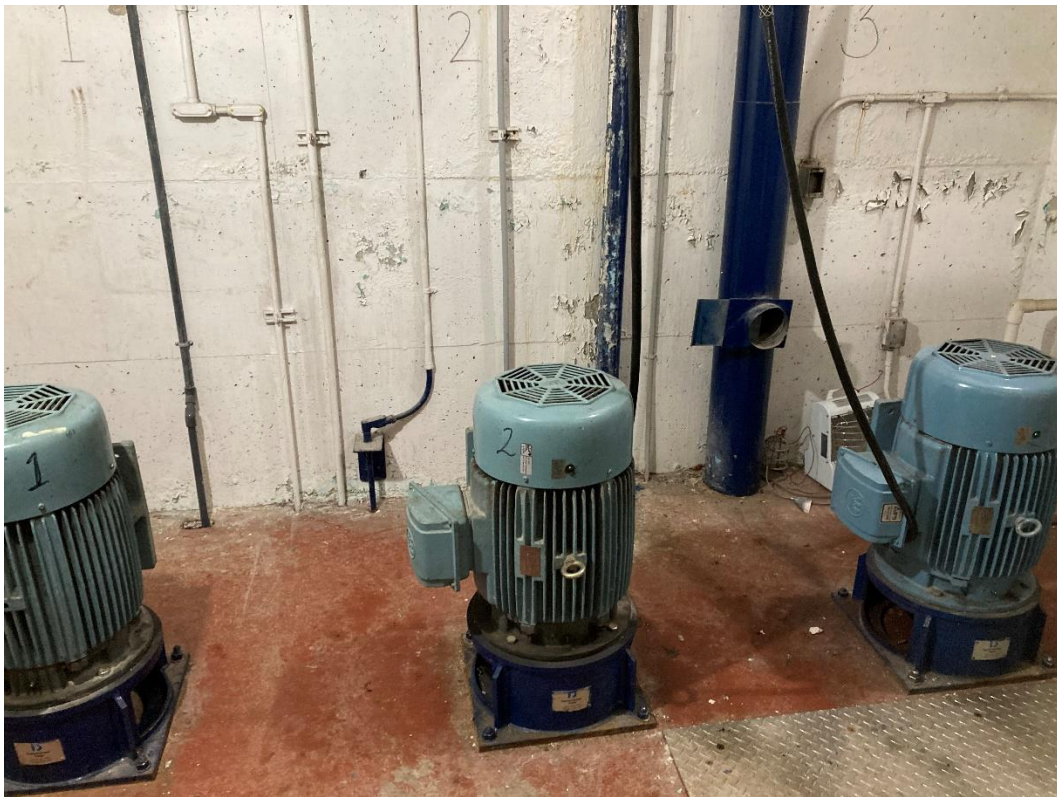

Motor Room – Lift Pump Motors, 30 HP each





Motor Room – lift pump motors and combined pumps discharge line with flow meter



Motor Room – Discharge Pipe to Gate Chamber (vertical) and Force Main (angled pipe)





Pump Room – stairs, differential pressure transmitter (for wet well level sensing) and lift pump 1



Pump Room – lift pumps and gate valves (lift pump 1 bottom, lift pump 3 top)





Pump Room – lift pumps and intake piping with gate valves



Pump Room – lift pump discharge piping with check valves, gate valves and header





Pump Room – lift pump discharge header (lift pump 1 on left, lift pump 3 on right)




Pump Room – lift pump discharge header (lift pump 3 on left, lift pump 1 on right)





Pump Room – lift pump discharge header

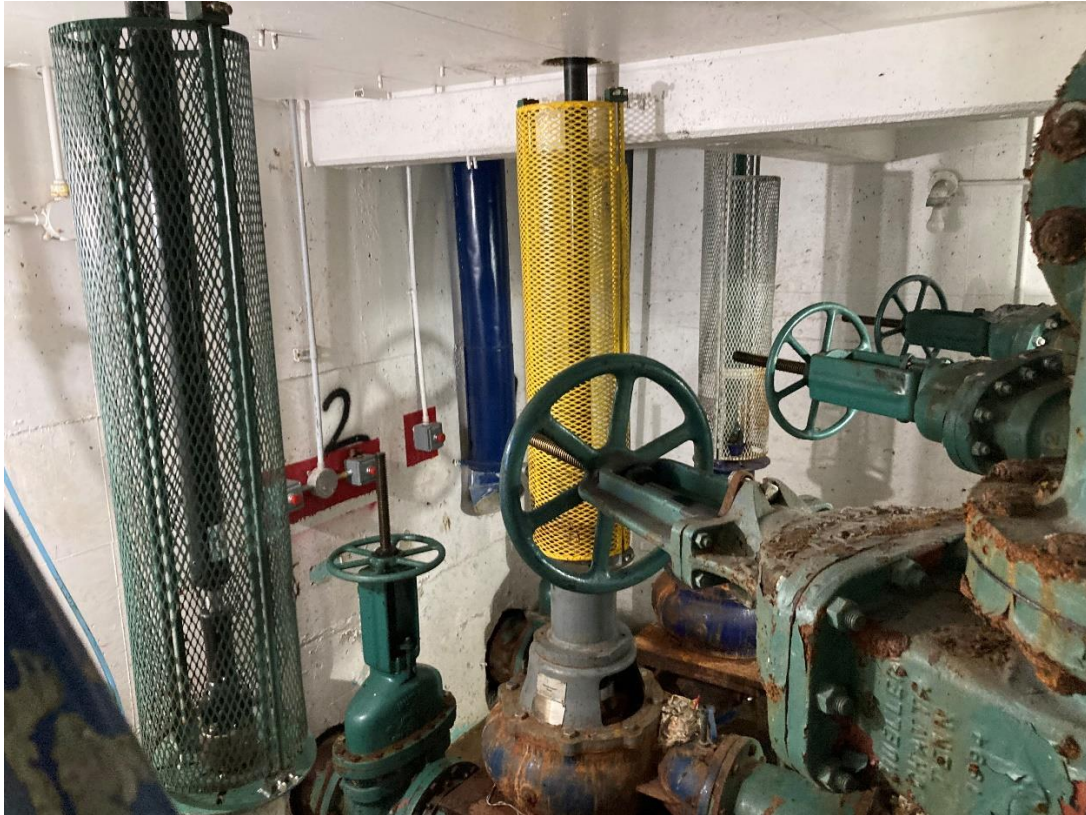

Pump Room – lift pumps and piping