


DEMOLITION NOTES:

- (A) COORDINATE WITH MANITOBA HYDRO TO DISCONNECT AND REMOVE THE EXISTING 600V SERVICE UTILITY METER. PATCH AND REPAIR ENCLOSURE WITH STEEL PLATES AND GASKET. PAINT TO MATCH. PROVIDE DEMOLITION OF THE EXISTING OUTDOOR UTILITY METER, CONDUITS AND CABLING. CONSULT WITH MANITOBA HYDRO IF METER SHOULD BE KEPT, OTHERWISE DISPOSE OF METER.
- (B) CONTRACTOR TO COORDINATE WITH MANITOBA HYDRO TO REMOVE THE 5KV CABLES TO THE EXISTING TRANSFORMER. CONTRACTOR TO SOFT DIG, EXCAVATE AND EXPOSE CABLE.
- (C) CONTRACTOR TO REMOVE THE NEUTRAL-GROUND LINK AT THE SERVICE ENTRANCE.

MANITOBA HYDRO SCOPE OF WORK:

1. DEMOLISH THE UTILITY CABLE FEEDING THE TRANSFORMER.

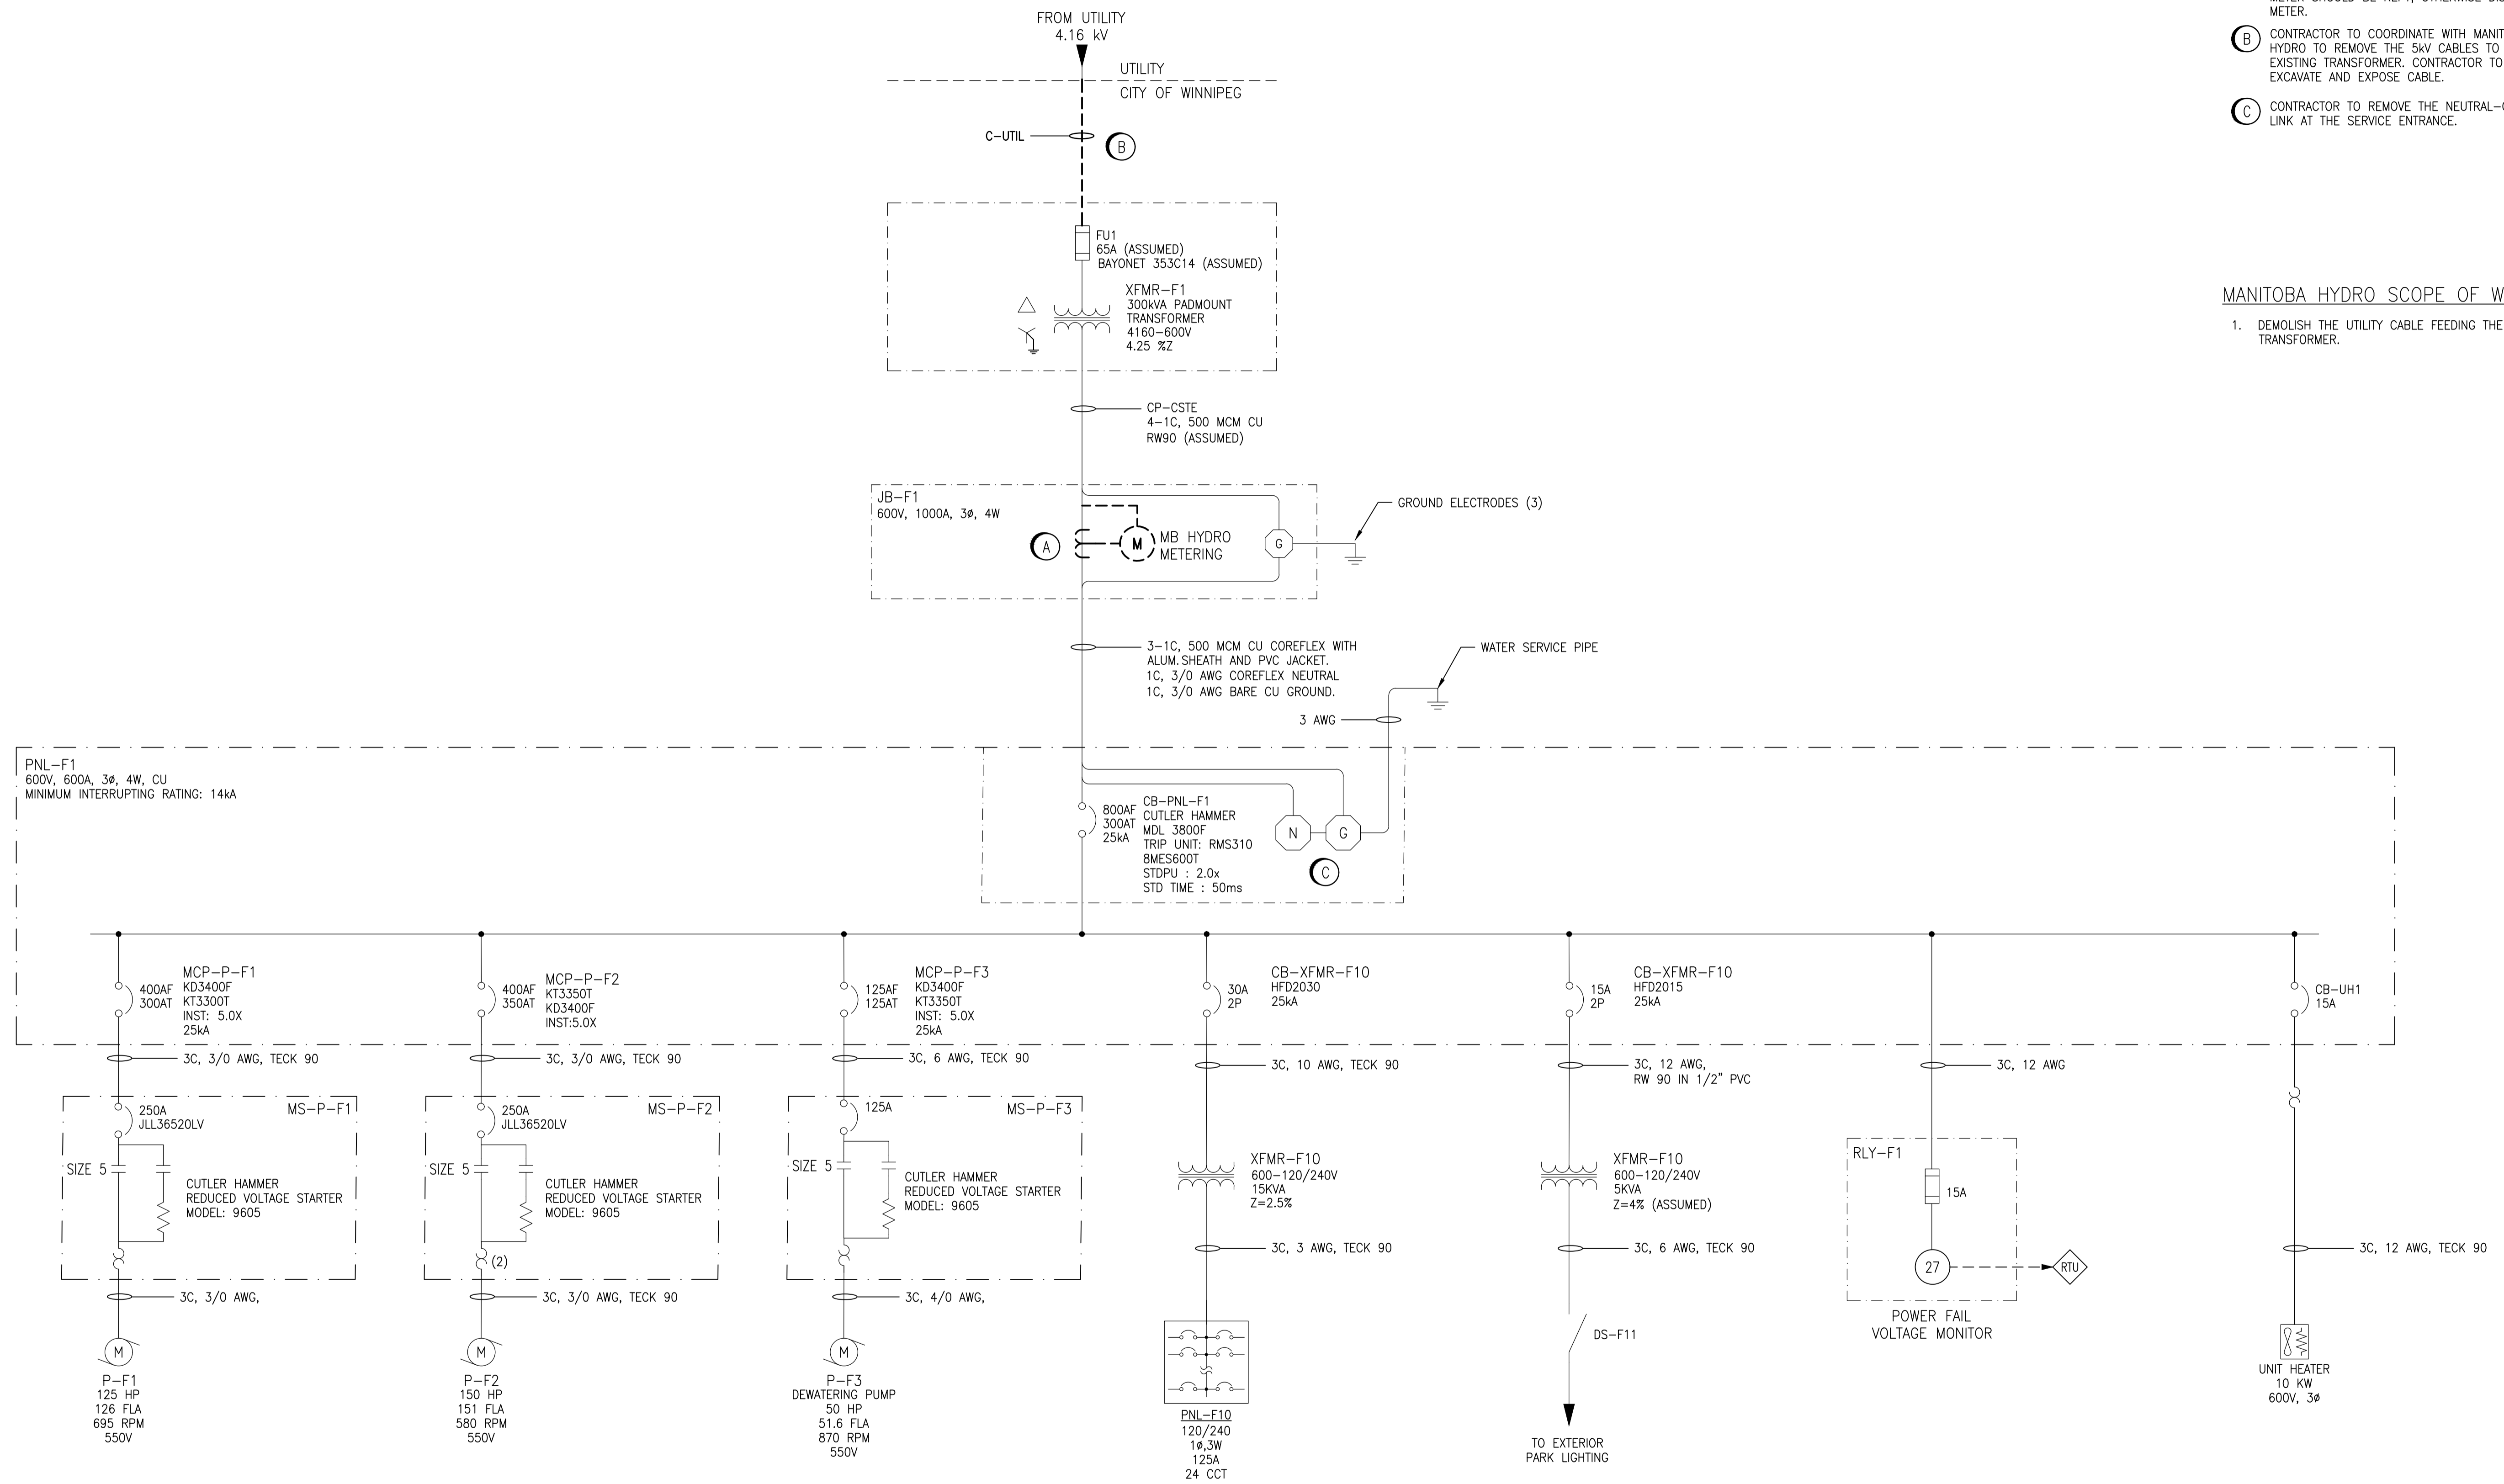

| NO. | REVISIONS | DATE | DESIGN | CHECK |
|-----|------------------------------------|------------|--------|-------|
| 01 | ISSUED FOR TENDER AND CONSTRUCTION | 2024/12/20 | PG | VE |

| | | |
|---|--|---|
| AtkinsRéalis 148 Nature Park Way, Winnipeg, Manitoba Canada R3P 0X7 204-786-8080 | | ENGINEER'S SEAL DESIGNED BY: P. GILL CHECKED BY: V. ELIMBAN DRAWN BY: K. MOHAMMED APPROVED BY: D. BECKER SCALE: N.T.S. ISSUED FOR CONSTRUCTION BY: B. SOLOWAY DATE: 2024/07/18 DATE: 2024/12/20 CONSULTANT NO.: 701408 |
|---|--|---|

THE CITY OF WINNIPEG
 WATER AND WASTE DEPARTMENT
 CORNISH FLOOD PUMPING STATION
 2025 TRANSFORMER REMEDIATION UPGRADES
 SINGLE LINE DIAGRAM
 DEMOLITION
 CITY DRAWING NUMBER: 1-0132F-E0001
 SHEET: 001 REV: 01 SIZE: A1