
## SERVICE EQUIPMENT LAYOUT

3219

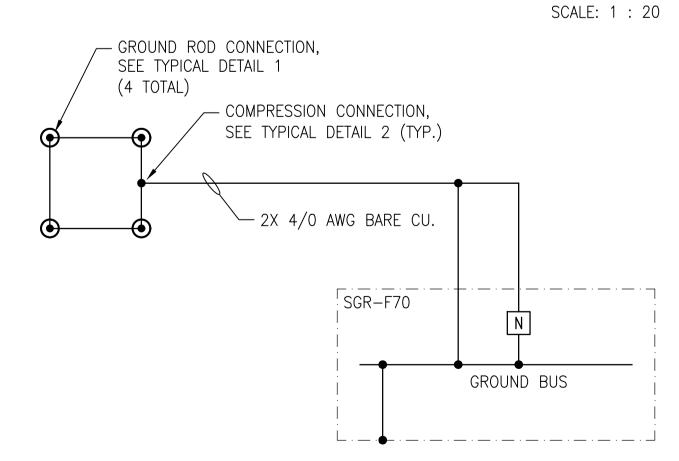

LOW VOLTAGE EQUIPMENT GROUNDING
SCALE: N.T.S.


WHOLE NUMBERS INDICATE MILLIMETRES
DECIMALIZED NUMBERS INDICATE METRES

0.0 200 400 800 1200

1: 20


**METRIC** 

ENGINEERS
GEOSCIENTISTS
MANITOBA
Certificate of Authorization
AtkinsRéalis Canada Inc.
No. 4489

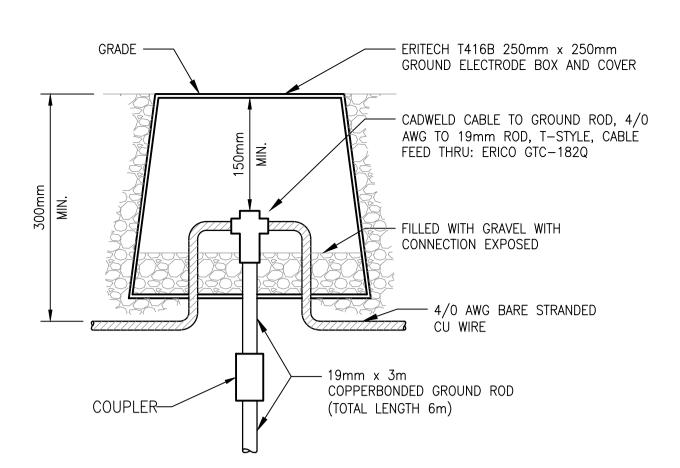


GROUND ROD WITH GROUND WELL

SCALE: N.T.S

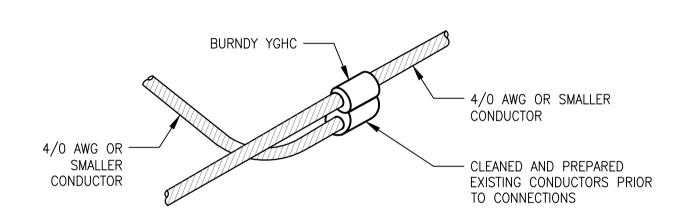

GROUND CONDUCTOR SPLICE

SCALE: N.T.S

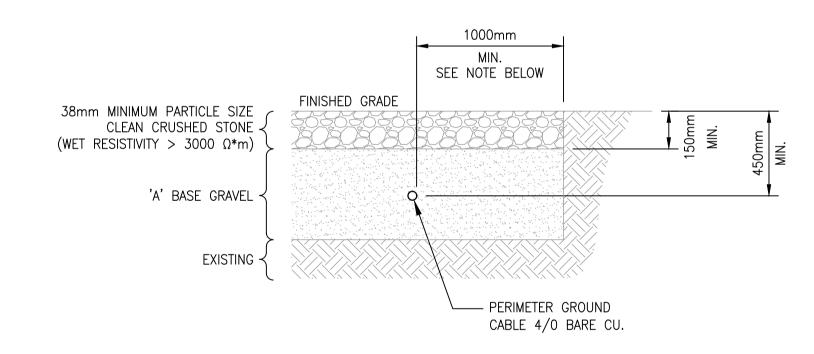

PERIMETER GROUND CABLE INSTALLATION

SCALE: N.T.S.

SCALE: N.T.S

NOTE:
CRUSHED STONE AND 'A' BASE MATERIAL TO EXTEND A
MINIMUM OF 1000mm PAST PERIMETER GROUND CABLE.

## **GENERAL NOTES:**

- COORDINATE EXACT LOCATION OF CONDUITS WITH EQUIPMENT SHOP DRAWINGS PRIOR TO CONCRETE POUR.
- 2. TRANSFORMER CLEARANCES SHALL BE IN ACCORDANCE WITH CEC RULE 26-242(2)(b)(i).
- 3. PERIMETER BURIED GROUND CABLE AND GROUND RODS SHALL BE INSTALLED AS PER DETAILS 1, 2 AND 3.
- OTHERWISE INDICATED.

  5. ALL SURFACE RUN CABLING SHALL BE PHYSICALLY PROTECTED BY

4. ALL GROUND CABLES ARE BARE 4/0 AWG, COPPER, UNLESS

- 6. EQUIPMENT DOOR OPENINGS ARE NOT SHOWN FOR CLARITY.
- 7. ALL 4160 AND 600 VAC POWER CABLING AND CONDUIT IS NOT SHOWN FOR CLARITY. REFER TO OTHER DRAWINGS.

EMBEDDING THE CABLE WITHIN THE CONCRETE SLAB, BY DIRECT BURIAL

## **CONSTRUCTION NOTES:**


OR BY SURFACE RUN CONDUIT.

- ALL PERIMETER GROUND CABLES SHALL BE BURIED BELOW FINISHED GRADE. ALL BELOW GRADE CONNECTIONS SHALL BE COMPRESSION OR CADWELDED.
- PROVIDE 4/0 AWG BARE COPPER GROUND RUN IN 53mm¢ CONDUIT SLEEVE FROM ELECTRICAL EQUIPMENT TO GROUND GRID. PROVIDE TWO (2) SEPARATE GROUNDING CONNECTIONS FOR EACH PIECE OF EQUIPMENT. EQUIPMENT SHALL BE GROUNDED TO TWO (2) DIFFERENT GROUNDING CONDUCTOR RUNS.
- PROVIDE RIGID PVC CONDUIT EMBEDDED IN CONCRETE SLAB FOR PRIMARY CABLE FROM THE 5KV SWITCHGEAR SGR-F70 FUSIBLE DISCONNECT TO TRANSFORMER XFMR-F70. EXACT LOCATIONS SHALL BE DETERMINED FROM THE SHOP DRAWINGS OF THE TRANSFORMER AND 5KV SWITCHGEAR. PROVIDE WATERPROOF SEALING OF CABLES AFTER INSTALLATION.
- THE CONDUIT SLEEVES FOR INCOMING AND OUTGOING CABLING SHALL BE EXTENDED 500mm PAST THE EDGE OF THE CONCRETE PAD AND SEALED AROUND THE CABLING.
- PROVIDE WARNING SIGNS IN ACCORDANCE WITH CSA 22.1, RULE 36-006.

## <u>LEGEND:</u>

/ - - 4/0 AWG BARE STRANDED COPPER GROUND CABLE

- 6000mm LONG (19mm Ø) COPPER CLAD GROUND ROD WITH GROUND WELL
- CABLE COMPRESSION CONNECTION
- CADWELD OR SERVIT CONNECTION

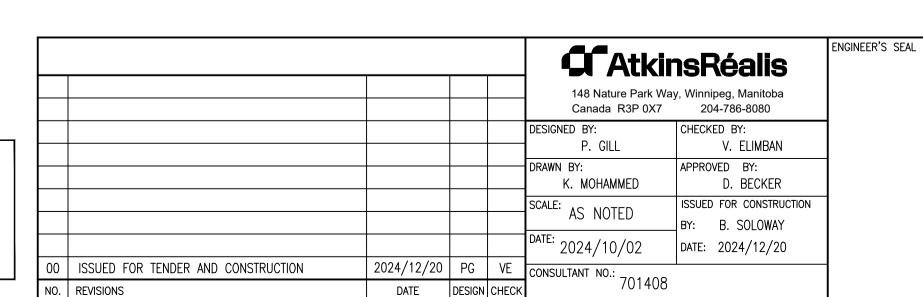

Winnipeg

THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT

MISSION FLOOD PUMPING STATION
2025 TRANSFORMER REMEDIATION UPGRADES
ELECTRICAL & GROUNDING
INSTALLATION DETAILS

city drawing number sheet rev. size 1-0163F-E0003 001 00 A1

1-0163F-E0003-001-00.dwg