




	CI WM		REPAIR 5-15YRS-ABANDON		AQUEDUCT		HISTORICAL PROJECT
	PVC WM		REPAIR >15YRS		MANHOLE		SCHOOL
	AC WM		REPAIR >15YRS-ABANDON		SEWERS		PWD PROJECT
	UNKNOWN WM		VALVE		RAILWAY		SEWER RELIEF WORK
	REPAIR <5YR		HYDRANT		WM RENEWAL		CATHODIC PROTECTION
	REPAIR <5YR-ABANDON		HYDRANT BRANCH		WM NEW		FIRE PROTECTION UPGRADE
	REPAIR 5-15YRS		FEEDER MAIN		WM ABANDON		


Additional Notes:  
 -200mm is good

Printed: 9/27/2024



### CITY OF WINNIPEG WATER AND WASTE DEPARTMENT 2025 WATER MAIN RENEWAL PROGRAM


Location ID: 11	Street: ELGIN AVE
Location Description: MID-BLOCK E OF ELLEN ST TO PRINCESS ST	
Scale: 1:2000	Renewal Type: PWD-REGIONAL

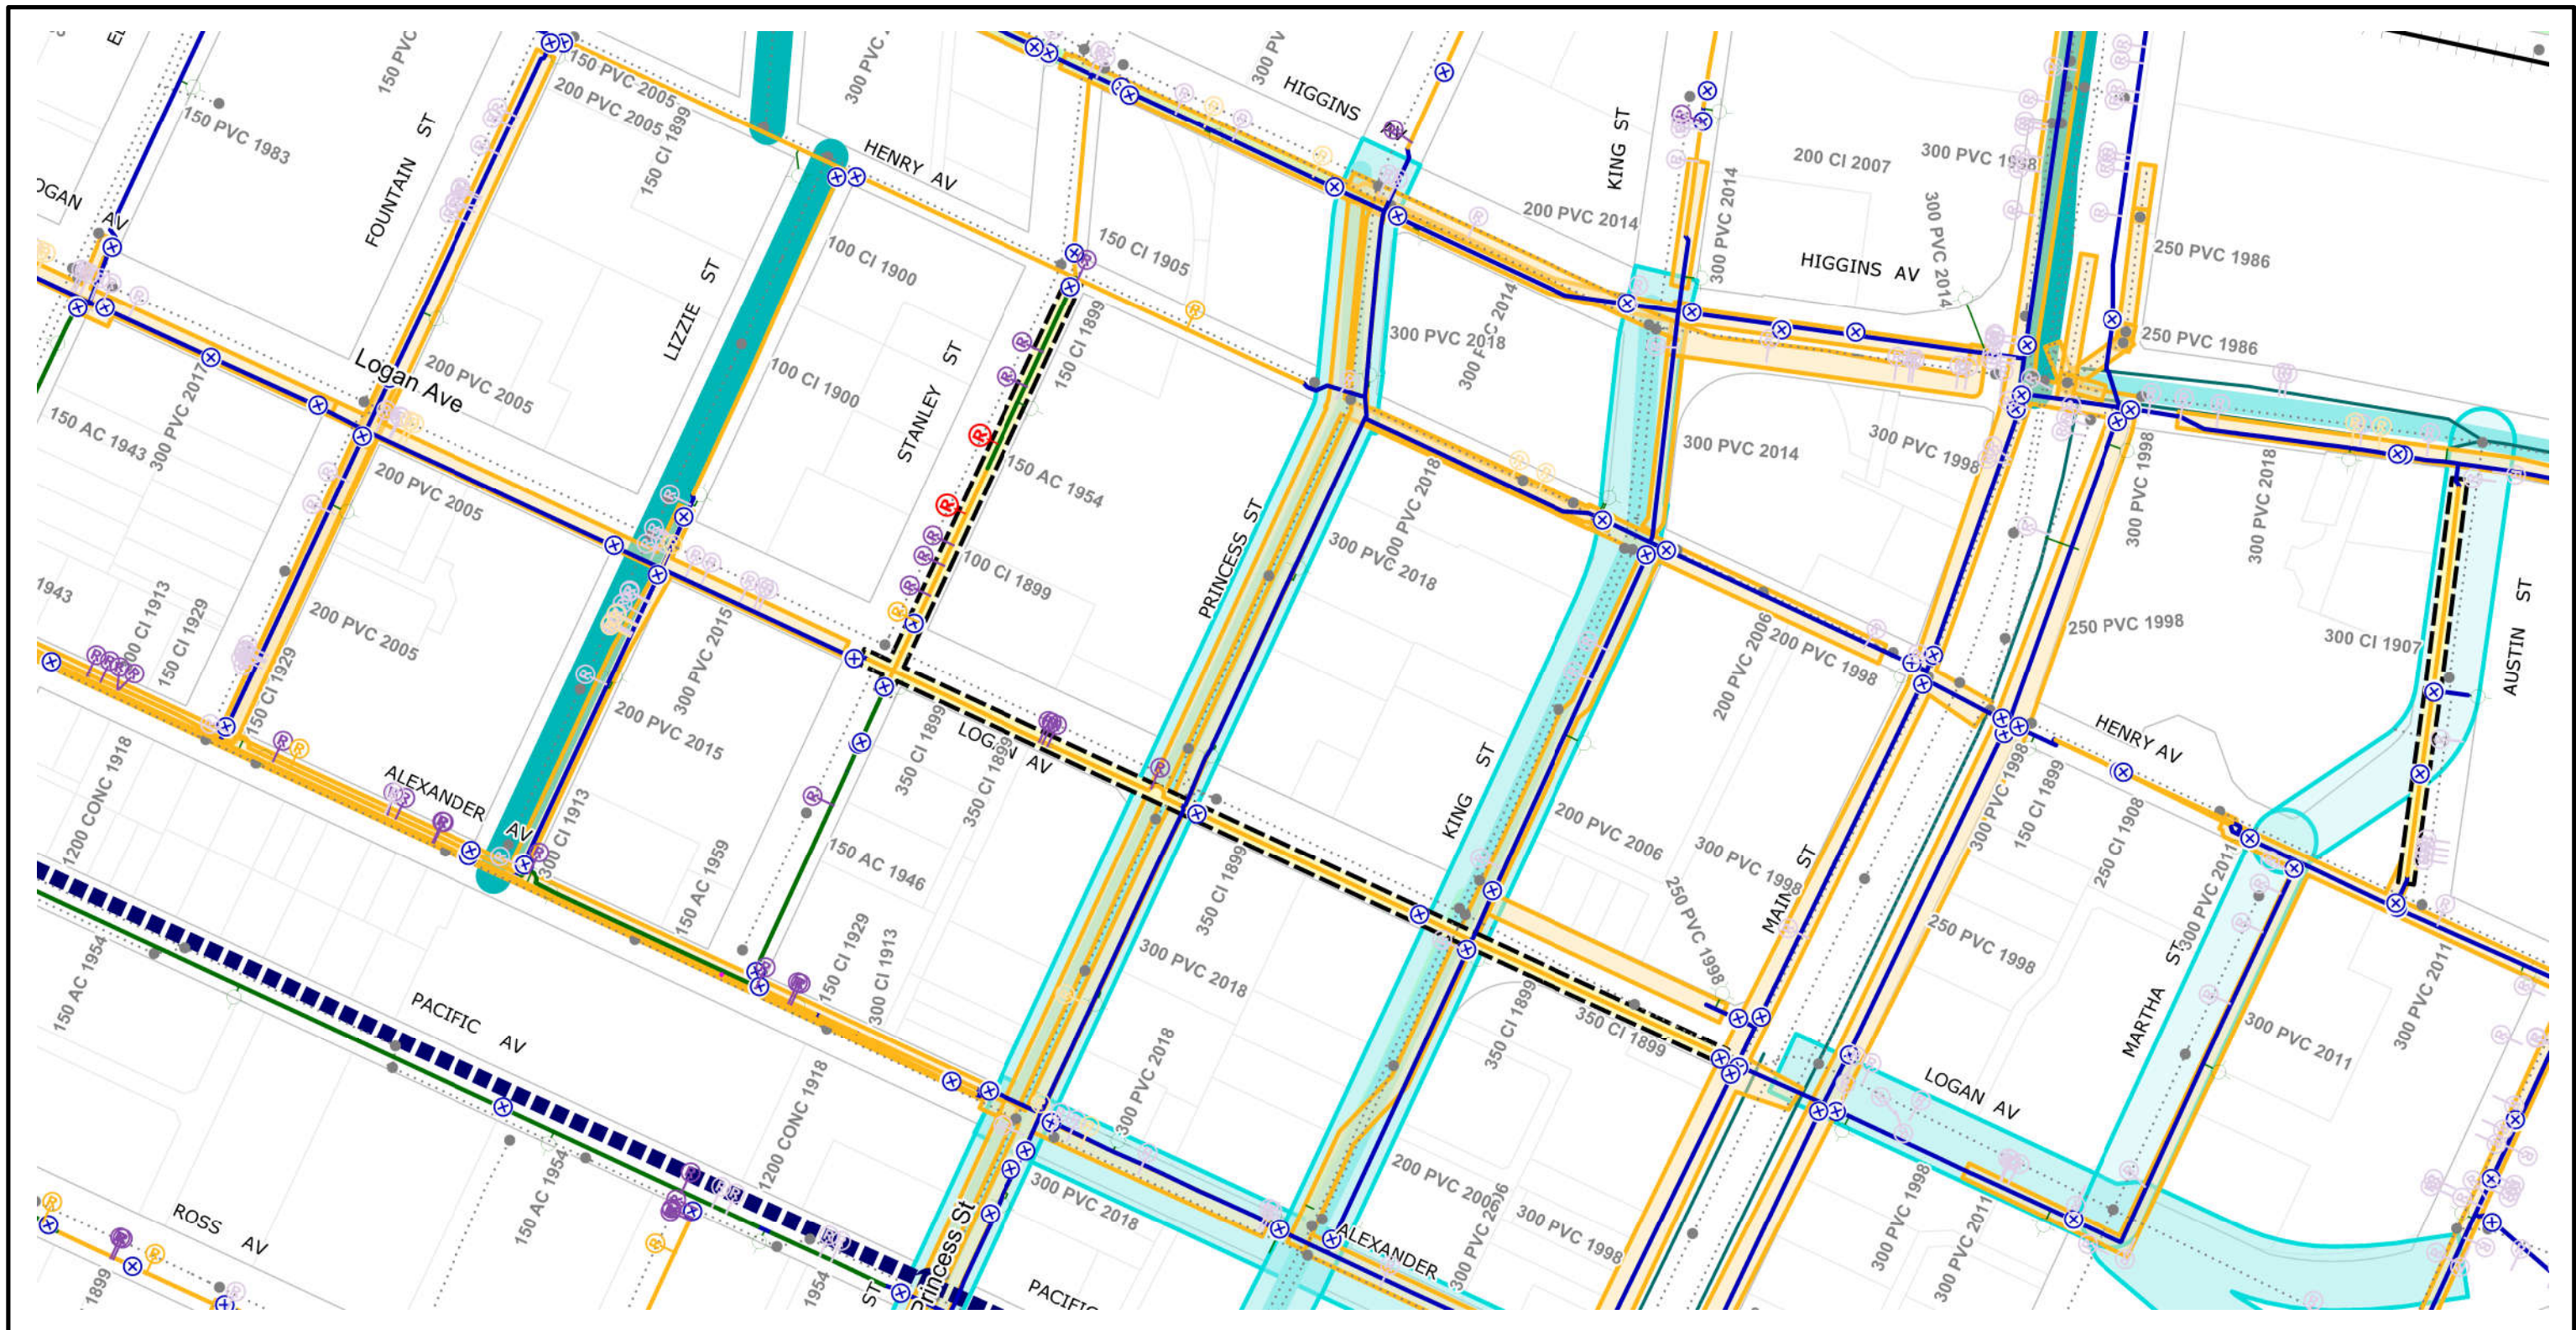

	CI WM		REPAIR 5-15YRS-ABANDON		AQUEDUCT		HISTORICAL PROJECT
	PVC WM		REPAIR >15YRS		MANHOLE		SCHOOL
	AC WM		REPAIR >15YRS-ABANDON		SEWERS		PWD PROJECT
	UNKNOWN WM		VALVE		RAILWAY		SEWER RELIEF WORK
	REPAIR <5YR		HYDRANT		WM RENEWAL		CATHODIC PROTECTION
	REPAIR <5YR-ABANDON		HYDRANT BRANCH		WM NEW		FIRE PROTECTION UPGRADE
	REPAIR 5-15YRS		FEEDER MAIN		WM ABANDON		


Additional Notes:  
 -300mm on Logan  
 -150mm on Stanley

Printed: 9/27/2024



### CITY OF WINNIPEG WATER AND WASTE DEPARTMENT 2025 WATER MAIN RENEWAL PROGRAM


Location ID: 12	Street: LOGAN AVE/ STANLEY ST
Location Description: STANLEY ST TO MAIN ST/ LOGAN AVE TO HENRY AVE	
Scale: 1:2000	Renewal Type: PWD-REGIONAL

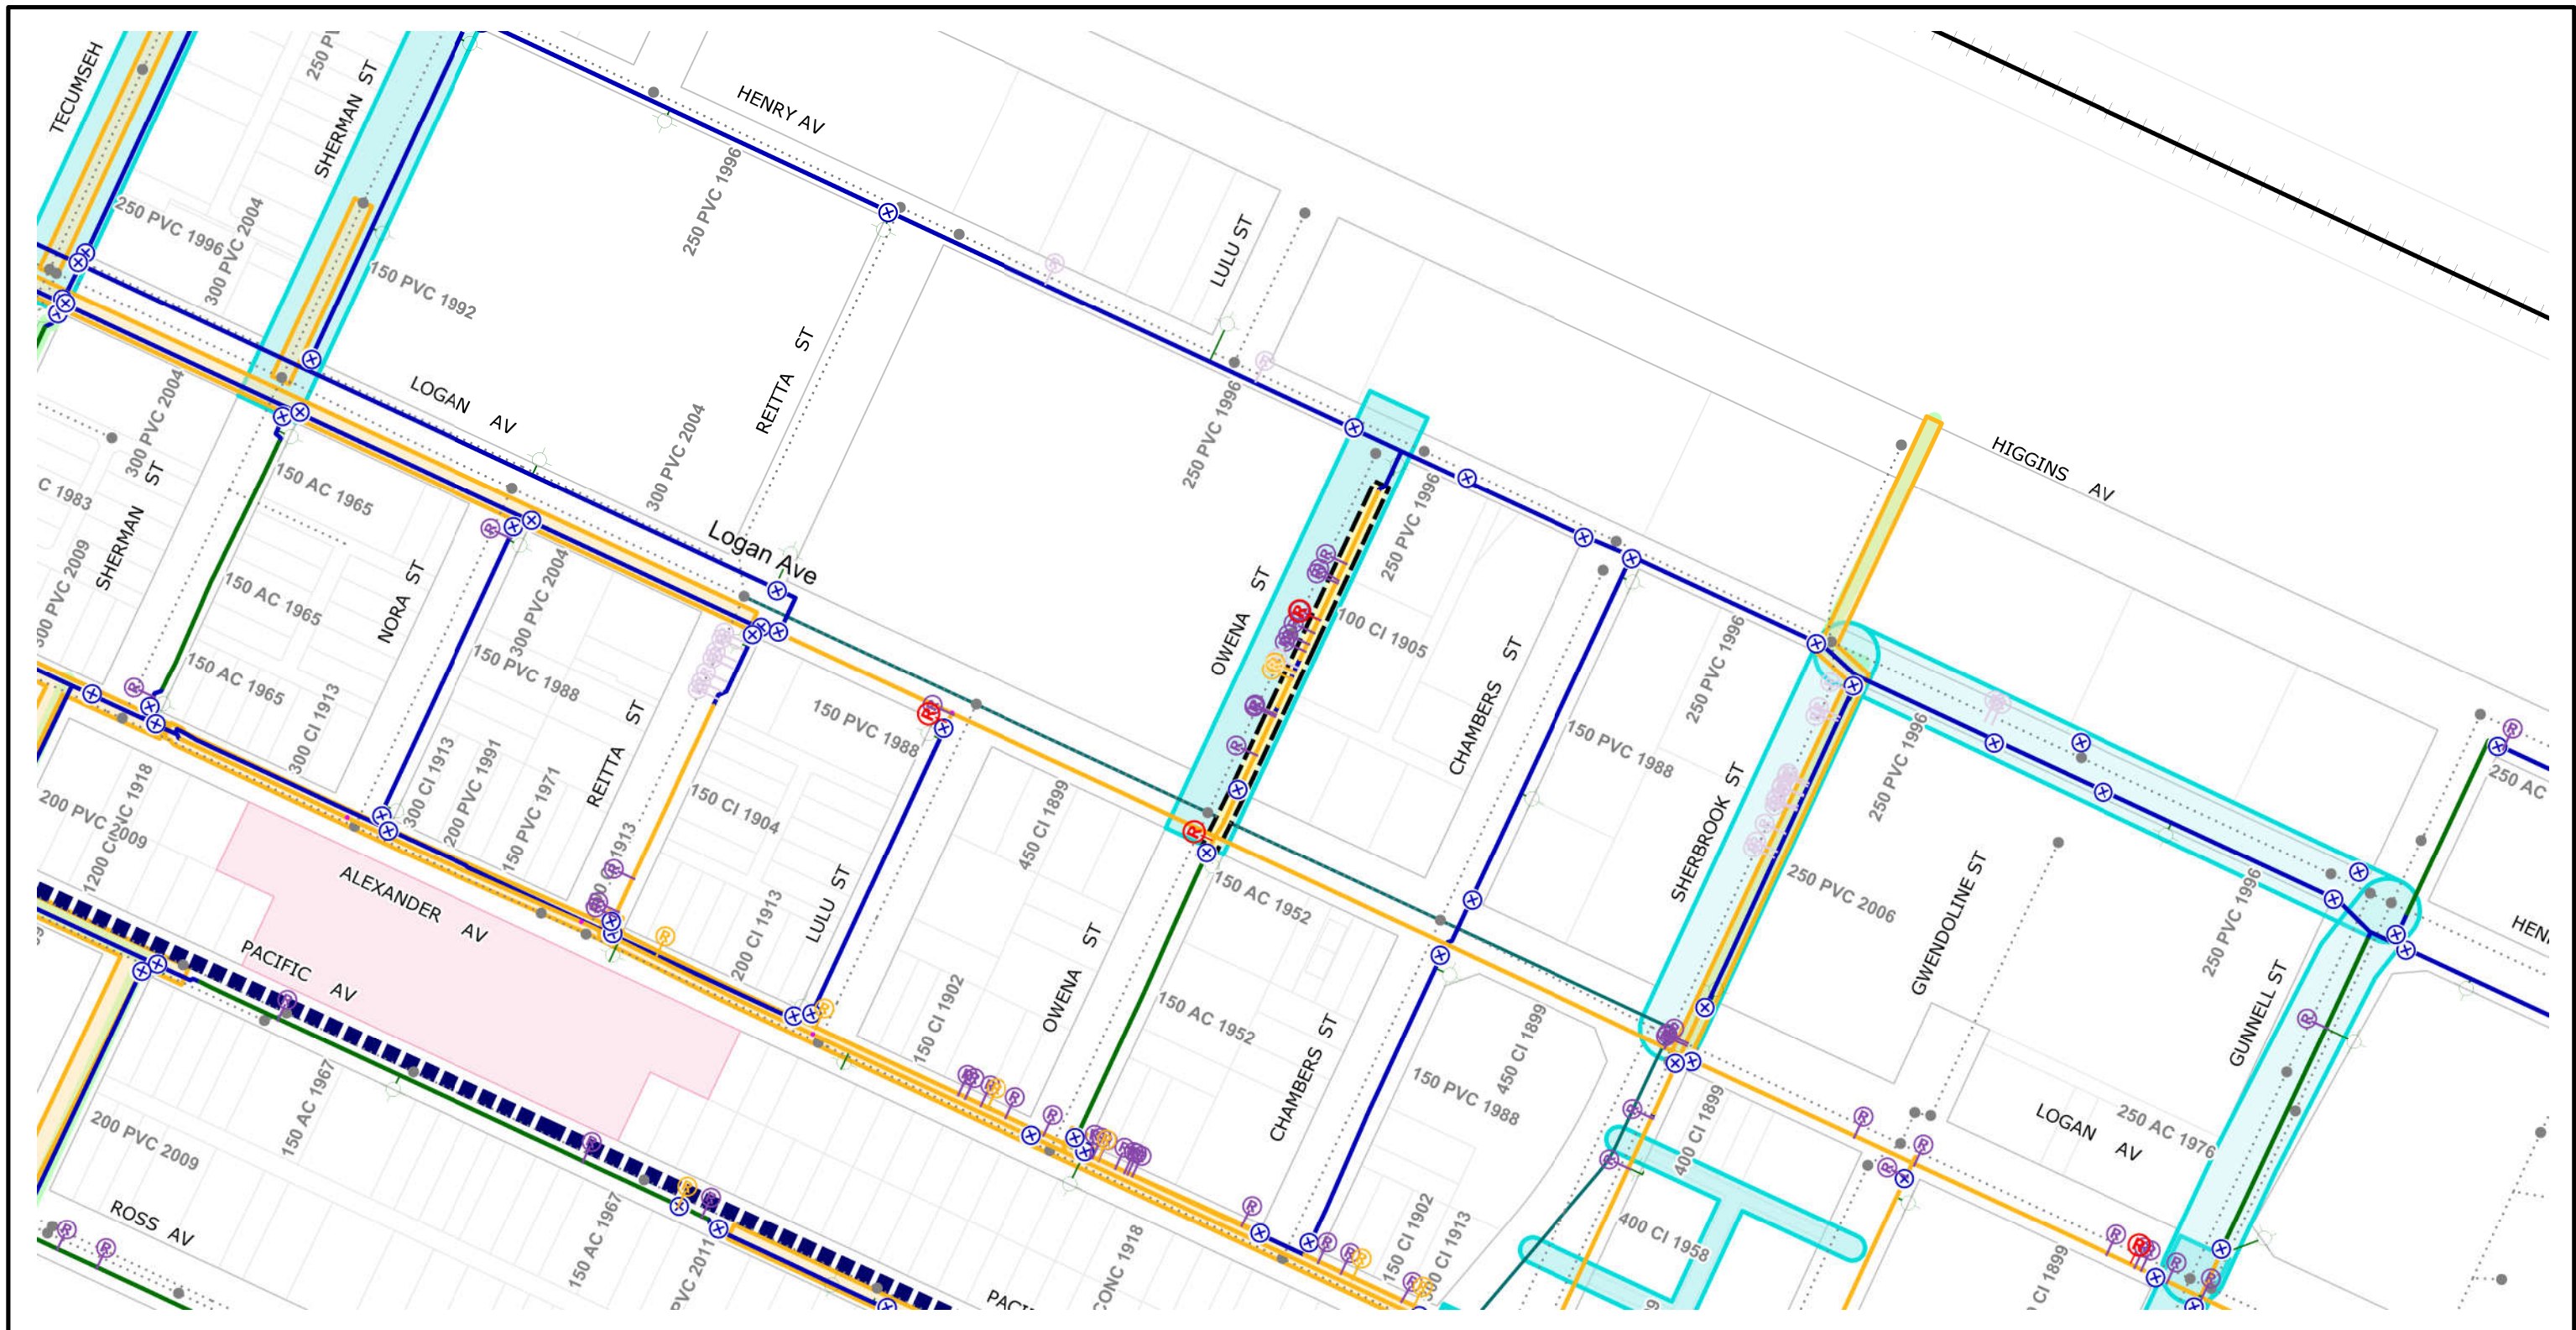

	CI WM		REPAIR < 5YRS-ABANDON		AQUEDUCT		HISTORICAL PROJECT
	PVC WM		REPAIR > 15YRS		MANHOLE		SCHOOL
	AC WM		REPAIR > 15YRS-ABANDON		SEWERS		PWD PROJECT
	UNKNOWN WM		VALVE		RAILWAY		SEWER RELIEF WORK
	REPAIR < 5YR		HYDRANT		WM RENEWAL		CATHODIC PROTECTION
	REPAIR < 5YR-ABANDON		HYDRANT BRANCH		WM NEW		FIRE PROTECTION UPGRADE
	REPAIR 5-15YRS		FEEDER MAIN		WM ABANDON		


Additional Notes:  
 -150mm is good

Printed: 9/27/2024



### CITY OF WINNIPEG WATER AND WASTE DEPARTMENT 2025 WATER MAIN RENEWAL PROGRAM


Location ID: 15	Street: OWENA ST
Location Description: HENRY AVE TO LOGAN AVE	
Scale: 1:3000	Renewal Type: PWD-INDUSTRIAL

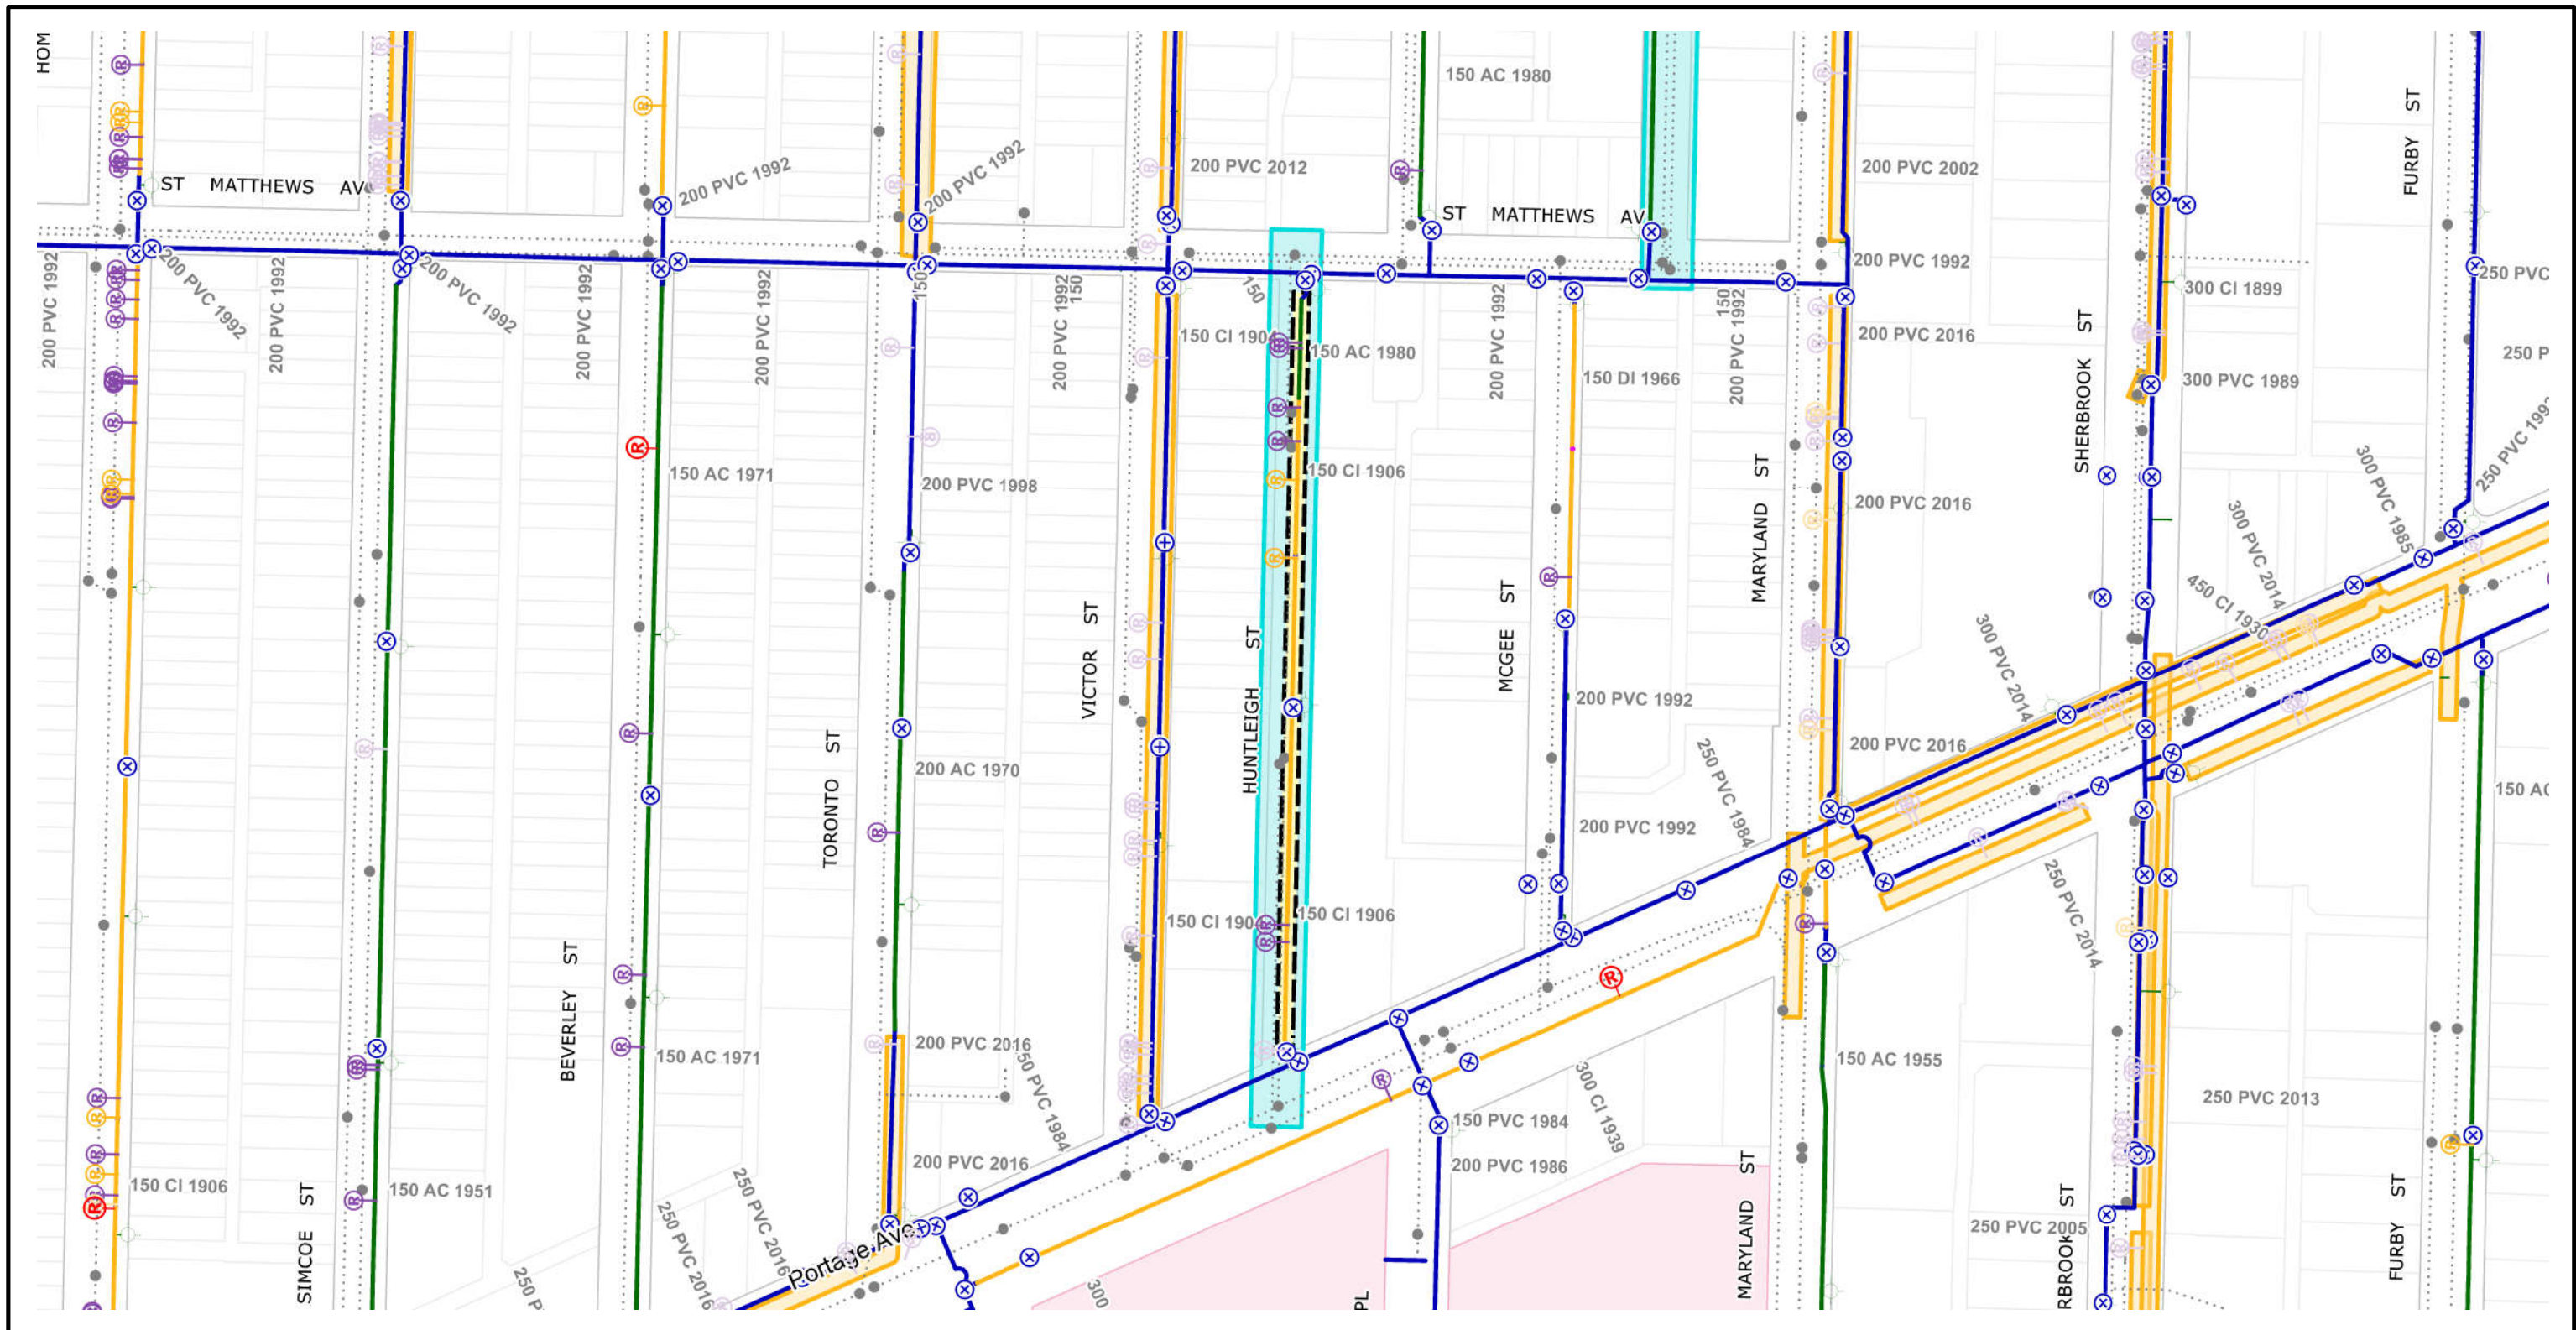

CI WM	REPAIR 5-15YRS-ABANDON	AQUEDUCT	HISTORICAL PROJECT
PVC WM	REPAIR >15YRS	MANHOLE	SCHOOL
AC WM	REPAIR >15YRS-ABANDON	SEWERS	PWD PROJECT
UNKNOWN WM	VALVE	RAILWAY	SEWER RELIEF WORK
REPAIR <5YR	HYDRANT	WM RENEWAL	CATHODIC PROTECTION
REPAIR <5YR-ABANDON	HYDRANT BRANCH	WM NEW	FIRE PROTECTION UPGRADE
REPAIR 5-15YRS	FEEDER MAIN	WM ABANDON	

Additional Notes:  
 -150mm is good  
 -Adjacent to Gordon Bell School

Printed: 9/27/2024



### CITY OF WINNIPEG WATER AND WASTE DEPARTMENT 2025 WATER MAIN RENEWAL PROGRAM

Location ID: 20	Street: HUNTLEIGH ST
Location Description: ST MATTHEWS AVE TO PORTAGE AVE	
Scale: 1:2000	Renewal Type: PWD-LOCAL