



NOTES:

1. INSTALL NEW 1P 60A BREAKER IN EXISTING PANEL B TO POWER NEW LEACHATE PUMP POWER PANEL.
2. PUMP CONTROL PANEL TO BE INSTALLED A MINIMUM OF 950mm (3FT) ABOVE GRADE AND A MINIMUM OF 4600mm (15FT) FROM PUMP RISER HEADWALL AS PER VENDOR RECOMMENDATION. COORDINATE LOCATION WITH SITE PAN.
3. PUMP COMES WITH SUPPLIED CABLING FOR CONNECTION TO JUNCTION BOXES. ELECTRICAL CONTRACTOR TO TERMINATE CABLES.
4. CONTRACTOR TO DETERMINE CABLE LENGTH FOR VENDOR SUPPLIED CABLE.
5. SENSOR IS EMBEDDED TO PUMP.
6. VENDOR SUPPLIED NEMA 4X L925PT PUMP MASTER CONTROLLER, COMPLETED WITH FACTORY INSTALLED LEVELMASTER CHS1000.
7. NEMA 4X, STAINLESS STEEL 30AT-60AF MAIN 240V, 1 PHASE, 3 WIRE, 18 CIRCUITS, NQ PANEL.
8. CONTRACTOR TO PROVIDE ALL ACCESSORIES FOR A COMPLETE HEAT TRACE SYSTEM.

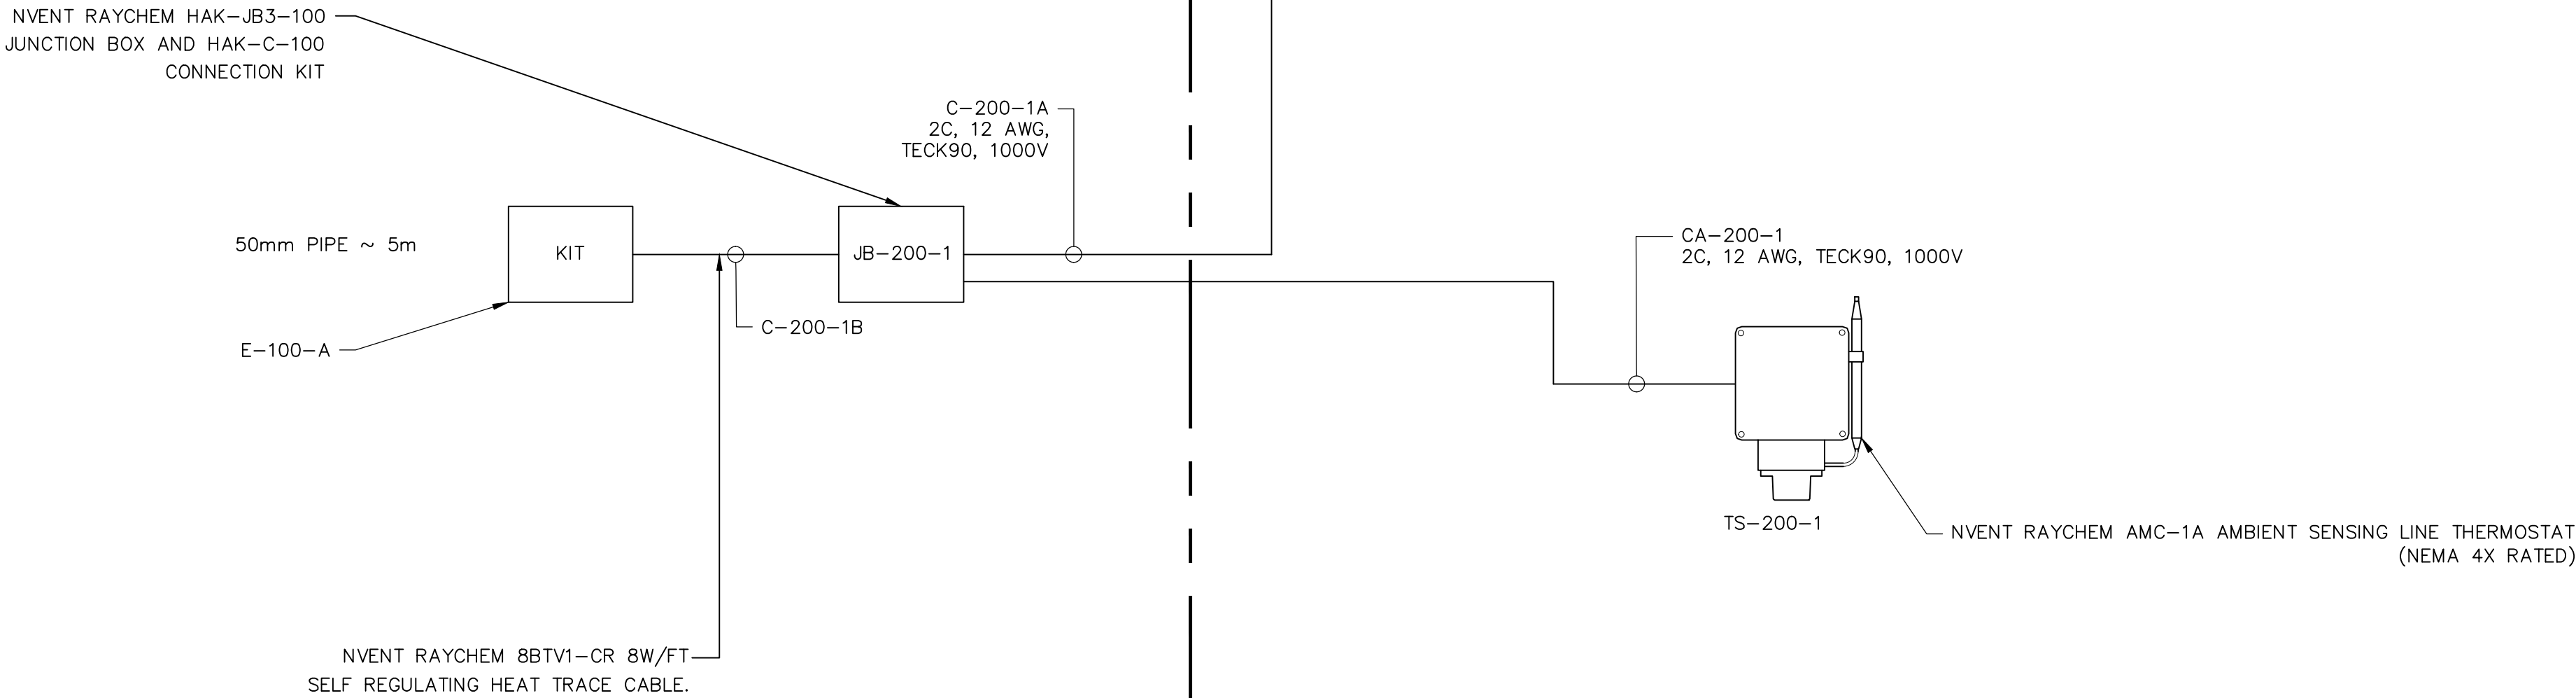

TENDER NO. 107-2025

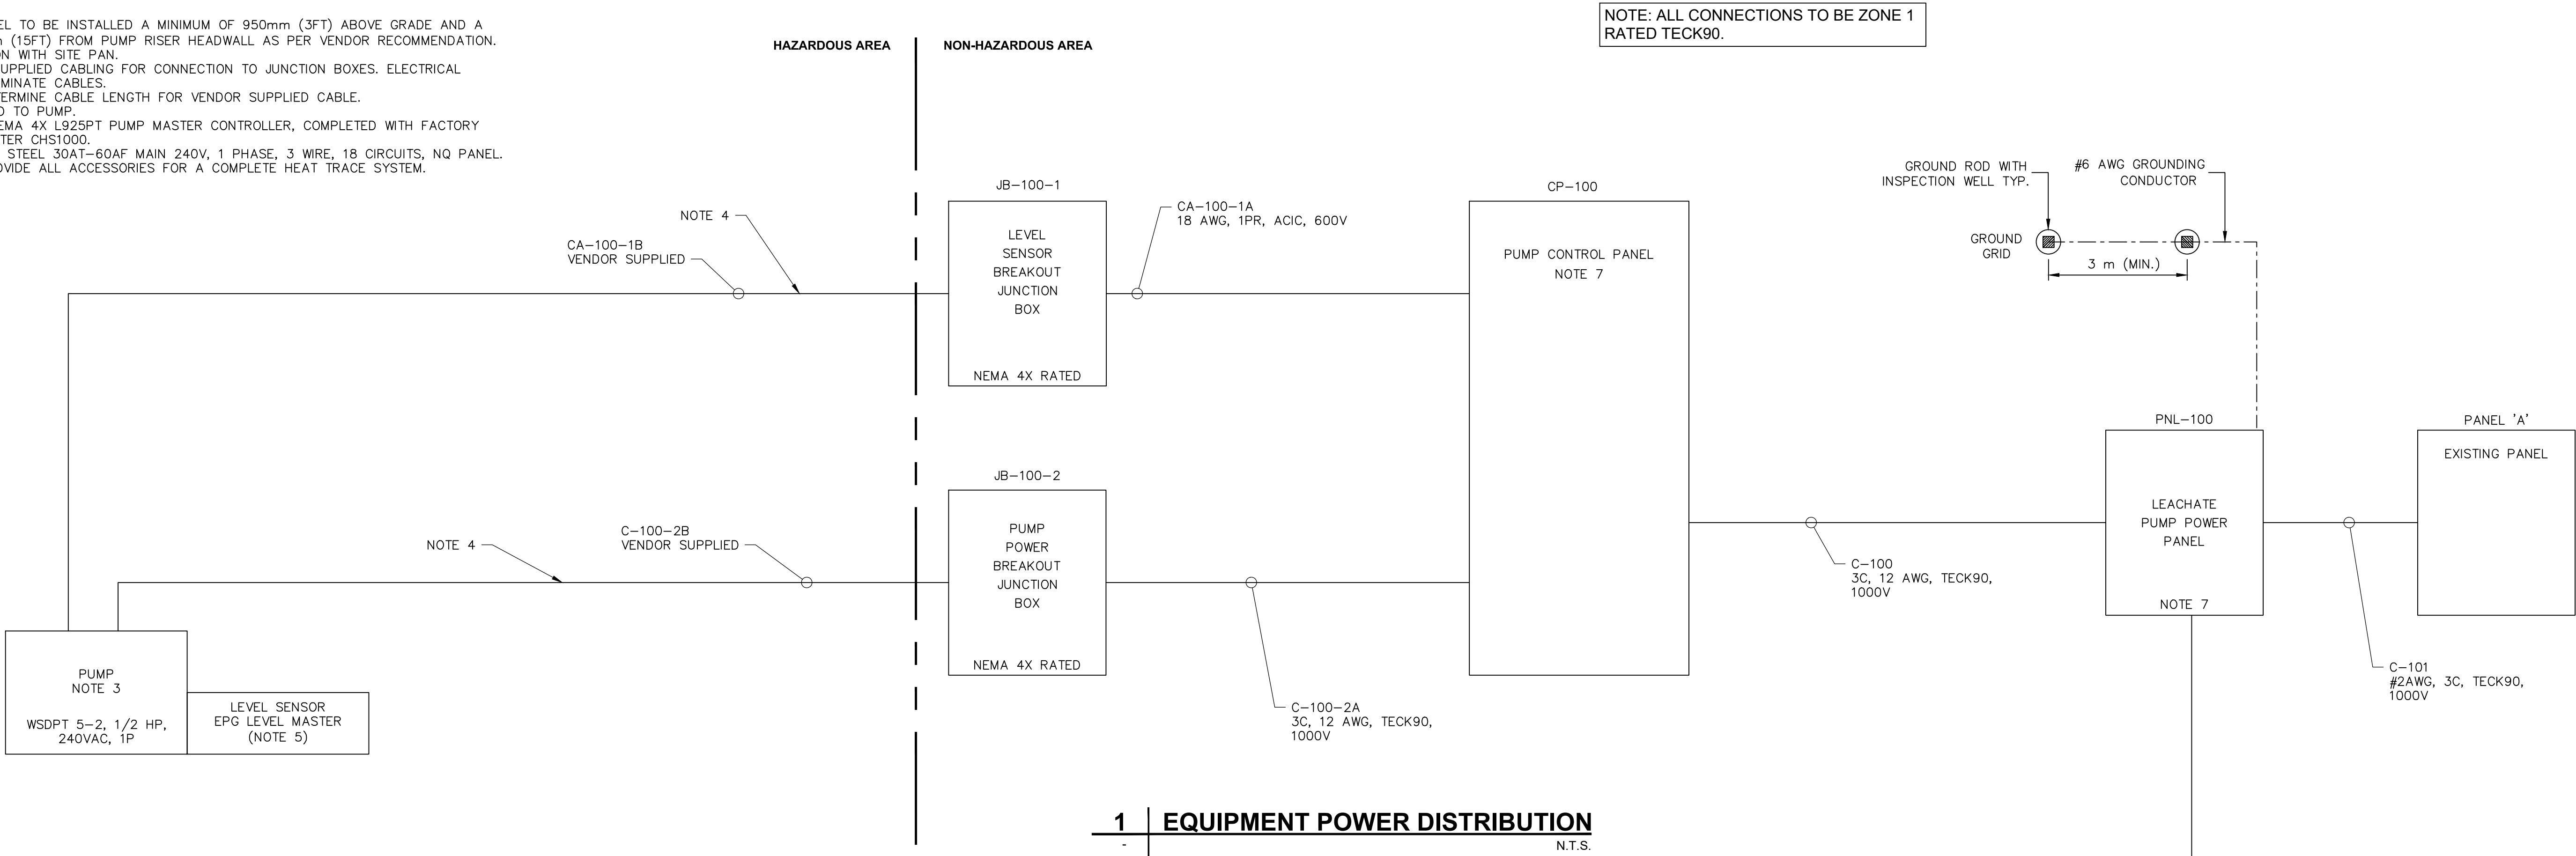

METRIC
WHOLE NUMBERS INDICATE MILLIMETRES
DECIMALIZED NUMBERS INDICATE METRES

WARNING

IF POWER EQUIPMENT OR EXPLOSIVES ARE TO BE USED FOR EXCAVATION ON THIS PROJECT THE CONTRACTOR MUST:

- 1) NOTIFY THE GAS COMPANY OF THE PROPOSED LOCATION OF EXCAVATION.
- 2) TAKE PRECAUTION TO AVOID DAMAGE TO GAS COMPANY INSTALLATIONS.

SEE PROVINCIAL REGULATION 210/72 FOR DETAILS

LOCATION APPROVED
UNDERGROUND STRUCTURES

SUPV. U/G STRUCTURES COMMITTEE DATE

NOTE:

LOCATION OF UNDERGROUND STRUCTURES AS SHOWN ARE BASED ON THE BEST INFORMATION AVAILABLE BUT NO GUARANTEE IS GIVEN THAT ALL EXISTING UTILITIES ARE SHOWN OR THAT THE GIVEN LOCATIONS ARE EXACT. CONFIRMATION OF EXISTENCE AND EXACT LOCATION OF ALL SERVICES MUST BE OBTAINED FROM THE INDIVIDUAL UTILITIES BEFORE PROCEEDING WITH CONSTRUCTION.

B.M.
ELEV.

CONSTRUCTION COMPLETION DATE: YYYY MM DD

00	ISSUED FOR TENDER	2025/03/31	MS		
NO.	REVISIONS	DATE	BY		

AECOM

DESIGNED BY	MS	CHECKED BY	KO
DRAWN BY	TW	APPROVED BY	
SCALE:		RELEASED FOR CONSTRUCTION	
HORIZONTAL	N.T.S.		
VERTICAL	-		
DATE	2025 04 01	DATE	

PLOT DATE: 2025 04 01

ENGINEER'S SEAL



THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT
SOLID WASTE SERVICES

BRADY ROAD RESOURCE MANAGEMENT FACILITY

CELL 35

INTERCONNECTION DETAILS

SHEET 24 OF 27

CITY DRAWING NUMBER

1-0400L-E0006-001

CONSULTANT DRAWING NUMBER
E-1006

FILE PATH: C:\Users\pedersen\DC\ACCDocs\AECOM\EN-AMER(CAN)-60733855-COW Brady Dump\Project Files\900 Design Collaboration\910 CAD\20-SHT
FILE NAME: 1-0400L-E0006-001.dwg