



**WATER SERVICE INFORMATION**

ADDRESS	SIZE (mm) MATERIAL (STREET)	SIZE (mm) MATERIAL (PROP.)	SHORT & LONG MEASUREMENT	LINEAR DISTANCE (1) CORP LOCATION (2)	REMARKS
1 KENNETH ST RESIDENTIAL	20 CU	-	3.70 SNL HSE	3.0 N OF S/C	RECONNECT SERVICE
2 KENNETH ST RESIDENTIAL	-	-	5.600 SSL DOWKER AVE	-	RECONNECT SERVICE
5 KENNETH ST RESIDENTIAL	20 CU	-	2.28 SNL BLDG	OPP OF S/C	RECONNECT SERVICE
6 KENNETH ST RESIDENTIAL	20 CU	20	5.17 SNL BLDG	0.4 N OF S/C	RECONNECT SERVICE
9 KENNETH ST RESIDENTIAL	20 CU	-	21.580 SSL DOWKER AVE	-	RECONNECT SERVICE
10 KENNETH ST RESIDENTIAL	20 CU	-	0.80 SNL BLDG	6.8 N OF S/C	RECONNECT SERVICE
13 KENNETH ST RESIDENTIAL	20 CU	-	35.680 SSL DOWKER AVE	-	RECONNECT SERVICE
14 KENNETH ST RESIDENTIAL	20 CU	-	2.89 SNL BLDG	OPP OF S/C	RECONNECT SERVICE
17 KENNETH ST RESIDENTIAL	20 CU	-	36.030 SSL DOWKER AVE	-	RECONNECT SERVICE
18 KENNETH ST RESIDENTIAL	20 CU	-	0.98 SNL BLDG	4.7 N OF S/C	RECONNECT SERVICE
21 KENNETH ST RESIDENTIAL	20 CU	-	52.040 SSL DOWKER AVE	-	RECONNECT SERVICE
22 KENNETH ST RESIDENTIAL	20 CU	-	2.93 SNL BLDG	OPP OF S/C	RECONNECT SERVICE
25 KENNETH ST RESIDENTIAL	20 CU	-	52.100 SSL DOWKER AVE	-	RECONNECT SERVICE
26 KENNETH ST RESIDENTIAL	20 CU	-	1.86 EWL BLDG	17.6	RECONNECT SERVICE
			68.310 SSL DOWKER AVE	1.9 N OF S/C	RECONNECT SERVICE
			67.730 SSL DOWKER AVE	7.8	RECONNECT SERVICE
			0.01 EWL BLDG	18.1	RECONNECT SERVICE
			77.960 SSL DOWKER AVE	9.7 N OF S/C	RECONNECT SERVICE
			4.31 WEL BLDG	7.3	RENEW TO R W/19mm SERVICE PIPE
			80.920 SSL DOWKER AVE	6.5 N OF S/C	RENEW TO R W/19mm SERVICE PIPE
			3.68 EWL BLDG	8.1	RENEW TO R W/19mm SERVICE PIPE (PREV. FROZEN)
			83.230 SSL DOWKER AVE	7.8 N OF S/C	RENEW TO R W/19mm SERVICE PIPE
			0.64 EWL BLDG	6.9	RENEW TO R W/19mm SERVICE PIPE
			83.230 SSL DOWKER AVE	6.9 N OF S/C	RENEW TO R W/19mm SERVICE PIPE

(1) LINEAR DISTANCE FROM THE S/C TO THE CORP USED ALONG BENDS & CURVED R.O.W. (2) DIRECTION FROM S/C  
 \* SERVICES TO BE RENEWED TO R. ALL OTHERS TO BE RECONNECTED


- 0+24.19 INSTALL HYDRANT ASSEMBLY (SD-006)
- 0+25
- 0+26.51 INSTALL 150-22' BEND
- 0+35.92 EXIST 150 COUPLING
- 0+36.60 EXIST HYDRANT ASSEMBLY
- 0+38.08 EXIST 150 COUPLING
- 0+50
- 0+75
- 0+77.00 EXIST 150 COUPLING
- 0+79.00 EXIST 150 COUPLING
- 0+95.80 EXIST 150 COUPLING
- 0+97.33 EXIST 150-45' BEND
- 0+98.48 EXIST 150-45' BEND
- 1+00.00 S R DOWKER AVE
- 1+00.00 INSTALL 150 VALVE
- 1+00.05 EXIST 150 VALVE
- 1+03.25 REMOVE EXIST 200X200X150 TEE & INSTALL 200X200X150 TEE
- 1+20.104 N R DOWKER AVE

NOTE: CHAINAGES SHOWN ARE ALONG E. R. OF KENNETH STREET

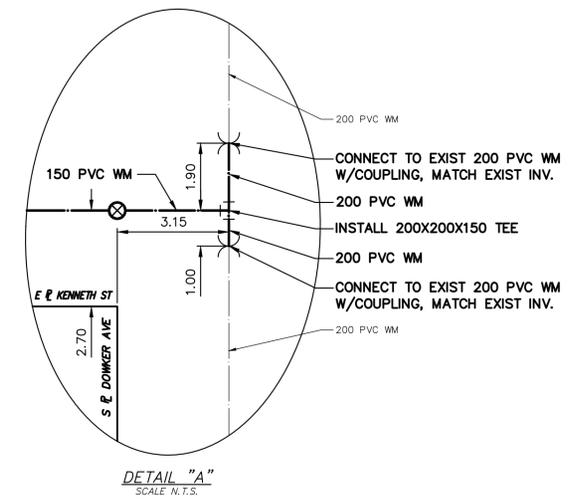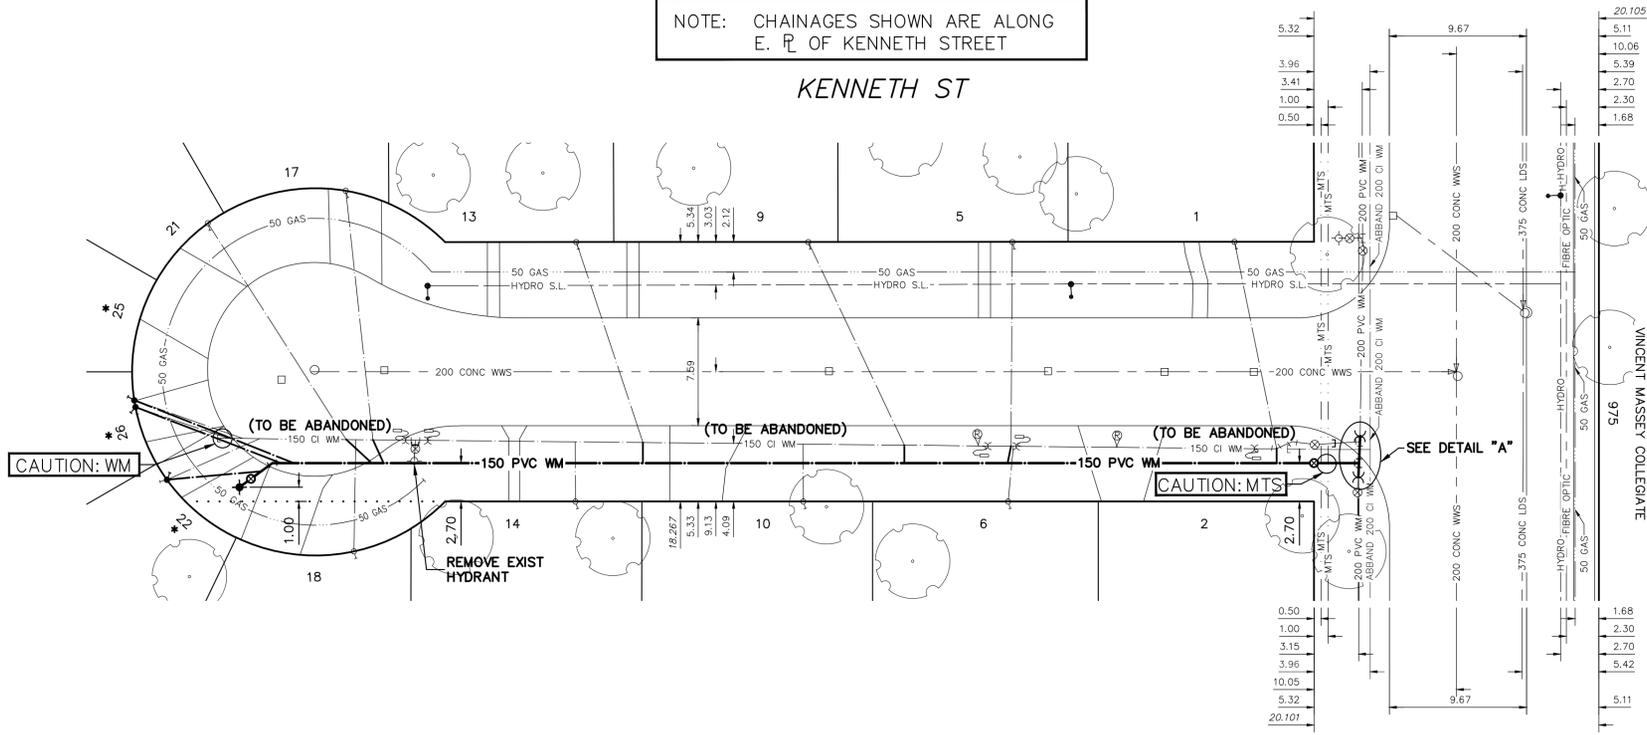

FOR INDEX SEE D-17214

NOTE: ALL VALVES TO BE INSTALLED CLOCKWISE TO CLOSE

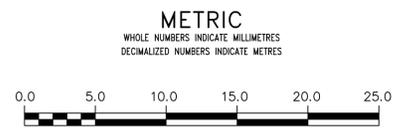


**WARNING**  
 IF POWER EQUIPMENT OR EXPLOSIVES ARE TO BE USED FOR EXCAVATION ON THIS PROJECT THE CONTRACTOR MUST:  
 1) NOTIFY THE GAS COMPANY OF THE PROPOSED LOCATION OF EXCAVATION.  
 2) TAKE PRECAUTION TO AVOID DAMAGE TO GAS COMPANY INSTALLATIONS.  
 SEE PROVINCIAL REGULATION 210/72 FOR DETAILS

**LOCATION APPROVED UNDERGROUND STRUCTURES**  
 SUPV. U/G STRUCTURES COMMITTEE DATE  
 NOTE:  
 LOCATION OF UNDERGROUND STRUCTURES AS SHOWN ARE BASED ON THE BEST INFORMATION AVAILABLE BUT NO GUARANTEE IS GIVEN THAT ALL EXISTING UTILITIES ARE SHOWN OR THAT THE GIVEN LOCATIONS ARE EXACT. CONFIRMATION OF EXISTENCE AND EXACT LOCATION OF ALL SERVICES MUST BE OBTAINED FROM THE INDIVIDUAL UTILITIES BEFORE PROCEEDING WITH CONSTRUCTION.

VERTICAL DATUM: CGVD28 (HT2.0 Geoid)  
 HORIZONTAL DATUM: NAD83 (June 1990), Zone 14

NO.	ISSUED FOR TENDER	DATE	BY
0	ISSUED FOR TENDER	2025/03/19	RG
	REVISIONS	DATE	BY

DESIGNED BY	RG	CHECKED BY	SC
DRAWN BY	AJ	APPROVED BY	SC
SCALE:		RELEASED FOR CONSTRUCTION	
HORIZONTAL	1:250		
VERTICAL	1:50		
DATE	2025 03 19	DATE	
PLOT DATE:	2025 03 19		



**THE CITY OF WINNIPEG**  
 WATER AND WASTE DEPARTMENT  
 ENGINEERING DIVISION

2025 WATER MAIN RENEWALS  
 CONTRACT 5  
**KENNETH STREET**  
 DOWKER AVENUE TO  
 72.8m S OF DOWKER AVENUE

SHEET 5 OF 11  
 CITY DRAWING NUMBER  
**D-17217**