



The Contractor shall verify and be responsible for all dimensions. DO NOT scale the drawing - any errors or omissions shall be reported to Stantec without delay. The Copyrights to all designs and drawings are the property of Stantec. Reproduction or use for any purpose other than that authorized by Stantec is forbidden.

### Legend

By	Appd.	YY.MM.DD
----	-------	----------

CB      AA      25.06.04

By	Appd.	YY.MM.DD
----	-------	----------

Dwn. Chkd. Dsgn. YY.MM.DD

**ENGINEERS  
GEOSCIENTISTS  
MANITOBA**  
Certificate of Authorization  
Stantec Consulting Ltd.  
No. 1301

# WINNIPEG TRANSIT MAINTENANCE FACILITY OFFICE REDEVELOPMENT

Title  
ELECTRICAL DETAILS

Scale  
 $1/8" = 1'-0"$

Sheet                      Revision

14 of 17


0



1. ALL COMMUNICATION LINES ARE TO BE TESTED BY A CERTIFIED INSTALLER FOR CATEGORY 6. PERFORMANCE UPON COMPLETION OF INSTALLATION. A TESTING REPORT IS TO BE PROVIDED.
2. CONTRACTOR TO SUPPLY PATCH CORDS FOR ALL CONNECTED EQUIPMENT AND ONE PATCH CORD FOR EACH DATA JACK. PATCH CORD TO BE 6'.



1. COORDINATE REQUIREMENTS WITH DOOR HARDWARE EQUIPMENT SUPPLIER. CONTRACTORS TO PROVIDE COMMUNICATION CABLE IN CONDUIT BETWEEN CARD ACCESS CONTROL PANEL.
2. CONTRACTOR RESPONSIBLE FOR PROVIDING AND WIRING ACCESS CONTROL SYSTEM.
3. REFER TO WINNIPEG TRANSIT MASTER SECURITY STANDARD 2024 UPDATED V8 FOR ADDITIONAL DETAILS.

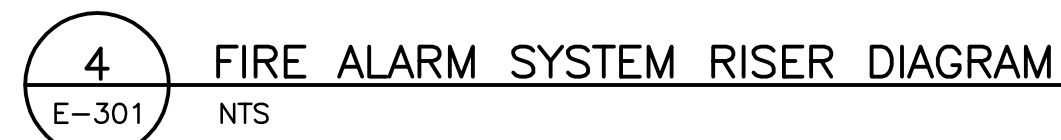

- ① ALL NEW DEVICES TO MATCH EXISTING SIEMENS (NOTIFIER) FIRE ALARM SYSTEM.
- ② PROVIDE BOOSTER PANELS AS REQUIRED TO ACCOMMODATE FIRE ALARM ANNUNCIATION DEVICES. CONNECT EACH BOOSTER PANEL TO A DEDICATED 120V, 15A-1P RED BREAKER C/W LOCK-ON DEVICE. COORDINATE LOCATION OF BOOSTER PANELS WITH THE OWNER PRIOR TO ROUGH-IN.
- ③ PROVIDE NEW SIGNALING DEVICES AND CONNECT TO EXISTING FIRE ALARM SYSTEM AS SHOWN. PROVIDE VERIFICATION INSPECTION REPORT FOR ALL NEW AND RELOCATED DEVICES.
- ④ PROVIDE DEDICATED NOTIFICATION LOOP FOR EACH OF THE TWO RENOVATION AREAS.